



HEAT CONTROLLER

Design Guide

Brazed Plate Geothermal Closed Loop Water-to-Water (HEW) Series

Table of Contents

Design Features	3	Electrical Data	21
Unit Model Key	5	HEW 036 & 060 Electrical Wiring Diagram	22
AHRI/ISO/ASHRAE/ANSI 13256-2 Performance	6	HEW 120 Electrical Wiring Diagram.....	23
Performance Data Selection Notes	7	Engineering Guide Specifications.....	24
Performance Data	8	Accessories & Options	25
Physical Data.....	19	Revision History.....	28
HEW 036, 060 & 120 Dimensions	20		

Water-To-Water (HEW) Series Features

Water-To-Water (HEW) Series

The HEW water to water series offers a wide range of units for most any installation with an extended range refrigerant circuit, capable of ground loop (geothermal) applications. As MARS/Heat Controller most adaptable EarthPure® HFC-410A refrigerant units, the HEW Series can be used for radiant floor heating, snow/ice melt, chilled water for fan coils, potable hot water generation, hot/chilled water for make-up air, and many other types of HVAC applications.

Available in sizes 036 [8.7 kW], 060 [13.5 kW] and 120 [26.9 kW] the HEW Series offers a wide range of units for most any installation. The HEW has an extended range refrigerant circuit, capable of ground loop (geothermal) applications as well as water loop (boiler-tower) applications. Standard features are many. Microprocessor controls, galvanized steel cabinet, powder coat paint, stainless steel front access panels and TXV refrigerant metering device are just some of the features of the flexible HEW Series.

MARS/Heat Controller exclusive dual level compressor isolation mounting system makes the HEW Series the quietest water-to-water unit on the market. Compressors are mounted on vibration isolation grommets to a heavy gauge mounting plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration/sound attenuation.

The HEW Series water-to-water heat pumps are designed to meet the challenges of today's HVAC demands with a high efficiency, high value solution.

Application Flexibility

- Three Capacities 036 [8.7 kW], 060 [13.5 kW], & 120 [26.9 kW].
- Copeland scroll compressors.
- Dual refrigeration circuits on size 120.
- Galvanized steel construction with epoxy powder coat paint.
- Insulated compressor compartment.
- TXV metering device.
- Extended range (20 to 120°F, -6.7 to 48.9°C) operation.
- Microprocessor controls standard.
- 1" swivel-type water connections for models 036 & 060.
- Flush securely-mounted corner post water connections (no backup wrench required) for model 120.
- Compressor "run" and "fault" lights on the front of the cabinet.
- Seven Safeties Standard.
- Intended for closed loop (geothermal) applications only.

Service & Installation Advantages

- Three Removable access panels.
- Low profile control box grants easy access to all internal components.
- Factory installed liquid line filter/drier.
- EarthPure® HFC-410A zero ozone depletion refrigerant.
- Brass swivel-type water connections for quick connection and elimination of wrenches or sealants during

installation.

- Bi-directional thermal expansion valve.
- DXM control features status lights with memory for easy diagnostics.
- Circuit breaker protected 75VA control transformer.
- High and low pressure service ports on refrigerant circuit.
- Accurate refrigerant sensing low-temperature protection.
- Solid state DXM control features: Anti-short cycle, high & low pressure, loss of charge protection, LED fault, and status indication with memory for easy diagnostics.
- 24vac accessory relays.
- Strainers shipped loose for field installation in load and source water in lines.


Factory Quality & Certifications

- All units are built on our Integrated Process Control Assembly System (IPCS). The IPCS is a unique state-of-the-art manufacturing system that is designed to assure quality of the highest standards of any manufacturer in the water-source industry. Our IPCS system:
 - Verifies that the correct components are being assembled.
 - Automatically performs special leak tests on all joints.
 - Conducts pressure tests.
 - Performs highly detailed run test unparalleled in the HVAC industry.
 - Automatically disables packaging for a "failed" unit.
 - Creates computer database for future service analysis and diagnostics from run test results.
- All units are water run-tested in all modes to insure efficiency and reliability.
- Heavy gauge galvanized steel cabinets are epoxy powder coated for durable and long-lasting finish.
- All refrigerant brazing is done in a nitrogen atmosphere.
- All units are deep evacuated to less than 100 microns prior to refrigerant charging.
- All joints are both helium and halogen leak tested to insure annual leak rate of less than 1/4 ounce.
- Brazed Plate heat exchanger, refrigerant suction lines and all water lines are fully insulated to eliminate condensation problems in low temperature applications.
- Noise reduction features include: dual level compressor isolation, insulated compressor compartment, interior cabinet insulation using 1/2" coated glass fiber, and variable speed fan.
- Safety features include: high pressure and loss of charge to protect the compressor, condensate overflow protection, low-temperature protection sensors and flow switches to safeguard the brazed plate heat exchanger, hot water high-limit, and low compressor discharge temperature switch provided to shut down the hot water generator when conditions dictate. Fault lockout enables emergency heat and prevents compressor operation until thermostat or circuit breaker has been reset.
- Standard 10-year limited warranty on all parts with 5-year labor allowance; Optional additional extended 5-year limited labor allowance available.
- AHRI/ASHRAE/ANSI/ISO 13256-2 certified.
- ETL listed.

Water-To-Water (HEW) Series Features

- 1** Copeland™ High Efficiency Scroll Compressor
- 2** Optional Hot Water Generator With Internal Pump
- 3** Fully Insulated Water and Refrigerant Lines
- 4** Fully Insulated Compressor Section
- 5** Powder Coated Steel Cabinet with Stainless Steel Access Panels For Long Life
- 6** System Operating LED Lights
- 7** Unit Performance Sentinel: Automatic Alert System Lets You Know If The System Is Not Running At Peak Performance
- 8** Dual Level Compressor Isolation Mounting for Ultra Quiet Operation
- 9** Multiple Removable Access Panels for Service
- 10** Brazed Plate heat exchangers

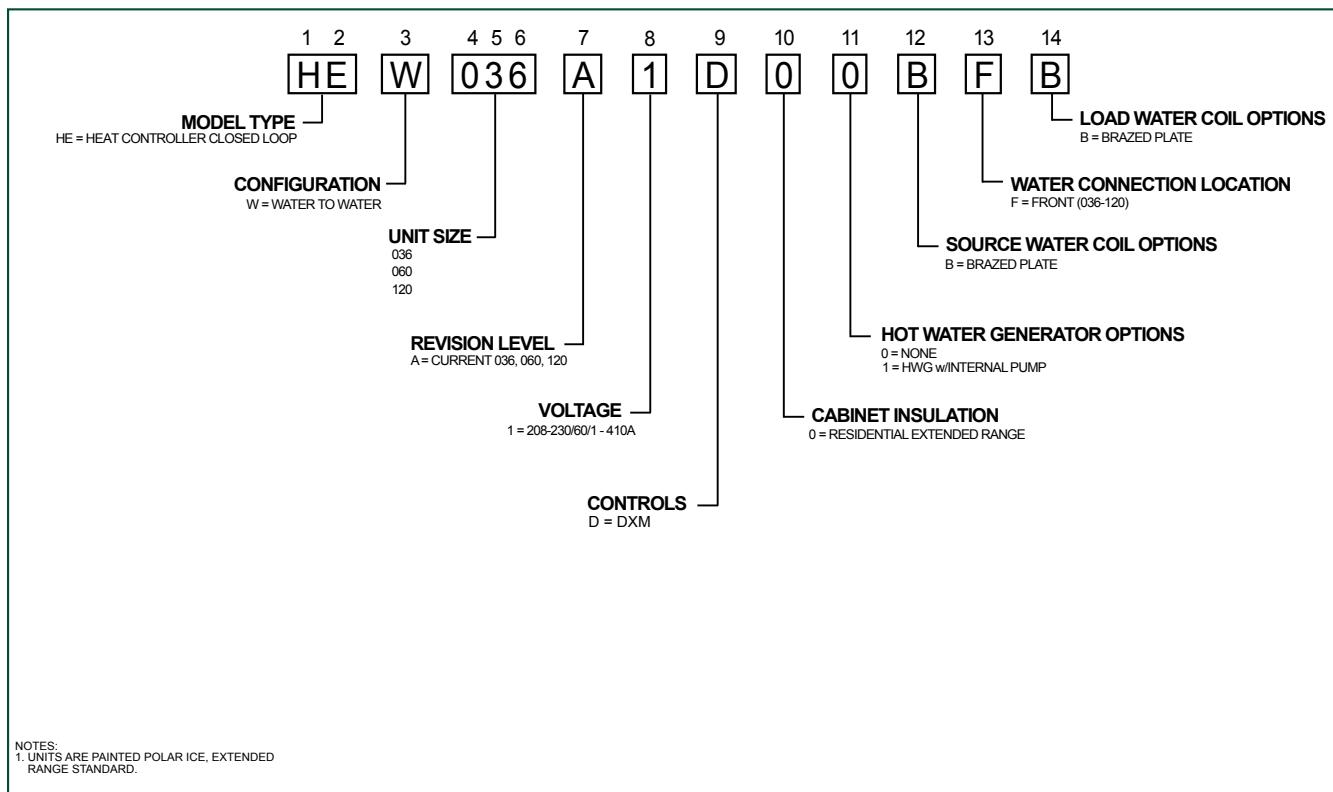

Unit Model Key**⚠ WARNING! ⚠**

WARNING! HEW is for GROUND LOOP INSTALLATIONS ONLY. Installing HEW on open loop system will void warranty and unit will not be eligible for federal tax credit.

AHRI/ISO/ASHRAE/ANSI 13256-2 Performance

ASHRAE/AHRI/ISO 13256-2. English (I-P) Units

Model	Ground Loop Heat Pump			
	Cooling		Heating	
	Indoor 53.6°F Outdoor 77°F		Indoor 104°F Outdoor 32°F	
	Capacity Btuh	EER Btuh/W	Capacity Btuh	COP
HEW036	30,400	16.5	26,900	3.1
HEW060	56,700	17.3	47,100	3.1
HEW120	113,400	17.3	94,200	3.1

All ratings based upon 208V operation
Indoor coil also called "Load" and outdoor coil also called "Source"

ASHRAE/AHRI/ISO 13256-2. Metric (S-I) Units

Model	Ground Loop Heat Pump			
	Cooling		Heating	
	Indoor 12°C Outdoor 25°C		Indoor 40°C Outdoor 0°C	
	Capacity Watts	EER W/W	Capacity Watts	COP
HEW036	8.91	4.8	7.88	3.1
HEW060	16.62	5.1	13.80	3.1
HEW120	33.24	5.1	27.61	3.1

All ratings based upon 208V operation
Indoor coil also called "Load" and outdoor coil also called "Source"

Performance Data Selection Notes

For operation in the shaded area when water is used in lieu of an anti-freeze solution, the LWT (Leaving Water Temperature) must be calculated. Flow must be maintained to a level such that the LWT is maintained above 40°F [4.4°C] when the JW3 jumper is not clipped (see example below). Otherwise, appropriate levels of a proper anti-freeze should be used in systems with leaving water temperatures of 40°F or below and the JW3 jumper should be clipped. This is due to the potential of the refrigerant temperature being as low as 32°F [0°C] with 40°F [4.4°C] LWT, which may lead to a nuisance cutout due to the activation of the Low Temperature Protection. JW3 should never be clipped for standard range equipment or systems without antifreeze.

Example:

At 50°F EWT (Entering Water Temperature) and 1.5 gpm/ton, a 3 ton unit has a HE of 22,500 Btuh. To calculate LWT, rearrange the formula for HE as follows:

HE = TD x GPM x 500, where HE = Heat of Extraction (Btuh);
 TD = temperature difference (EWT - LWT) and GPM = U.S. Gallons per Minute.

$$TD = HE / (GPM \times 500)$$

$$TD = 22,500 / (4.5 \times 500)$$

$$TD = 10^{\circ}\text{F}$$


$$LWT = EWT - TD$$

$$LWT = 50 - 10 = 40^{\circ}\text{F}$$

In this example, as long as the EWT does not fall below 50°F, the system will operate as designed. For EWTs below 50°F, higher flow rates will be required (open loop systems, for example, require at least 2 gpm/ton when EWT is below 50°F).

Antifreeze Correction Table

Antifreeze Type	Antifreeze %	Cooling			WPD Corr. Fct. EWT 40°F	
		EWT 40°F				
		Total Cap	Sens Cap	Power		
Propylene Glycol	15	0.968	0.968	0.990	1.210	
	25	0.947	0.947	0.983	1.360	
Methanol	15	0.968	0.968	0.990	1.160	
	25	0.949	0.949	0.984	1.220	
Ethanol	15	0.944	0.944	0.983	1.300	
	25	0.917	0.917	0.974	1.360	
Ethylene Glycol	15	0.980	0.980	0.994	1.120	
	25	0.966	0.966	0.990	1.200	

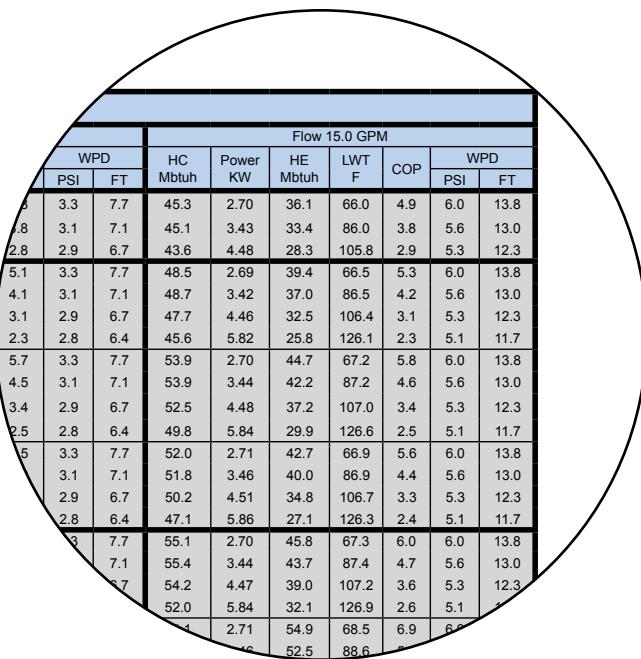

Performance Data — HEW036 - Cooling

SOURCE			LOAD																									
EWT °F	Flow		EWT °F	Flow 4.5 GPM								Flow 6.8 GPM								Flow 9.0 GPM								
	GPM	WPD		TC Mb-tuh	Power kW	HR Mbtuhr	LWT °F	EER	WPD		TC Mb-tuh	Power kW	HR Mbtuhr	LWT °F	EER	WPD		TC Mb-tuh	Power kW	HR Mbtuhr	LWT °F	EER	WPD					
		PSI	FT						PSI	FT						PSI	FT											
50	4.5	1.3	3.1	50	32.5	1.49	37.6	35.6	21.8	0.6	1.4	34.5	1.52	39.7	39.8	22.7	1.4	3.2	35.3	1.5	40.5	42.1	23.2	2.6	5.9			
				60	36.8	1.53	42.0	43.6	24.1	0.5	1.2	38.4	1.54	43.6	48.6	24.9	1.3	3.1	39.2	1.5	44.5	51.3	25.3	2.5	5.8			
				70	40.4	1.55	45.7	52.0	26.0	0.5	1.1	41.6	1.56	47.0	57.7	26.6	1.3	2.9	42.4	1.6	47.8	60.6	27.0	2.4	5.6			
				80	43.2	1.57	48.6	60.8	27.5	0.4	0.9	44.2	1.58	49.6	66.9	28.0	1.2	2.8	44.8	1.6	50.3	70.0	28.1	2.3	5.4			
	6.8	3.4	7.8	90	45.1	1.58	50.5	69.9	28.6	0.3	0.8	46.2	1.60	51.7	76.3	28.9	1.1	2.6	46.6	1.6	52.1	79.7	28.9	2.2	5.1			
				50	32.9	1.41	37.7	35.4	23.3	0.6	1.4	34.9	1.44	39.8	39.7	24.2	1.4	3.2	35.8	1.4	40.7	42.0	24.8	2.6	5.9			
				60	37.3	1.45	42.2	43.4	25.7	0.5	1.2	38.9	1.46	43.9	48.5	26.6	1.3	3.1	39.7	1.5	44.7	51.2	27.1	2.5	5.8			
				70	40.9	1.47	46.0	51.8	27.8	0.5	1.1	42.2	1.48	47.2	57.5	28.4	1.3	2.9	42.9	1.5	48.0	60.5	28.8	2.4	5.6			
		9.0	6.0	80	43.8	1.49	48.9	60.5	29.4	0.4	0.9	44.8	1.50	49.9	66.7	29.9	1.2	2.8	45.4	1.5	50.6	69.9	30.0	2.3	5.4			
				90	45.7	1.50	50.8	69.7	30.5	0.3	0.8	Operation not recommended																
				50	33.3	1.33	37.8	35.2	25.1	0.6	1.4	35.4	1.35	40.0	39.5	26.1	1.4	3.2	36.2	1.4	40.9	41.9	26.8	2.6	5.9			
				60	37.8	1.36	42.4	43.2	27.8	0.5	1.2	39.4	1.37	44.0	48.3	28.7	1.3	3.1	40.2	1.4	44.9	51.1	29.2	2.5	5.8			
		9.0	13.9	70	41.5	1.38	46.2	51.6	30.0	0.5	1.1	42.7	1.39	47.5	57.3	30.7	1.3	2.9	43.5	1.4	48.3	60.3	31.1	2.4	5.6			
				80	44.3	1.40	49.1	60.3	31.7	0.4	0.9	45.4	1.41	50.2	66.6	32.3	1.2	2.8	46.0	1.4	50.8	69.8	32.5	2.3	5.4			
				90	46.3	1.41	51.1	69.4	33.0	0.3	0.8	Operation not recommended																
				50	30.1	1.96	36.8	36.6	15.3	0.6	1.4	32.1	1.95	38.8	40.5	16.4	1.4	3.2	33.0	2.0	39.7	42.7	16.7	2.6	5.9			
	4.5	1.0	2.3	60	34.1	1.98	40.9	44.8	17.2	0.5	1.2	37.6	1.96	44.3	48.9	19.2	1.3	3.1	36.6	2.0	43.3	51.9	18.7	2.5	5.8			
				70	39.0	2.01	45.9	52.7	19.4	0.5	1.1	41.7	1.98	48.5	57.6	21.0	1.3	2.9	39.9	2.0	46.7	61.1	19.9	2.4	5.6			
				80	42.7	2.03	49.7	61.0	21.1	0.4	1.0	45.4	2.01	52.3	66.5	22.5	1.2	2.8	42.9	2.0	49.8	70.5	21.1	2.3	5.4			
		6.8	2.8	90	46.2	2.05	53.2	69.5	22.5	0.3	0.8	Operation not recommended																
				50	30.5	1.86	36.8	36.5	16.4	0.6	1.4	32.5	1.85	38.8	40.4	17.5	1.4	3.2	33.4	1.9	39.8	42.6	17.8	2.6	5.9			
				60	34.6	1.88	41.0	44.6	18.4	0.5	1.2	38.1	1.86	44.4	48.7	20.4	1.3	3.1	37.1	1.9	43.4	51.8	19.9	2.5	5.8			
		9.0	5.1	70	39.5	1.90	46.0	52.4	20.8	0.5	1.1	42.3	1.88	48.7	57.5	22.4	1.3	2.9	40.4	1.9	46.9	61.0	21.3	2.4	5.6			
				80	43.3	1.93	49.9	60.8	22.5	0.4	0.9	46.0	1.91	52.5	66.4	24.1	1.2	2.8	43.4	1.9	50.0	70.3	22.5	2.3	5.4			
				90	46.8	1.95	53.4	69.2	24.0	0.3	0.8	Operation not recommended																
				50	30.8	1.74	36.8	36.3	17.7	0.6	1.4	32.9	1.74	38.8	40.2	19.0	1.4	3.2	33.8	1.8	39.8	42.5	19.3	2.6	5.9			
	9.0	11.9	11.9	60	35.0	1.76	41.0	44.4	19.9	0.5	1.2	38.6	1.75	44.5	48.6	22.1	1.3	3.1	37.5	1.7	43.5	51.7	21.5	2.5	5.8			
				70	40.0	1.78	46.1	52.2	22.4	0.5	1.1	42.8	1.77	48.8	57.3	24.2	1.3	2.9	40.9	1.8	47.0	60.9	23.0	2.4	5.6			
				80	43.8	1.81	50.0	60.5	24.3	0.4	0.9	46.6	1.79	52.7	66.2	26.0	1.2	2.8	44.0	1.8	50.2	70.2	24.3	2.3	5.4			
		9.0	10.3	90	47.4	1.83	53.6	68.9	26.0	0.3	0.8	Operation not recommended																
				50	27.7	2.27	35.4	37.7	12.2	0.6	1.4	29.6	2.31	37.5	41.2	12.9	1.4	3.2	30.4	2.3	38.2	43.2	13.3	2.6	5.9			
				60	31.9	2.29	39.7	45.8	13.9	0.5	1.2	34.8	2.31	42.7	49.7	15.1	1.3	3.1	34.4	2.3	42.2	52.3	15.1	2.5	5.8			
		9.0	4.5	70	36.7	2.47	45.1	53.7	14.9	0.5	1.1	39.4	2.48	47.9	58.3	15.9	1.3	2.9	37.8	2.5	46.2	61.6	15.4	2.4	5.6			
				80	41.0	2.49	49.5	61.8	16.5	0.4	0.9	43.5	2.51	52.1	67.1	17.3	1.2	2.8	41.6	2.5	50.1	70.8	16.7	2.3	5.4			
				90	44.7	2.50	53.3	69.1	19.3	0.3	0.8	Operation not recommended																
				50	23.3	3.27	34.4	39.7	7.1	0.6	1.4	24.9	3.33	36.2	42.6	7.5	1.4	3.2	25.3	3.3	36.7	44.4	7.6	2.6	5.9			
	4.5	1.4	1.4	60	27.7	3.30	39.0	47.7	8.4	0.5	1.2	29.4	3.33	40.8	51.3	8.8	1.3	3.1	30.2	3.3	41.6	53.3	9.1	2.5	5.8			
				70	32.1	3.33	43.5	55.7	9.6	0.5	1.1	33.9	3.34	45.3	60.0	10.2	1.3	2.9	34.9	3.3	46.3	62.3	10.4	2.4	5.6			
				80	36.4	3.34	47.8	63.8	10.9	0.4	0.9	38.4	3.36	49.8	68.6	11.4	1.2	2.8	39.4	3.4	50.9	71.3	11.7	2.3	5.4			
		6.75	2.0	70	23.5	3.10	34.1	39.5	7.6	0.6	1.4	25.2	3.16	36.0	42.5	8.0	1.4	3.2	25.7	3.2	36.4	44.3	8.1	2.6	5.9			
				80	28.1	3.14	38.8	47.5	9.0	0.5	1.2	29.8	3.16	40.6	51.2													

Performance Data — HEW036 - Heating

SOURCE			LOAD																											
			EWT °F		Flow		Flow 4.5 GPM						Flow 6.8 GPM						Flow 9.0 GPM											
					GPM	WPD	HC Mbtuh		Power KW		HE Mbtuh		LWT °F		COP		WPD		HC Mbtuh		Power KW		HE Mbtuh		LWT °F		COP		WPD	
20	9.0	7.7	17.9	60	26.1	1.53	20.9	71.6	5.0	0.5	1.2	26.4	1.45	21.5	67.8	5.3	1.3	3.1	26.5	1.41	21.7	65.9	5.5	2.5	5.8					
				80	25.7	1.96	19.0	91.4	3.8	0.4	0.9	25.9	1.86	19.6	87.7	4.1	1.2	2.8	25.9	1.81	19.8	85.8	4.2	2.3	5.4					
				100	25.0	2.56	16.3	111.1	2.9	0.3	0.7	25.0	2.42	16.7	107.4	3.0	1.1	2.5	24.9	2.36	16.9	105.5	3.1	2.1	4.9					
30	4.5	1.7	4.0	60	27.1	1.54	21.9	72.1	5.2	0.5	1.2	27.5	1.45	22.5	68.1	5.5	1.3	3.1	27.6	1.42	22.7	66.1	5.7	2.5	5.8					
				80	26.7	1.97	20.0	91.9	4.0	0.4	0.9	27.0	1.86	20.6	88.0	4.2	1.2	2.8	27.0	1.81	20.8	86.0	4.4	2.3	5.4					
				100	26.1	2.56	17.3	111.6	3.0	0.3	0.7	26.1	2.43	17.8	107.7	3.2	1.1	2.5	26.0	2.36	18.0	105.8	3.2	2.1	4.9					
				120	25.1	3.32	13.8	131.2	2.2	0.2	0.5	24.9	3.14	14.2	127.4	2.3	0.9	2.1	24.7	3.06	14.3	125.5	2.4	1.8	4.3					
	6.8	4.1	9.4	60	28.4	1.54	23.2	72.6	5.4	0.5	1.2	28.8	1.46	23.8	68.5	5.8	1.3	3.1	28.9	1.42	24.1	66.4	6.0	2.5	5.8					
				80	27.9	1.97	21.2	92.4	4.2	0.4	0.9	28.2	1.87	21.8	88.4	4.4	1.2	2.8	28.2	1.82	22.0	86.3	4.6	2.3	5.4					
				100	27.1	2.57	18.3	112.0	3.1	0.3	0.7	27.2	2.43	18.9	108.0	3.3	1.1	2.5	27.1	2.37	19.0	106.0	3.4	2.1	4.9					
				120	25.9	3.33	14.6	131.5	2.3	0.2	0.5	25.7	3.15	15.0	127.6	2.4	0.9	2.1	25.6	3.07	15.1	125.7	2.4	1.8	4.3					
	9.0	7.1	16.4	60	29.2	1.54	23.9	73.0	5.5	0.5	1.2	29.6	1.46	24.6	68.8	5.9	1.3	3.1	29.7	1.42	24.8	66.6	6.1	2.5	5.8					
				80	28.6	1.98	21.9	92.7	4.2	0.4	0.9	28.9	1.87	22.5	88.6	4.5	1.2	2.8	28.9	1.82	22.7	86.4	4.7	2.3	5.4					
				100	27.7	2.58	18.9	112.3	3.2	0.3	0.7	27.8	2.44	19.5	108.2	3.3	1.1	2.5	27.7	2.37	19.6	106.2	3.4	2.1	4.9					
				120	26.4	3.34	15.0	131.7	2.3	0.2	0.5	26.2	3.16	15.4	127.8	2.4	0.9	2.1	26.1	3.08	15.6	125.8	2.5	1.8	4.3					
40	4.5	1.5	3.5	60	30.7	1.41	25.9	71.5	6.4	0.5	1.2	31.2	1.33	26.7	67.9	6.9	1.3	3.1	31.3	1.30	26.9	66.0	7.1	2.5	5.8					
				80	30.6	1.81	24.4	90.8	4.9	0.4	0.9	31.0	1.72	25.1	87.4	5.3	1.2	2.8	31.1	1.67	25.3	85.6	5.4	2.3	5.4					
				100	29.9	2.39	21.7	109.7	3.7	0.3	0.7	30.1	2.27	22.4	106.6	3.9	1.1	2.5	30.1	2.21	22.6	105.0	4.0	2.1	4.9					
				120	28.8	3.17	18.0	128.0	2.7	0.2	0.5	28.7	3.00	18.5	125.5	2.8	0.9	2.1	28.6	2.92	18.6	124.1	2.9	1.8	4.3					
	6.8	3.7	8.6	60	32.6	1.48	27.5	72.2	6.4	0.5	1.2	33.1	1.40	28.3	68.4	6.9	1.3	3.1	33.3	1.37	28.6	66.4	7.1	2.5	5.8					
				80	32.1	1.90	25.6	91.4	4.9	0.4	0.9	32.5	1.80	26.3	87.8	5.3	1.2	2.8	32.6	1.75	26.6	85.9	5.4	2.3	5.4					
				100	31.1	2.49	22.6	110.0	3.7	0.3	0.7	31.3	2.36	23.3	106.9	3.9	1.1	2.5	31.3	2.30	23.5	105.2	4.0	2.1	4.9					
				120	29.7	3.26	18.6	128.3	2.7	0.2	0.5	29.7	3.09	19.1	125.7	2.8	0.9	2.1	29.6	3.01	19.3	124.3	2.9	1.8	4.3					
	9.0	6.5	15.1	60	34.5	1.55	29.2	73.0	6.5	0.5	1.2	35.0	1.47	30.0	68.9	7.0	1.3	3.1	35.2	1.43	30.3	66.7	7.2	2.5	5.8					
				80	33.6	1.99	26.8	91.9	4.9	0.4	0.9	34.0	1.89	27.6	88.2	5.3	1.2	2.8	34.1	1.84	27.8	86.2	5.4	2.3	5.4					
				100	32.3	2.59	23.5	110.4	3.7	0.3	0.7	32.5	2.45	24.2	107.2	3.9	1.1	2.5	32.5	2.39	24.4	105.4	4.0	2.1	4.9					
				120	30.7	3.36	19.2	128.5	2.7	0.2	0.5	30.6	3.18	19.8	125.9	2.8	0.9	2.1	30.5	3.09	20.0	124.4	2.9	1.8	4.3					
50	4.5	1.3	3.1	60	35.9	1.55	30.6	76.0	6.8	0.5	1.2	36.5	1.47	31.5	70.8	7.3	1.3	3.1	36.7	1.43	31.8	68.2	7.5	2.5	5.8					
				80	35.0	2.00	28.2	95.6	5.1	0.4	0.9	35.5	1.89	29.0	90.5	5.5	1.2	2.8	35.6	1.84	29.3	87.9	5.7	2.3	5.4					
				100	33.8	2.60	24.9	115.0	3.8	0.3	0.7	34.0	2.46	25.6	110.1	4.1	1.1	2.5	34.0	2.39	25.9	107.6	4.2	2.1	4.9					
				120	32.2	3.36	20.7	134.3	2.8	0.2	0.5	32.1	3.18	21.3	129.5	3.0	0.9	2.1	32.1	3.09	21.5	127.1	3.0	1.8	4.3					
	6.75	3.4	7.8	130	Operation not recommended												31.1	3.59	18.8	139.2	2.5	0.8	1.9	30.9	3.50	19.0	136.9	2.6	1.7	3.9
				60	37.7	1.56	32.4	76.8	7.1	0.5	1.2	38.4	1.48	33.3	71.4	7.6	1.3	3.1	38.5	1.44	33.6	68.6	7.9	2.5	5.8					
				80	36.6	2.00	29.8	96.3	5.4	0.4	0.9	37.1	1.89	30.7	91.0	5.7	1.2	2.8	37.3	1.84	31.0	88.3	5.9	2.3	5.4					
				100	35.2	2.60	26.3	115.6	4.0	0.3	0.7	35.5	2.46	27.1	110.5	4.2	1.1	2.5	35.5	2.40	27.3	107.9	4.3	2.1	4.9					
	9.0	6.0	13.9	120	33.4	3.37	21.9	134.8	2.9	0.2	0.5	33.4	3.19	22.5	129.9	3.1	0.9	2.1	33.3	3.10	22.7	127.4	3.1	1.8	4.3					
				130	38.6	1.56	33.3	77.2	7.2	0.5	1.2	39.3	1.48	34.3	71.7	7.8	1.3	3.1	39.5	1.44	34.6	68.8	8.0	2.5	5.8					
				80	37.5	2.01	30.7	96.7	5.5	0.4	0.9	38.0	1.90	31.6	91.3	5.9	1.2	2.8	38.2	1.85	31.9	88.5	6.1	2.3	5.4					
				100	36.0	2.61	27.1	116.0	4.0	0.3	0.7	36.3	2.47	27.9	110.8	4.3	1.1	2.5	36.3	2.40	28.1	108.1	4.4	2.1	4.9					
				120	34.0	3.37	22.5	135.1	3.0	0.2	0.5	34.1	3.19	23.2	130.1	3.1	0.9	2.1	34.0	3.11	23.4	127.6	3.2	1.8	4.3					
				130	32.8	3.61	20.5	139.7	2.7	0.8	1.9	32.8	3.61	20.5	139.7	2.7	0.8	1.9	32.6	3.52	20.6	137.3	2.7	1.7	3.9					

Table Continued on Next Page

Interpolation is permissible, extrapolation is not
All performance data is based upon the lower voltage of dual voltage rated units
Operation below 40°F EWT is based upon 15% methanol antifreeze solution
See performance data notes for operation in the shaded areas. Calculation to determine percentage of antifreeze required on source side.
Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated

WPD Adder For Required Strainer			
CV	GPM	PSI	FT HD
<tbl_info

Performance Data — HEW036 - Heating

Table Continued from Previous Page

SOURCE			LOAD																						
EWT °F	Flow		EWT °F	Flow 4.5 GPM							Flow 6.8 GPM							Flow 9.0 GPM							
	GPM	WPD		HC Mbtuh	Power KW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power KW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power KW	HE Mbtuh	LWT °F	COP	WPD		
		PSI	FT						PSI	FT						PSI	FT						PSI	FT	
60	4.5	1.2	2.7	60	39.0	1.57	33.6	77.3	7.3	0.5	1.2	39.7	1.48	34.6	71.8	7.8	1.3	3.1	39.9	1.44	34.9	68.9	8.1	2.5	5.8
				80	38.6	2.01	31.8	97.2	5.6	0.4	0.9	39.2	1.90	32.7	91.6	6.0	1.2	2.8	39.3	1.85	33.0	88.7	6.2	2.3	5.4
		1.2	2.7	100	37.6	2.61	28.7	116.7	4.2	0.3	0.7	38.0	2.47	29.6	111.3	4.5	1.1	2.5	38.0	2.40	29.8	108.5	4.6	2.1	4.9
				120	36.0	3.37	24.5	136.0	3.1	0.2	0.5	36.1	3.19	25.2	130.7	3.3	0.9	2.1	36.0	3.11	25.4	128.0	3.4	1.8	4.3
				130	Operation not recommended							34.8	3.61	22.5	140.3	2.8	0.8	1.9	34.7	3.51	22.7	137.7	2.9	1.7	3.9
	6.75	3.1	7.1	60	40.6	1.57	35.3	78.1	7.6	0.5	1.2	41.4	1.49	36.3	72.3	8.2	1.3	3.1	41.6	1.45	36.6	69.2	8.4	2.5	5.8
				80	40.2	2.01	33.4	97.9	5.9	0.4	0.9	40.8	1.90	34.3	92.1	6.3	1.2	2.8	41.0	1.85	34.6	89.1	6.5	2.3	5.4
		3.1	7.1	100	39.1	2.61	30.2	117.4	4.4	0.3	0.7	39.5	2.47	31.0	111.7	4.7	1.1	2.5	39.5	2.41	31.3	108.8	4.8	2.1	4.9
				120	37.2	3.38	25.7	136.5	3.2	0.2	0.5	37.3	3.20	26.4	131.1	3.4	0.9	2.1	37.3	3.11	26.6	128.3	3.5	1.8	4.3
				130	Operation not recommended							35.9	3.62	23.6	140.6	2.9	0.8	1.9	35.8	3.52	23.8	138.0	3.0	1.7	3.9
	9.0	5.6	12.8	60	41.5	1.57	36.1	78.4	7.7	0.5	1.2	42.2	1.49	37.2	72.5	8.3	1.3	3.1	42.4	1.45	37.5	69.4	8.6	2.5	5.8
				80	41.0	2.01	34.1	98.2	6.0	0.4	0.9	41.6	1.91	35.1	92.3	6.4	1.2	2.8	41.8	1.86	35.5	89.3	6.6	2.3	5.4
		5.6	12.8	100	39.8	2.62	30.9	117.7	4.5	0.3	0.7	40.2	2.48	31.8	111.9	4.8	1.1	2.5	40.3	2.41	32.0	109.0	4.9	2.1	4.9
				120	37.8	3.38	26.3	136.8	3.3	0.2	0.5	38.0	3.20	27.0	131.2	3.5	0.9	2.1	37.9	3.12	27.3	128.4	3.6	1.8	4.3
				130	Operation not recommended							36.5	3.62	24.1	140.8	3.0	0.8	1.9	36.4	3.53	24.4	138.1	3.0	1.7	3.9
70	4.5	1.0	2.3	60	42.1	1.58	36.7	78.7	7.8	0.5	1.2	42.9	1.49	37.8	72.7	8.4	1.3	3.1	43.1	1.46	38.1	69.6	8.7	2.5	5.8
				80	42.4	2.02	35.5	98.8	6.2	0.4	0.9	43.0	1.91	36.5	92.7	6.6	1.2	2.8	43.2	1.86	36.8	89.6	6.8	2.3	5.4
		1.0	2.3	100	41.6	2.62	32.7	118.5	4.7	0.3	0.7	42.1	2.48	33.6	112.5	5.0	1.1	2.5	42.2	2.41	33.9	109.4	5.1	2.1	4.9
				120	39.8	3.38	28.3	137.7	3.5	0.2	0.5	40.0	3.20	29.1	131.9	3.7	0.9	2.1	40.0	3.12	29.4	128.9	3.8	1.8	4.3
				130	Operation not recommended							38.6	3.62	26.3	141.4	3.1	0.8	1.9	38.5	3.53	26.5	138.6	3.2	1.7	3.9
	6.75	2.8	6.5	60	43.6	1.58	38.2	79.4	8.1	0.5	1.2	44.4	1.50	39.3	73.2	8.7	1.3	3.1	44.7	1.46	39.7	69.9	9.0	2.5	5.8
				80	43.8	2.02	36.9	99.5	6.4	0.4	0.9	44.5	1.91	38.0	93.2	6.8	1.2	2.8	44.7	1.86	38.4	89.9	7.0	2.3	5.4
		2.8	6.5	100	43.0	2.62	34.0	119.1	4.8	0.3	0.7	43.5	2.49	35.0	112.9	5.1	1.1	2.5	43.6	2.42	35.3	109.7	5.3	2.1	4.9
				120	41.0	3.39	29.5	138.2	3.5	0.2	0.5	41.3	3.21	30.3	132.2	3.8	0.9	2.1	41.3	3.13	30.6	129.2	3.9	1.8	4.3
				130	Operation not recommended							39.7	3.63	27.3	141.8	3.2	0.8	1.9	39.7	3.54	27.6	138.8	3.3	1.7	3.9
	9.0	5.1	11.9	60	44.3	1.59	38.9	79.7	8.2	0.5	1.2	45.1	1.50	40.0	73.4	8.8	1.3	3.1	45.4	1.46	40.4	70.1	9.1	2.5	5.8
				80	44.5	2.02	37.6	99.8	6.4	0.4	0.9	45.2	1.92	38.7	93.4	6.9	1.2	2.8	45.4	1.87	39.1	90.1	7.1	2.3	5.4
		5.1	11.9	100	43.6	2.63	34.6	119.4	4.9	0.3	0.7	44.1	2.49	35.6	113.1	5.2	1.1	2.5	44.2	2.42	36.0	109.8	5.4	2.1	4.9
				120	41.6	3.40	30.0	138.5	3.6	0.2	0.5	41.8	3.22	30.9	132.4	3.8	0.9	2.1	41.8	3.13	31.1	129.3	3.9	1.8	4.3
				130	Operation not recommended							40.2	3.64	27.8	141.9	3.2	0.8	1.9	40.2	3.54	28.1	138.9	3.3	1.7	3.9
80	4.5	0.9	2.0	60	45.3	1.59	39.8	80.1	8.3	0.5	1.2	46.1	1.51	41.0	73.7	9.0	1.3	3.1	46.4	1.47	41.4	70.3	9.3	2.5	5.8
				80	46.2	2.03	39.2	100.5	6.7	0.4	0.9	46.9	1.92	40.4	93.9	7.2	1.2	2.8	47.1	1.87	40.8	90.5	7.4	2.3	5.4
		0.9	2.0	100	45.7	2.63	36.7	120.3	5.1	0.3	0.7	46.3	2.49	37.8	113.7	5.4	1.1	2.5	46.4	2.42	38.1	110.3	5.6	2.1	4.9
				120	43.8	3.40	32.2	139.5	3.8	0.2	0.5	44.1	3.22	33.2	133.1	4.0	0.9	2.1	44.2	3.13	33.5	129.8	4.1	1.8	4.3
				130	Operation not recommended							27.9	3.61	15.6	138.3	2.3	0.8	1.9	27.7	3.51	15.7	136.2	2.3	1.7	3.9
	6.75	2.6	5.9	60	46.6	1.59	41.2	80.7	8.6	0.5	1.2	47.5	1.51	42.4	74.1	9.2	1.3	3.1	47.8	1.47	42.8	70.6	9.5	2.5	5.8
				80	47.5	2.03	40.6	101.1	6.9	0.4	0.9	48.3	1.92	41.7	94.3	7.4	1.2	2.8	48.5	1.87	42.1	90.8	7.6	2.3	5.4
		2.6	5.9	100	46.9	2.64	37.9	120.9	5.2	0.3	0.7	47.5	2.50	39.0	114.1	5.6	1.1	2.5	47.7	2.43	39.4	110.6	5.8	2.1	4.9
				120	44.9	3.40	33.3	140.0	3.9	0.2	0.5	45.3	3.22	34.3	133.4	4.1	0.9	2.1	45.3	3.14	34.6	130.1	4.2	1.8	4.3
				130	Operation not recommended							28.5	3.62	16.1	138.4	2.3	0.8	1.9	28.3	3.52	16.3	136.3	2.4	1.7	3.9
	9.0	4.8	11.0	60	47.1	1.60																			

Performance Data — HEW060 - Cooling

SOURCE			LOAD																						
EWT °F	Flow		EWT °F	Flow 7.5 GPM								Flow 11.25 GPM								Flow 15.0 GPM					
	GPM	WPD		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD		
		PSI	FT						PSI	FT						PSI	FT						PSI	FT	
50	7.5	1.3	2.9	50	52.6	2.20	60.1	38.2	23.9	1.4	3.3	53.5	2.23	61.1	41.0	24.0	3.5	8.0	55.3	2.25	63.0	42.5	24.6	4.8	11.0
				60	53.2	2.22	60.8	47.1	23.9	1.4	3.2	54.1	2.25	61.7	50.5	24.1	3.3	7.7	55.9	2.27	63.7	52.4	24.7	4.6	10.6
				70	53.8	2.24	61.4	56.0	24.0	1.3	3.0	54.7	2.26	62.4	60.0	24.1	3.2	7.4	56.6	2.29	64.4	62.2	24.7	4.4	10.1
				80	55.5	2.24	63.2	64.7	24.7	1.2	2.9	56.4	2.27	64.1	69.4	24.9	3.1	7.1	58.4	2.29	66.2	72.0	25.5	4.3	9.8
				90	57.2	2.25	64.9	73.5	25.5	1.2	2.7	58.1	2.27	65.9	78.9	25.6	3.0	6.9	60.2	2.29	68.0	81.8	26.3	4.1	9.5
	11.25	3.4	7.9	50	53.4	2.23	61.0	38.0	24.0	1.4	3.3	54.1	2.25	61.8	40.8	24.1	3.5	8.0	56.0	2.27	63.8	42.3	24.7	4.8	11.0
				60	55.5	2.25	63.1	46.7	24.7	1.4	3.2	56.2	2.27	64.0	50.1	24.8	3.3	7.7	58.2	2.29	66.0	52.0	25.4	4.6	10.6
				70	57.5	2.26	65.3	55.4	25.4	1.3	3.0	58.3	2.29	66.1	59.4	25.5	3.2	7.4	60.4	2.31	68.3	61.6	26.1	4.4	10.2
				80	58.1	2.27	65.8	64.3	25.6	1.2	2.9	58.9	2.29	66.7	69.0	25.7	3.1	7.1	60.9	2.31	68.8	71.5	26.4	4.3	9.8
				90	58.6	2.27	66.3	73.2	25.8	1.2	2.7	59.4	2.29	67.2	78.5	25.9	3.0	6.9	61.5	2.31	69.4	81.4	26.6	4.1	9.5
	15.0	6.2	14.2	50	55.6	2.25	63.2	35.8	24.7	1.4	3.3	56.5	2.27	64.2	40.3	24.9	3.5	8.0	57.9	2.29	65.8	42.1	25.2	4.8	11.1
				60	57.5	2.27	65.2	45.0	25.3	1.4	3.2	58.7	2.29	66.6	49.8	25.6	3.3	7.7	61.5	2.31	69.4	51.5	26.6	4.6	10.6
				70	59.4	2.29	67.2	54.1	26.0	1.3	3.0	61.0	2.31	68.9	59.3	26.4	3.2	7.4	65.1	2.33	73.1	60.9	27.9	4.4	10.1
				80	60.3	2.29	68.1	63.5	26.4	1.2	2.9	61.8	2.31	69.7	68.7	26.7	3.1	7.1	65.8	2.34	73.8	70.8	28.2	4.2	9.8
				90	61.3	2.29	69.1	72.8	26.7	1.2	2.7	62.6	2.31	70.5	78.1	27.0	3.0	6.9	66.6	2.34	74.6	80.7	28.5	4.1	9.4
70	7.5	1.1	2.5	50	49.1	2.82	58.7	38.1	17.4	1.4	3.3	50.3	2.85	60.0	41.1	17.7	3.5	8.0	52.0	2.88	61.8	42.9	18.1	4.7	11.0
				60	53.2	2.84	62.9	46.4	18.7	1.4	3.2	54.5	2.87	64.3	50.0	19.0	3.3	7.7	56.3	2.90	66.2	52.3	19.4	4.6	10.5
				70	57.2	2.86	67.0	54.8	20.0	1.3	3.0	58.7	2.89	68.5	59.1	20.3	3.2	7.4	60.6	2.92	70.6	61.7	20.8	4.4	10.1
				80	59.3	2.92	69.3	63.4	20.3	1.2	2.9	60.8	2.95	70.9	68.3	20.6	3.1	7.1	62.9	2.98	73.0	71.4	21.1	4.3	9.8
				90	61.4	2.98	71.6	71.9	20.6	1.2	2.7	63.0	3.01	73.3	77.6	20.9	3.0	6.9	65.1	3.04	75.5	81.1	21.4	4.1	9.5
	11.25	3.0	6.9	50	50.2	2.85	59.9	38.0	17.6	1.4	3.3	51.4	2.88	61.2	41.0	17.8	3.5	8.0	53.1	2.91	63.0	42.8	18.3	4.8	11.0
				60	54.5	2.87	64.3	46.2	19.0	1.4	3.2	55.9	2.90	65.8	49.8	19.3	3.3	7.7	57.7	2.93	67.7	52.1	19.7	4.6	10.6
				70	58.9	2.89	68.8	54.5	20.4	1.3	3.0	60.4	2.92	70.3	58.8	20.7	3.2	7.4	62.4	2.94	72.4	61.4	21.2	4.4	10.2
				80	60.8	2.95	70.8	63.1	20.6	1.2	2.9	62.3	2.98	72.4	68.1	20.9	3.1	7.1	64.4	3.01	74.6	71.1	21.4	4.3	9.9
				90	62.6	3.01	72.9	71.7	20.8	1.2	2.7	64.2	3.04	74.5	77.3	21.1	3.0	6.9	66.3	3.07	76.8	80.8	21.6	4.1	9.6
	15.0	5.5	12.8	50	51.2	2.88	61.0	36.9	17.8	1.4	3.3	53.3	2.91	63.2	40.8	18.3	3.5	8.0	54.3	2.94	64.3	42.6	18.5	4.8	11.0
				60	55.6	2.90	65.5	45.4	19.2	1.4	3.2	57.6	2.93	67.6	49.6	19.7	3.3	7.7	59.4	2.96	69.5	51.8	20.1	4.6	10.6
				70	60.1	2.92	70.1	53.9	20.6	1.3	3.0	61.9	2.94	72.0	58.5	21.0	3.2	7.4	64.5	2.97	74.6	61.1	21.7	4.4	10.1
				80	62.3	2.98	72.5	62.7	20.9	1.2	2.9	64.1	3.01	74.4	67.8	21.3	3.1	7.1	67.1	3.04	77.5	70.6	22.1	4.2	9.8
				90	64.6	3.04	74.9	71.5	21.3	1.2	2.7	66.3	3.07	76.8	77.1	21.6	3.0	6.9	69.8	3.10	80.3	80.2	22.5	4.1	9.5
80	7.5	1.0	2.3	50	47.3	3.13	58.0	38.0	15.1	1.4	3.3	48.7	3.16	59.5	41.1	15.4	3.5	8.0	50.3	3.19	61.2	43.1	15.8	4.7	10.9
				60	53.1	3.15	63.9	46.1	16.9	1.4	3.2	54.7	3.18	65.6	49.8	17.2	3.3	7.7	56.5	3.21	67.5	52.3	17.6	4.6	10.5
				70	58.9	3.17	69.7	54.2	18.6	1.3	3.0	60.7	3.20	71.6	58.6	19.0	3.2	7.4	62.7	3.23	73.7	61.5	19.4	4.4	10.1
				80	61.3	3.25	72.4	62.7	18.8	1.2	2.9	63.1	3.29	74.3	67.8	19.2	3.1	7.1	65.1	3.32	76.5	71.1	19.6	4.3	9.8
				90	63.6	3.34	75.0	71.1	19.0	1.2	2.7	65.4	3.38	77.0	76.9	19.4	3.0	6.9	67.6	3.41	79.2	80.7	19.8	4.1	9.6
	11.25	2.8	6.5	50	48.5	3.16	59.3	38.0	15.3	1.4	3.3	50.0	3.19	60.9	41.1	15.6	3.5	8.0	51.6	3.23	62.6	43.0	16.0	4.8	11.1
				60	54.1	3.18	64.9	46.0	17.0	1.4	3.2	55.7	3.21	66.6	49.7	17.3	3.3	7.7	57.5	3.24	68.6	52.2	17.7	4.6	10.6
				70	59.6	3.20	70.5	54.0	18.7	1.3	3.0	61.4	3.23	72.4	58.4	19.0	3.2	7.4	63.4	3.26	74.5	61.3	19.4	4.4	10.2
				80	62.1	3.29	73.4	62.5	18.9	1.2	2.9	64.0	3.32	75.3	67.6	19.3	3.1	7.1	66.1	3.35	77.5	70.9	19.7	4.3	9.9
				90	64.6	3.38	76.2	71.0	19.1	1.2	2.7	66.6	3.41	78.2	76.8	19.5	3.0	6.9	68.7	3.45	80.5	80.6	19.9	4.2	9.6
	15.0	5.3	12.1	50	49.0	3.19	59.9	37.4	15.3	1.4	3.3	51.7	3.23	62.7	41.0	16.0	3.5	8.0	52.4	3.26	63.5	42.9	1		

Performance Data — HEW060 - Cooling

Table Continued from Previous Page

SOURCE			LOAD																						
EWT °F	Flow		EWT °F	Flow 7.5 GPM						Flow 11.25 GPM						Flow 15.0 GPM									
	GPM	WPD		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD	TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD	TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD				
90	7.5	0.9	2.1	50	44.8	3.57	57.0	38.7	12.5	1.4	3.3	46.3	3.61	58.6	41.6	12.8	3.5	8.0	47.5	3.65	59.9	43.4	13.0	4.7	10.9
				60	50.7	3.61	63.0	46.8	14.0	1.4	3.2	52.3	3.65	64.8	50.3	14.3	3.3	7.7	53.7	3.68	66.3	52.6	14.6	4.5	10.5
				70	56.6	3.65	69.0	54.9	15.5	1.3	3.0	58.4	3.69	70.9	59.1	15.8	3.2	7.4	59.9	3.72	72.6	61.8	16.1	4.4	10.1
				80	59.6	3.73	72.4	63.4	16.0	1.2	2.9	61.5	3.77	74.4	68.2	16.3	3.1	7.1	63.1	3.81	76.1	71.3	16.6	4.3	9.8
				90	62.7	3.82	75.7	71.9	16.4	1.2	2.7	64.7	3.86	77.9	77.3	16.8	3.0	6.9	66.4	3.90	79.7	80.9	17.0	4.1	9.6
	11.25	2.7	6.1	50	45.9	3.61	58.2	38.6	12.7	1.4	3.3	47.4	3.65	59.8	41.5	13.0	3.5	8.0	48.6	3.68	61.2	43.4	13.2	4.8	11.0
				60	51.8	3.65	64.3	46.7	14.2	1.4	3.2	53.5	3.68	66.0	50.2	14.5	3.3	7.7	54.9	3.72	67.6	52.5	14.7	4.6	10.6
				70	57.7	3.69	70.3	54.8	15.7	1.3	3.0	59.6	3.72	72.3	58.9	16.0	3.2	7.4	61.1	3.76	73.9	61.6	16.2	4.4	10.2
				80	60.7	3.77	73.6	63.2	16.1	1.2	2.9	62.6	3.81	75.7	68.0	16.4	3.1	7.1	64.3	3.85	77.4	71.1	16.7	4.3	9.9
				90	63.7	3.86	76.9	71.7	16.5	1.2	2.7	65.7	3.90	79.0	77.1	16.9	3.0	6.9	67.4	3.94	80.9	80.6	17.1	4.1	9.6
	15.0	5.0	11.6	50	46.5	3.65	59.0	38.1	12.8	1.4	3.3	48.6	3.68	61.1	41.4	13.2	3.5	8.0	49.5	3.72	62.2	43.3	13.3	4.7	10.9
				60	52.4	3.68	64.9	46.2	14.2	1.4	3.2	54.2	3.72	66.9	50.1	14.6	3.3	7.7	55.8	3.76	68.6	52.4	14.8	4.6	10.5
				70	58.2	3.72	70.9	54.3	15.6	1.3	3.0	59.8	3.76	72.7	58.7	15.9	3.2	7.4	62.0	3.80	75.0	61.5	16.3	4.4	10.1
				80	61.6	3.81	74.6	62.9	16.2	1.2	2.9	63.4	3.85	76.6	67.8	16.5	3.1	7.1	65.8	3.89	79.0	70.8	16.9	4.3	9.8
				90	65.1	3.90	78.4	71.6	16.7	1.2	2.7	67.0	3.94	80.5	77.0	17.0	3.0	6.9	69.5	3.98	83.1	80.2	17.5	4.1	9.5
110	7.5	0.8	1.8	50	39.8	4.46	55.0	39.9	8.9	1.4	3.3	41.3	4.50	56.7	42.5	9.2	3.5	8.0	41.7	4.55	57.3	44.1	9.2	4.7	10.9
				60	45.8	4.54	61.3	48.2	10.1	1.4	3.2	47.5	4.58	63.1	51.2	10.4	3.3	7.7	48.0	4.63	63.8	53.2	10.4	4.5	10.4
				70	51.8	4.62	67.5	56.4	11.2	1.3	3.0	53.7	4.66	69.6	60.0	11.5	3.2	7.4	54.3	4.71	70.4	62.4	11.5	4.3	10.0
				80	56.4	4.69	72.4	64.9	12.0	1.2	2.9	58.5	4.74	74.7	69.0	12.3	3.1	7.1	59.1	4.79	75.5	71.7	12.3	4.2	9.8
				90	61.0	4.77	77.3	73.4	12.8	1.2	2.7	63.3	4.82	79.7	78.0	13.1	3.0	6.9	64.0	4.87	80.6	81.1	13.1	4.2	9.6
	11.25	2.4	5.6	50	40.6	4.50	56.0	39.9	9.0	1.4	3.3	42.2	4.55	57.7	42.4	9.3	3.5	8.0	42.6	4.60	58.3	44.1	9.3	4.8	11.0
				60	47.3	4.58	62.9	48.1	10.3	1.4	3.2	49.0	4.63	64.8	51.2	10.6	3.3	7.7	49.6	4.68	65.5	53.2	10.6	4.6	10.5
				70	53.9	4.66	69.8	56.3	11.6	1.3	3.0	55.9	4.71	72.0	59.9	11.9	3.2	7.4	56.5	4.76	72.7	62.2	11.9	4.4	10.1
				80	57.9	4.74	74.0	64.7	12.2	1.2	2.9	60.0	4.79	76.4	68.8	12.5	3.1	7.1	60.7	4.84	77.2	71.5	12.5	4.2	9.8
				90	61.8	4.82	78.3	73.1	12.8	1.2	2.7	64.1	4.87	80.8	77.7	13.2	3.0	6.9	64.8	4.92	81.6	80.8	13.2	4.1	9.5
	15.0	4.6	10.7	50	41.5	4.55	57.1	39.4	9.1	1.4	3.3	42.3	4.60	58.0	42.4	9.2	3.5	8.0	43.8	4.64	59.7	44.0	9.4	4.7	10.8
				60	47.6	4.63	63.4	47.4	10.3	1.4	3.2	48.5	4.68	64.5	51.1	10.4	3.3	7.7	50.7	4.72	66.8	53.1	10.7	4.5	10.5
				70	53.7	4.71	69.8	55.3	11.4	1.3	3.0	54.7	4.76	70.9	59.9	11.5	3.2	7.4	57.6	4.80	74.0	62.2	12.0	4.4	10.2
				80	58.3	4.79	74.6	64.2	12.2	1.2	2.9	59.7	4.84	76.2	68.7	12.3	3.1	7.1	61.7	4.89	78.4	71.4	12.6	4.3	9.8
				90	62.8	4.87	79.4	73.0	12.9	1.2	2.7	64.8	4.92	81.6	77.6	13.2	3.0	6.9	65.8	4.97	82.8	80.7	13.2	4.1	9.5
120	7.5	0.7	1.7	50	37.0	5.04	54.2	40.3	7.3	1.4	3.3	38.5	5.09	55.9	43.2	7.6	3.5	8.0	39.3	5.14	56.8	44.7	7.6	4.7	10.9
				60	42.7	5.13	60.2	48.6	8.3	1.4	3.2	44.4	5.18	62.1	52.0	8.6	3.3	7.7	45.3	5.23	63.2	53.8	8.7	4.5	10.5
				70	48.4	5.21	66.2	56.9	9.3	1.3	3.0	50.4	5.27	68.3	60.8	9.6	3.2	7.4	51.4	5.32	69.5	62.9	9.7	4.3	10.0
				80	53.0	5.31	71.1	65.2	10.0	1.2	2.9	55.1	5.36	73.4	69.7	10.3	3.1	7.1	56.2	5.42	74.7	72.1	10.4	4.2	9.7
				90	57.5	5.40	76.0	73.5	10.6	1.2	2.7	59.9	5.46	78.5	78.6	11.0	3.0	6.9	61.1	5.51	79.9	81.3	11.1	4.1	9.4
	11.25	2.4	5.5	50	37.2	5.09	54.6	40.3	7.3	1.4	3.3	38.8	5.14	56.3	43.1	7.5	3.5	8.0	39.6	5.19	57.3	44.6	7.6	4.8	11.1
				60	43.2	5.18	60.8	48.5	8.3	1.4	3.2	44.9	5.23	62.8	51.9	8.6	3.3	7.7	45.8	5.28	63.8	53.7	8.7	4.6	10.6
				70	49.1	5.27	67.0	56.7	9.3	1.3	3.0	51.1	5.32	69.2	60.6	9.6	3.2	7.4	52.1	5.37	70.4	62.7	9.7	4.4	10.1
				80	53.6	5.36	71.9	65.0	10.0	1.2	2.9	55.8	5.42	74.3	69.6	10.3	3.1	7.1	57.0	5.47	75.6	72.0	10.4	4.2	9.8
				90	58.2	5.46	76.9	73.4	10.7	1.2	2.7	60.6	5.51	79.4	78.5	11.0	3.0	6.9	61.8	5.57	80.9	81.3	11.1	4.1	9.5
	15.0	4.5	10.3	50	38.5	5.14	56.0	40.0	7.5	1.4	3.3	40.1	5.19	57.8	42.9	7.7	3.5	8.0	40.8	5.25	58.7	44.5	7.8	4.7	11.0
				60	44.																				

Performance Data — HEW060 - Heating

SOURCE			LOAD																							
EWT °F	Flow			EWT °F	Flow 7.5 GPM						Flow 11.25 GPM						Flow 15.0 GPM									
	GPM	WPD			HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		
		PSI	FT							PSI	FT						PSI	FT						PSI	FT	
20	15.0	7.3	16.9	60	41.1	2.43	32.8	71.5	5.0	1.4	3.2	41.3	2.38	33.2	67.4	5.1	3.3	7.7	41.5	2.33	33.5	65.3	5.2	6.0	13.8	
				80	40.5	3.17	29.6	91.2	3.7	1.2	2.9	40.6	3.11	30.0	87.2	3.8	3.1	7.1	40.7	3.05	30.3	85.3	3.9	5.6	13.0	
				100	39.7	4.11	25.6	110.8	2.8	1.1	2.6	39.7	4.03	25.9	106.9	2.9	2.9	6.7	39.7	3.95	26.2	105.1	2.9	5.3	12.3	
	30	7.5	1.5	3.5	60	47.8	2.52	39.2	73.3	5.6	1.4	3.2	48.0	2.47	39.6	68.6	5.7	3.3	7.7	48.3	2.42	40.0	66.3	5.8	6.0	13.8
					80	46.9	3.28	35.7	92.9	4.2	1.2	2.9	47.1	3.21	36.1	88.4	4.3	3.1	7.1	47.2	3.15	36.5	86.1	4.4	5.6	13.0
		11.25	4.0	9.2	100	45.8	4.22	31.4	112.4	3.2	1.1	2.6	45.9	4.14	31.8	108.1	3.3	2.9	6.7	45.9	4.05	32.1	105.9	3.3	5.3	12.3
					120	44.6	5.36	26.3	131.9	2.4	1.1	2.4	44.5	5.25	26.6	127.7	2.5	2.8	6.4	44.4	5.14	26.9	125.7	2.5	5.1	11.7
	40	7.5	1.4	3.2	60	50.0	2.56	41.3	73.6	5.7	1.4	3.2	50.3	2.51	41.7	68.9	5.9	3.3	7.7	50.5	2.46	42.1	66.6	6.0	6.0	13.8
					80	49.0	3.33	37.6	93.3	4.3	1.2	2.9	49.1	3.26	38.0	88.7	4.4	3.1	7.1	49.3	3.20	38.4	86.5	4.5	5.6	13.0
					100	47.8	4.29	33.2	112.8	3.3	1.1	2.6	47.9	4.21	33.5	108.4	3.3	2.9	6.7	47.9	4.12	33.9	106.2	3.4	5.3	12.3
		11.25	3.7	8.5	120	46.6	5.45	28.0	132.1	2.5	1.1	2.4	46.5	5.34	28.3	128.0	2.6	2.8	6.4	46.4	5.23	28.6	125.9	2.6	5.1	11.7
					60	52.0	2.61	43.1	73.9	5.8	1.4	3.2	52.2	2.55	43.5	69.1	6.0	3.3	7.7	52.5	2.50	43.9	66.8	6.1	6.0	13.8
					80	50.9	3.39	39.3	93.4	4.4	1.2	2.9	51.1	3.32	39.7	88.9	4.5	3.1	7.1	51.2	3.25	40.1	86.6	4.6	5.6	13.0
	50	15.0	6.9	15.9	100	49.6	4.36	34.7	112.9	3.3	1.1	2.6	49.7	4.28	35.1	108.6	3.4	2.9	6.7	49.7	4.19	35.4	106.4	3.5	5.3	12.3
					120	48.1	5.54	29.2	132.3	2.5	1.1	2.4	48.0	5.43	29.5	128.2	2.6	2.8	6.4	47.9	5.32	29.8	126.1	2.6	5.1	11.7
					60	54.4	2.61	45.5	75.0	6.1	1.4	3.2	54.7	2.56	46.0	69.7	6.3	3.3	7.7	55.1	2.51	46.5	67.2	6.4	6.0	13.8
		11.25	3.7	8.5	80	53.4	3.38	41.8	94.6	4.6	1.2	2.9	53.6	3.31	42.3	89.6	4.7	3.1	7.1	53.8	3.25	42.7	87.0	4.9	5.6	13.0
					100	52.0	4.33	37.2	114.0	3.5	1.1	2.6	52.1	4.24	37.6	109.2	3.6	2.9	6.7	52.2	4.16	38.0	106.7	3.7	5.3	12.3
					120	50.4	5.46	31.8	133.4	2.7	1.1	2.4	50.3	5.35	32.1	128.7	2.8	2.8	6.4	50.3	5.24	32.4	126.4	2.8	5.1	11.7
	40	15.0	6.5	15.1	60	57.4	2.65	48.3	75.5	6.4	1.4	3.2	57.7	2.59	48.8	70.1	6.5	3.3	7.7	58.0	2.54	49.3	67.5	6.7	6.0	13.8
					80	55.9	3.42	44.2	95.1	4.8	1.2	2.9	56.1	3.36	44.7	90.0	4.9	3.1	7.1	56.4	3.29	45.1	87.4	5.0	5.6	13.0
					100	54.3	4.38	39.4	114.5	3.6	1.1	2.6	54.4	4.30	39.8	109.7	3.7	2.9	6.7	54.5	4.21	40.2	107.1	3.8	5.3	12.3
		11.25	3.7	8.5	120	52.6	5.53	33.7	133.8	2.8	1.1	2.4	52.6	5.42	34.1	129.1	2.8	2.8	6.4	52.5	5.31	34.4	126.8	2.9	5.1	11.7
					60	59.2	2.68	50.1	75.9	6.5	1.4	3.2	59.6	2.63	50.6	70.5	6.6	3.3	7.7	59.9	2.58	51.1	67.9	6.8	6.0	13.8
					80	57.8	3.47	46.0	95.3	4.9	1.2	2.9	58.0	3.40	46.4	90.3	5.0	3.1	7.1	58.3	3.33	46.9	87.6	5.1	5.6	13.0
	50	15.0	6.2	14.2	100	56.1	4.44	40.9	114.7	3.7	1.1	2.6	56.2	4.35	41.3	109.9	3.8	2.9	6.7	56.3	4.27	41.7	107.3	3.9	5.3	12.3
					120	54.0	5.60	34.9	134.0	2.8	1.1	2.4	54.0	5.49	35.2	129.3	2.9	2.8	6.4	54.0	5.38	35.6	127.0	2.9	5.1	11.7
					130	Operation not recommended						55.2	6.16	34.2	139.8	2.6	2.7	6.2	55.1	6.03	34.5	137.2	2.7	5.0	11.5	
	50	11.25	3.4	7.9	60	64.7	2.73	55.4	77.4	6.9	1.4	3.2	65.1	2.68	56.0	71.3	7.1	3.3	7.7	65.5	2.62	56.5	68.5	7.3	6.0	13.8
					80	62.8	3.52	50.8	96.9	5.2	1.2	2.9	63.1	3.45	51.4	91.3	5.4	3.1	7.1	63.4	3.38	51.9	88.3	5.5	5.6	13.0
					100	60.8	4.48	45.5	116.2	4.0	1.1	2.6	61.0	4.39	46.0	110.9	4.1	2.9	6.7	61.1	4.30	46.5	108.0	4.2	5.3	12.3
		15.0	6.2	14.2	120	58.6	5.61	39.4	135.4	3.1	1.1	2.4	58.6	5.50	39.8	130.2	3.1	2.8	6.4	58.6	5.39	40.2	127.7	3.2	5.1	11.7
					130	57.9	6.22	36.7	139.7	2.7	2.7	6.2	57.8	6.09	37.1	137.3	2.8	5.0	11.5	57.8	6.09	37.1	137.3	2.8	5.0	11.5
					60	66.5	2.76	57.1	78.0	7.1	1.4	3.2	66.9	2.70	57.7	71.9	7.3	3.3	7.7	67.3	2.65	58.3	69.0	7.4	6.0	13.8
	50	15.0	6.2	14.2	80	64.7	3.55	52.6	97.2	5.3	1.2	2.9	65.0	3.48	53.1	91.6	5.5	3.1	7.1	65.3	3.41	53.6	88.6	5.6	5.6	13.0
					100	62.5	4.52	47.1	116.4	4.1	1.1	2.6	62.7	4.43	47.6	111.1	4.1	2.9	6.7	62.9	4.34	48.0	108.2	4.2	5.3	12.3
					120	60.0	5.67	40.6	135.6	3.1	1.1	2.4	60.0	5.55	41.0	130.5	3.2	2.8	6.4	60.0	5.44	41.4	127.9	3.2	5.1	11.7
		15.0	6.2	14.2	130	58.8	6.28	37.3	140.3	2.7	2.7	6.2	58.7	6.15	37.7	137.7	2.8	5.0	11.5	58.7	6.15	37.7	137.7	2.8	5.0	11.5

Table Continued on Next Page

Interpolation is permissible, extrapolation is not.
 All performance data is based upon the lower voltage of dual voltage rated units.
 Operation below 40°F EWT is based upon 15% methanol antifreeze solution.
 See performance data notes for operation in the shaded areas. Calculation to determine percentage of antifreeze required on source side.
 Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated

Performance Data — HEW060 - Heating

Table Continued from Previous Page

SOURCE			LOAD																						
EWT °F	Flow		EWT °F	Flow 7.5 GPM						Flow 11.25 GPM						Flow 15.0 GPM									
	GPM	WPD		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD		
									PSI	FT						PSI	FT						PSI	FT	
60	7.5	1.2	2.7	60	64.9	2.76	55.5	78.5	6.9	1.4	3.2	65.2	2.70	56.0	71.7	7.1	3.3	7.7	65.6	2.65	56.6	68.6	7.3	6.0	13.8
				80	64.8	3.54	52.7	98.1	5.4	1.2	2.9	65.1	3.47	53.3	91.8	5.5	3.1	7.1	65.4	3.40	53.8	88.6	5.6	5.6	13.0
				100	63.7	4.49	48.3	117.6	4.2	1.1	2.6	63.9	4.40	48.8	111.5	4.3	2.9	6.7	64.1	4.31	49.4	108.4	4.4	5.3	12.3
				120	61.4	5.60	42.3	136.7	3.2	1.1	2.4	61.5	5.48	42.8	130.9	3.3	2.8	6.4	61.6	5.37	43.2	128.0	3.4	5.1	11.7
				130	Operation not recommended						60.2	6.21	39.1	140.8	2.8	2.7	6.2	60.0	6.02	39.5	137.9	2.9	5.0	11.5	
	11.25	3.2	7.3	60	67.7	2.78	58.2	79.0	7.1	1.4	3.2	68.1	2.73	58.8	72.2	7.3	3.3	7.7	68.5	2.67	59.4	69.1	7.5	6.0	13.8
				80	67.7	3.58	55.5	98.7	5.5	1.2	2.9	68.0	3.51	56.0	92.3	5.7	3.1	7.1	68.3	3.44	56.6	89.1	5.8	5.6	13.0
				100	66.4	4.54	50.9	118.1	4.3	1.1	2.6	66.6	4.45	51.5	112.0	4.4	2.9	6.7	66.9	4.36	52.0	108.9	4.5	5.3	12.3
				120	64.0	5.67	44.6	137.2	3.3	1.1	2.4	64.1	5.56	45.1	131.3	3.4	2.8	6.4	64.2	5.45	45.6	128.5	3.5	5.1	11.7
				130	Operation not recommended						63.1	6.27	41.7	141.0	3.0	2.7	6.2	62.9	6.08	42.2	138.1	3.0	5.0	11.5	
70	15.0	5.8	13.5	60	70.0	2.81	60.4	79.4	7.3	1.4	3.2	70.4	2.76	61.0	72.6	7.5	3.3	7.7	70.8	2.70	61.6	69.5	7.7	6.0	13.8
				80	70.0	3.62	57.7	99.0	5.7	1.2	2.9	70.4	3.54	58.3	92.6	5.8	3.1	7.1	70.7	3.47	58.9	89.4	6.0	5.6	13.0
				100	68.8	4.60	53.1	118.3	4.4	1.1	2.6	69.0	4.50	53.6	112.2	4.5	2.9	6.7	69.2	4.41	54.2	109.1	4.6	5.3	12.3
				120	66.2	5.75	46.6	137.4	3.4	1.1	2.4	66.3	5.63	47.1	131.6	3.4	2.8	6.4	66.4	5.52	47.5	128.7	3.5	5.1	11.7
				130	Operation not recommended						64.6	6.14	43.6	138.4	3.1	5.0	11.5								
	7.5	1.1	2.5	60	68.6	2.81	59.0	80.1	7.2	1.4	3.2	69.0	2.76	59.6	72.6	7.3	3.3	7.7	69.5	2.70	60.2	69.2	7.5	6.0	13.8
				80	69.8	3.61	57.5	100.0	5.7	1.2	2.9	70.2	3.53	58.1	92.8	5.8	3.1	7.1	70.5	3.46	58.7	89.4	6.0	5.6	13.0
				100	69.2	4.55	53.6	119.5	4.5	1.1	2.6	69.4	4.46	54.2	112.6	4.6	2.9	6.7	69.7	4.37	54.8	109.3	4.7	5.3	12.3
				120	66.7	5.64	47.4	138.5	3.5	1.1	2.4	66.8	5.52	47.9	132.0	3.5	2.8	6.4	66.9	5.41	48.5	128.9	3.6	5.1	11.7
				130	Operation not recommended						65.0	6.01	44.5	138.6	3.2	5.0	11.5								
70	11.25	3.0	6.9	60	70.7	2.84	61.0	80.7	7.3	1.4	3.2	71.2	2.78	61.7	73.2	7.5	3.3	7.7	71.6	2.73	62.3	69.7	7.7	6.0	13.8
				80	72.5	3.64	60.1	100.5	5.8	1.2	2.9	72.9	3.57	60.7	93.3	6.0	3.1	7.1	73.2	3.50	61.3	89.9	6.1	5.6	13.0
				100	72.1	4.61	56.3	119.9	4.6	1.1	2.6	72.3	4.52	56.9	113.1	4.7	2.9	6.7	72.6	4.43	57.5	109.7	4.8	5.3	12.3
				120	69.4	5.73	49.9	139.0	3.5	1.1	2.4	69.6	5.62	50.4	132.4	3.6	2.8	6.4	69.7	5.51	50.9	129.3	3.7	5.1	11.7
				130	Operation not recommended						68.0	6.07	47.3	138.9	3.3	5.0	11.5								
	15.0	5.5	12.8	60	73.5	2.87	63.7	80.9	7.5	1.4	3.2	73.9	2.81	64.3	73.4	7.7	3.3	7.7	74.4	2.75	65.0	70.0	7.9	6.0	13.8
				80	75.4	3.68	62.8	100.7	6.0	1.2	2.9	75.8	3.61	63.5	93.5	6.2	3.1	7.1	76.2	3.53	64.1	90.1	6.3	5.6	13.0
				100	75.1	4.67	59.1	120.2	4.7	1.1	2.6	75.3	4.57	59.7	113.3	4.8	2.9	6.7	75.6	4.48	60.3	109.9	4.9	5.3	12.3
				120	72.5	5.83	52.6	139.2	3.6	1.1	2.4	72.6	5.71	53.1	132.7	3.7	2.8	6.4	72.7	5.60	53.6	129.5	3.8	5.1	11.7
				130	Operation not recommended						70.4	6.13	49.5	139.2	3.4	5.0	11.5								
80	11.25	2.8	6.5	60	73.7	2.89	63.9	82.3	7.5	1.4	3.2	74.2	2.84	64.5	74.1	7.7	3.3	7.7	74.7	2.78	65.2	70.3	7.9	6.0	13.8
				80	77.3	3.71	64.7	102.3	6.1	1.2	2.9	77.7	3.63	65.3	94.3	6.3	3.1	7.1	78.2	3.56	66.0	90.6	6.4	5.6	13.0
				100	77.7	4.67	61.8	121.8	4.9	1.1	2.6	78.0	4.58	62.4	114.2	5.0	2.9	6.7	78.4	4.49	63.0	110.6	5.1	5.3	12.3
				120	74.8	5.79	55.1	140.7	3.8	1.1	2.4	75.0	5.68	55.7	133.5	3.9	2.8	6.4	75.2	5.56	56.2	130.1	4.0	5.1	11.7
				130	Operation not recommended						73.1	6.06	52.4	139.7	3.5	5.0	11.5								
	15.0	5.3	12.1	60	76.9	2.92	67.0	82.4	7.7	1.4	3.2	77.4	2.87	67.6	74.2	7.9	3.3	7.7	77.9	2.81	68.3	70.4	8.1	6.0	13.8
				80	80.7	3.74	68.0	102.5	6.3	1.2	2.9	81.2	3.67	68.7	94.5	6.5	3.1	7.1	81.6	3.60	69.3	90.8	6.7	5.6	13.0
				100	81.3	4.74	65.2	122.0	5.0	1.1	2.6	81.7	4.64	65.8	114.4	5.2	2.9	6.7	82.0	4.55	66.5	110.8	5.3	5.3	12.3
				120	78.7	5.91	58.5	141.0	3.9	1.1	2.4	78.9	5.79	59.1	133.8	4.0	2.8	6.4	79.1	5.68	59.7	130.4	4.1	5.1	11.7
				130	Operation not recommended						76.3	6.12	55.4	139.9	3.6	5.0	11.5								

Interpolation is permissible, extrapolation is not.
All performance data is based upon the lower voltage of dual voltage rated units
Operation below 40°F EWT is based upon 15% methanol antifreeze solution
See performance data notes for operation in the shaded areas. Calculation to determine percentage of antifreeze required on source side.
Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated

WPD Adder For Required Strainer

Performance Data — HEW120 - Cooling

SOURCE			LOAD																						
EWT °F	Flow		EWT °F	Flow 15.0 GPM						Flow 22.5 GPM						Flow 30.0 GPM									
	GPM	WPD PSI		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD PSI		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD PSI		TC Mbtuh	Power kW	HR Mbtuh	LWT °F	EER	WPD PSI		
									TC Mbtuh	Power kW						TC Mbtuh	Power kW						TC Mbtuh	Power kW	TC Mbtuh
50	15.0	1.4	3.2	50	105.2	4.41	120.3	38.2	23.9	1.6	3.7	106.9	4.45	122.1	41.0	24.0	3.8	8.8	110.7	4.50	126.0	42.5	24.6	6.8	15.7
				60	106.4	4.45	121.6	47.1	23.9	1.5	3.5	108.1	4.49	123.4	50.5	24.1	3.7	8.4	111.9	4.54	127.4	52.4	24.7	6.6	15.2
				70	107.6	4.48	122.9	56.0	24.0	1.4	3.3	109.3	4.53	124.8	60.0	24.1	3.5	8.1	113.1	4.57	128.7	62.2	24.7	6.4	14.7
				80	111.0	4.49	126.3	64.7	24.7	1.4	3.2	112.8	4.53	128.3	69.4	24.9	3.4	7.9	116.7	4.58	132.4	72.0	25.5	6.2	14.3
	22.5	3.8	8.7	90	114.4	4.49	129.8	73.5	25.5	1.3	3.0	116.3	4.54	131.8	78.9	25.6	3.3	7.6	120.3	4.58	136.0	81.8	26.3	6.0	13.9
				50	106.8	4.45	122.0	38.0	24.0	1.6	3.7	108.3	4.50	123.6	40.8	24.1	3.8	8.8	112.1	4.54	127.6	42.3	24.7	6.8	15.7
				60	110.9	4.49	126.2	46.7	24.7	1.5	3.5	112.5	4.54	128.0	50.1	24.8	3.7	8.4	116.4	4.58	132.0	52.0	25.4	6.6	15.2
				70	115.1	4.53	130.5	55.4	25.4	1.4	3.3	116.7	4.57	132.3	59.4	25.5	3.5	8.1	120.8	4.62	136.5	61.6	26.1	6.4	14.7
				80	116.1	4.53	131.6	64.3	25.6	1.4	3.2	117.7	4.58	133.4	69.0	25.7	3.4	7.9	121.9	4.62	137.6	71.5	26.4	6.2	14.3
	30.0	6.8	15.6	90	117.2	4.54	132.6	73.2	25.8	1.3	3.0	118.8	4.58	134.5	78.5	25.9	3.3	7.6	123.0	4.63	138.8	81.4	26.6	6.0	13.9
				50	111.1	4.50	126.5	35.8	24.7	1.6	3.7	113.0	4.54	128.5	40.3	24.9	3.8	8.8	115.9	4.59	131.5	42.1	25.2	6.8	15.7
				60	114.9	4.54	130.4	45.0	25.3	1.5	3.5	117.5	4.58	133.1	49.8	25.6	3.7	8.4	123.0	4.63	138.8	51.5	26.6	6.6	15.2
				70	118.8	4.57	134.4	54.1	26.0	1.4	3.3	122.0	4.62	137.8	59.3	26.4	3.5	8.1	130.2	4.67	146.1	60.9	27.9	6.4	14.7
				80	120.7	4.58	136.3	63.5	26.4	1.4	3.2	123.6	4.62	139.4	68.7	26.7	3.4	7.9	131.7	4.67	147.6	70.8	28.2	6.2	14.3
	70	1.2	2.7	90	122.5	4.58	138.2	72.8	26.7	1.3	3.0	125.2	4.63	141.0	78.1	27.0	3.3	7.6	133.2	4.68	149.1	80.7	28.5	6.0	13.9
				50	98.2	5.64	117.5	38.1	17.4	1.6	3.7	100.6	5.70	120.1	41.1	17.7	3.8	8.8	104.0	5.76	123.7	42.9	18.1	6.8	15.7
				60	106.3	5.68	125.7	46.4	18.7	1.5	3.5	109.0	5.74	128.6	50.0	19.0	3.7	8.4	112.6	5.79	132.4	52.3	19.4	6.6	15.2
				70	114.4	5.71	133.9	54.8	20.0	1.4	3.3	117.3	5.77	137.0	59.1	20.3	3.5	8.1	121.3	5.83	141.2	61.7	20.8	6.4	14.7
				80	118.7	5.83	138.6	63.4	20.3	1.4	3.2	121.7	5.89	141.8	68.3	20.6	3.4	7.9	125.7	5.95	146.1	71.4	21.1	6.2	14.3
				90	122.9	5.95	143.2	71.9	20.6	1.3	3.0	126.0	6.02	146.5	77.6	20.9	3.3	7.6	130.2	6.08	151.0	81.1	21.4	6.0	13.9
	22.5	3.3	7.6	50	100.3	5.70	119.8	38.0	17.6	1.6	3.7	102.7	5.76	122.4	41.0	17.8	3.8	8.8	106.2	5.82	126.0	42.8	18.3	6.8	15.7
				60	109.1	5.74	128.7	46.2	19.0	1.5	3.5	111.7	5.79	131.5	49.8	19.3	3.7	8.4	115.5	5.85	135.4	52.1	19.7	6.6	15.2
				70	117.9	5.77	137.6	54.5	20.4	1.4	3.3	120.7	5.83	140.6	58.8	20.7	3.5	8.1	124.8	5.89	144.9	61.4	21.2	6.4	14.7
				80	121.6	5.89	141.7	63.1	20.6	1.4	3.2	124.5	5.95	144.9	68.1	20.9	3.4	7.9	128.7	6.01	149.2	71.1	21.4	6.2	14.3
				90	125.2	6.02	145.8	71.7	20.8	1.3	3.0	128.3	6.08	149.1	77.3	21.1	3.3	7.6	132.6	6.14	153.6	80.8	21.6	6.0	13.9
	30.0	6.1	14.1	50	102.4	5.76	122.0	36.9	17.8	1.6	3.7	106.6	5.82	126.4	40.8	18.3	3.8	8.8	108.5	5.88	128.6	42.6	18.5	6.8	15.7
				60	111.3	5.79	131.1	45.4	19.2	1.5	3.5	115.2	5.85	135.2	49.6	19.7	3.7	8.4	118.8	5.91	138.9	51.8	20.1	6.6	15.2
				70	120.2	5.83	140.1	53.9	20.6	1.4	3.3	123.9	5.89	144.0	58.5	21.0	3.5	8.1	129.0	5.95	149.3	61.1	21.7	6.4	14.7
				80	124.7	5.95	145.0	62.7	20.9	1.4	3.2	128.3	6.01	148.8	67.8	21.3	3.4	7.9	134.3	6.07	155.0	70.6	22.1	6.2	14.3
				90	129.1	6.08	149.9	71.5	21.3	1.3	3.0	132.6	6.14	153.6	77.1	21.6	3.3	7.6	139.5	6.20	160.7	80.2	22.5	6.0	13.9
	80	1.1	2.5	50	94.7	6.26	116.1	38.0	15.1	1.6	3.7	97.5	6.33	119.1	41.1	15.4	3.8	8.8	100.7	6.39	122.5	43.1	15.8	6.8	15.7
				60	106.3	6.30	127.8	46.1	16.9	1.5	3.5	109.4	6.36	131.1	49.8	17.2	3.7	8.4	113.0	6.42	134.9	52.3	17.6	6.6	15.2
				70	117.9	6.33	139.5	54.2	18.6	1.4	3.3	121.4	6.39	143.2	58.6	19.0	3.5	8.1	125.3	6.46	147.4	61.5	19.4	6.4	14.7
				80	122.5	6.51	144.7	62.7	18.8	1.4	3.2	126.1	6.57	148.6	67.8	19.2	3.4	7.9	130.3	6.64	152.9	71.1	19.6	6.2	14.3
				90	127.1	6.69	149.9	71.1	19.0	1.3	3.0	130.9	6.75	153.9	76.9	19.4	3.3	7.6	135.2	6.82	158.4	80.7	19.8	6.0	13.9
	22.5	3.1	7.1	50	97.1	6.33	118.7	38.0	15.3	1.6	3.7	99.9	6.39	121.7	41.1	15.6	3.8	8.8	103.2	6.45	125.2	43.0	16.0	6.8	15.7
				60	108.2	6.36	129.9	46.0	17.0	1.5	3.5	111.4	6.42	133.3	49.7	17.3	3.7	8.4	115.0	6.49	137.1	52.2	17.7	6.6	15.2
				70	119.3	6.39	141.1	54.0	18.7	1.4	3.3	122.8	6.46	144.8	58.4	19.0	3.5	8.1	126.8	6.52	149.1	61.3	19.4	6.4	14.7
				80	124.3	6.57	146.7	62.5	18.9	1.4	3.2	127.9	6.64	150.6	67.6	19.3	3.4	7.9	132.1	6.71	155.0	70.9	19.7	6.2	14.3
				90	129.3	6.75	152.3	71.0	19.1	1.3	3.0	133.1	6.82	156.4	76.8	19.5	3.3	7.6	137.5	6.89					

Performance Data — HEW120 - Cooling

Table Continued from Previous Page

				50	79.6	8.92	110.0	39.9	8.9	1.6	3.7	82.6	9.01	113.3	42.5	9.2	3.8	8.8	83.5	9.10	114.5	44.1	9.2	6.8	15.7
				60	91.6	9.08	122.6	48.2	10.1	1.5	3.5	95.0	9.17	126.3	51.2	10.4	3.7	8.4	96.1	9.26	127.6	53.2	10.4	6.6	15.2
				70	103.6	9.23	135.1	56.4	11.2	1.4	3.3	107.4	9.32	139.3	60.0	11.5	3.5	8.1	108.6	9.42	140.8	62.4	11.5	6.4	14.7
				80	112.8	9.39	144.8	64.9	12.0	1.4	3.2	117.0	9.48	149.4	69.0	12.3	3.4	7.9	118.3	9.58	151.0	71.7	12.3	6.2	14.3
				90	122.0	9.55	154.6	73.4	12.8	1.3	3.0	126.6	9.64	159.5	78.0	13.1	3.3	7.6	128.0	9.74	161.2	81.1	13.1	6.0	13.9
				50	81.3	9.01	112.0	39.9	9.0	1.6	3.7	84.3	9.10	115.4	42.4	9.3	3.8	8.8	85.2	9.19	116.6	44.1	9.3	6.8	15.7
				60	94.5	9.17	125.8	48.1	10.3	1.5	3.5	98.0	9.26	129.6	51.2	10.6	3.7	8.4	99.1	9.35	131.0	53.2	10.6	6.6	15.2
				70	107.8	9.32	139.6	56.3	11.6	1.4	3.3	111.8	9.42	143.9	59.9	11.9	3.5	8.1	113.0	9.51	145.5	62.2	11.9	6.4	14.7
				80	115.7	9.48	148.1	64.7	12.2	1.4	3.2	120.0	9.58	152.7	68.8	12.5	3.4	7.9	121.3	9.68	154.4	71.5	12.5	6.2	14.3
				90	123.7	9.64	156.6	73.1	12.8	1.3	3.0	128.3	9.74	161.5	77.7	13.2	3.3	7.6	129.7	9.84	163.3	80.8	13.2	6.0	13.9
				50	83.1	9.10	114.1	39.4	9.1	1.6	3.7	84.7	9.19	116.1	42.4	9.2	3.8	8.8	87.6	9.28	119.3	44.0	9.4	6.8	15.7
				60	95.2	9.26	126.8	47.4	10.3	1.5	3.5	97.0	9.35	128.9	51.1	10.4	3.7	8.4	101.4	9.45	133.7	53.1	10.7	6.6	15.2
				70	107.4	9.42	139.5	55.3	11.4	1.4	3.3	109.3	9.51	141.8	59.9	11.5	3.5	8.1	115.2	9.61	148.0	62.2	12.0	6.4	14.7
				80	116.5	9.58	149.2	64.2	12.2	1.4	3.2	119.5	9.68	152.5	68.7	12.3	3.4	7.9	123.4	9.77	156.8	71.4	12.6	6.2	14.3
				90	125.6	9.74	158.9	73.0	12.9	1.3	3.0	129.6	9.84	163.1	77.6	13.2	3.3	7.6	131.7	9.94	165.6	80.7	13.2	6.0	13.9
				50	74.0	10.08	108.4	40.3	7.3	1.6	3.7	77.0	10.18	111.8	43.2	7.6	3.8	8.8	78.6	10.28	113.7	44.7	7.6	6.8	15.7
				60	85.4	10.25	120.4	48.6	8.3	1.5	3.5	88.9	10.36	124.2	52.0	8.6	3.7	8.4	90.7	10.46	126.4	53.8	8.7	6.6	15.2
				70	96.8	10.42	132.4	56.9	9.3	1.4	3.3	100.8	10.53	136.7	60.8	9.6	3.5	8.1	102.8	10.64	139.1	62.9	9.7	6.4	14.7
				80	105.9	10.62	142.1	65.2	10.0	1.4	3.2	110.2	10.72	146.8	69.7	10.3	3.4	7.9	112.5	10.83	149.4	72.1	10.4	6.2	14.3
				90	115.1	10.81	151.9	73.5	10.6	1.3	3.0	119.7	10.92	157.0	78.6	11.0	3.3	7.6	122.2	11.03	159.8	81.3	11.1	6.0	13.9
				50	74.5	10.18	109.2	40.3	7.3	1.6	3.7	77.5	10.28	112.6	43.1	7.5	3.8	8.8	79.1	10.39	114.6	44.6	7.6	6.8	15.7
				60	86.3	10.36	121.6	48.5	8.3	1.5	3.5	89.8	10.46	125.5	51.9	8.6	3.7	8.4	91.6	10.57	127.7	53.7	8.7	6.6	15.2
				70	98.1	10.53	134.0	56.7	9.3	1.4	3.3	102.1	10.64	138.4	60.6	9.6	3.5	8.1	104.2	10.74	140.8	62.7	9.7	6.4	14.7
				80	107.3	10.72	143.9	65.0	10.0	1.4	3.2	111.7	10.83	148.6	69.6	10.3	3.4	7.9	113.9	10.94	151.3	72.0	10.4	6.2	14.3
				90	116.5	10.92	153.7	73.4	10.7	1.3	3.0	121.2	11.03	158.9	78.5	11.0	3.3	7.6	123.7	11.14	161.7	81.3	11.1	6.0	13.9
				50	76.9	10.28	112.0	40.0	7.5	1.6	3.7	80.2	10.39	115.7	42.9	7.7	3.8	8.8	81.7	10.49	117.5	44.5	7.8	6.8	15.7
				60	88.8	10.46	124.4	48.2	8.5	1.5	3.5	92.8	10.57	128.9	51.7	8.8	3.7	8.4	94.6	10.67	131.0	53.6	8.9	6.6	15.2
				70	100.6	10.64	136.9	56.5	9.5	1.4	3.3	105.5	10.74	142.1	60.5	9.8	3.5	8.1	107.6	10.85	144.6	62.6	9.9	6.4	14.7
				80	109.9	10.83	146.8	64.9	10.1	1.4	3.2	115.1	10.94	152.4	69.5	10.5	3.4	7.9	117.2	11.05	154.9	71.9	10.6	6.2	14.3
				90	119.2	11.03	156.8	73.3	10.8	1.3	3.0	124.7	11.14	162.7	78.5	11.2	3.3	7.6	126.9	11.25	165.3	81.2	11.3	6.0	13.9

Interpolation is permissible, extrapolation is not

All performance data is based upon the lower voltage of dual voltage rated units

See performance data notes for operation in the shaded areas. Calculation to determine

percentage of antifreeze required on load side.

Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated

WPD Adder For Required Strainer			
CV	GPM	PSI	FT HD
24	15.0	.6	1.4
24	22.5	.9	2.1
24	30.0	1.3	3.0

Performance Data — HEW120 - Heating

SOURCE			LOAD																											
EWT °F	Flow		EWT °F	Flow 15.0 GPM						Flow 22.5 GPM						Flow 30.0 GPM														
	GPM	WPD PSI		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI	HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI	HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI	FT								
20	30.0	8.0	18.6	60	82.2	4.86	65.6	71.5	5.0	1.5	3.5	82.6	4.76	66.3	67.4	5.1	3.3	7.7	82.9	4.67	67.0	65.3	5.2	6.0	13.8					
				80	80.9	6.34	59.3	91.2	3.7	1.4	3.2	81.1	6.22	59.9	87.2	3.8	3.1	7.1	81.3	6.09	60.5	85.3	3.9	5.6	13.0					
				100	79.3	8.23	51.3	110.8	2.8	1.3	2.9	79.3	8.06	51.8	106.9	2.9	2.9	6.7	79.3	7.90	52.4	105.1	2.9	5.3	12.3					
30	15.0	1.7	3.9	60	95.6	5.04	78.4	73.3	5.6	1.5	3.5	96.0	4.94	79.2	68.6	5.7	3.3	7.7	96.5	4.84	80.0	66.3	5.8	6.0	13.8					
				80	93.8	6.55	71.5	92.9	4.2	1.4	3.2	94.1	6.42	72.2	88.4	4.3	3.1	7.1	94.4	6.29	73.0	86.1	4.4	5.6	13.0					
				100	91.7	8.44	62.9	112.4	3.2	1.3	2.9	91.8	8.27	63.5	108.1	3.3	2.9	6.7	91.9	8.11	64.2	105.9	3.3	5.3	12.3					
	22.5	4.4	10.1	60	100.0	5.13	82.5	73.6	5.7	1.5	3.5	100.5	5.02	83.4	68.9	5.9	3.3	7.7	101.0	4.92	84.2	66.6	6.0	6.0	13.8					
				80	97.9	6.66	75.2	93.3	4.3	1.4	3.2	98.3	6.53	76.0	88.7	4.4	3.1	7.1	98.6	6.40	76.8	86.5	4.5	5.6	13.0					
				100	95.7	8.58	66.4	112.8	3.3	1.3	2.9	95.8	8.41	67.1	108.4	3.3	2.9	6.7	95.9	8.24	67.8	106.2	3.4	5.3	12.3					
	30.0	7.6	17.5	60	103.9	5.21	86.1	73.9	5.8	1.5	3.5	104.4	5.11	87.0	69.1	6.0	3.3	7.7	105.0	5.01	87.9	66.8	6.1	6.0	13.8					
				80	101.8	6.77	78.7	93.4	4.4	1.4	3.2	102.1	6.64	79.5	88.9	4.5	3.1	7.1	102.5	6.50	80.3	86.6	4.6	5.6	13.0					
				100	99.2	8.73	69.4	112.9	3.3	1.3	2.9	99.3	8.55	70.1	108.6	3.4	2.9	6.7	99.4	8.38	70.8	106.4	3.5	5.3	12.3					
	40 EWT	1.5	3.5	60	108.9	5.22	91.1	75.0	6.1	1.5	3.5	109.5	5.12	92.0	69.7	6.3	3.3	7.7	110.1	5.02	93.0	67.2	6.4	6.0	13.8					
				80	106.7	6.76	83.6	94.6	4.6	1.4	3.2	107.1	6.62	84.5	89.6	4.7	3.1	7.1	107.6	6.49	85.4	87.0	4.9	5.6	13.0					
				100	104.0	8.65	74.5	114.0	3.5	1.3	2.9	104.2	8.48	75.3	109.2	3.6	2.9	6.7	104.4	8.31	76.1	106.7	3.7	5.3	12.3					
	40	2.25	4.1	60	110.7	10.91	63.5	133.4	2.7	1.2	2.7	100.7	10.69	64.2	128.7	2.8	2.8	6.4	100.6	10.48	64.9	126.4	2.8	5.1	11.7					
				80	114.7	5.29	96.7	75.5	6.4	1.5	3.5	115.4	5.19	97.7	70.1	6.5	3.3	7.7	116.0	5.08	98.7	67.5	6.7	6.0	13.8					
				100	111.8	6.85	88.5	95.1	4.8	1.4	3.2	112.3	6.71	89.4	90.0	4.9	3.1	7.1	112.7	6.58	90.3	87.4	5.0	5.6	13.0					
	30.0	7.2	16.6	60	108.6	8.77	78.7	114.5	3.6	1.3	2.9	108.8	8.59	79.5	109.7	3.7	2.9	6.7	109.1	8.42	80.3	107.1	3.8	5.3	12.3					
				80	115.6	5.36	100.2	75.9	6.5	1.5	3.5	119.1	5.26	101.2	70.5	6.6	3.3	7.7	119.8	5.15	102.2	67.9	6.8	6.0	13.8					
				100	115.6	6.94	91.9	95.3	4.9	1.4	3.2	116.1	6.80	92.8	90.3	5.0	3.1	7.1	116.5	6.67	93.8	87.6	5.1	5.6	13.0					
	50 EWT	1.4	3.2	60	112.1	8.89	81.8	114.7	3.7	1.3	2.9	112.3	8.71	82.6	109.9	3.8	2.9	6.7	112.6	8.54	83.5	107.3	3.9	5.3	12.3					
				80	118.5	5.36	103.8	76.8	6.6	1.5	3.5	122.9	5.30	104.9	70.8	6.8	3.3	7.7	123.7	5.19	106.0	68.1	7.0	6.0	13.8					
				100	119.6	6.97	95.8	96.3	5.0	1.4	3.2	120.1	6.83	96.8	90.8	5.2	3.1	7.1	120.7	6.69	97.9	87.8	5.3	5.6	13.0					
	50	22.5	3.8	130	116.3	8.87	86.1	115.6	3.8	1.3	2.9	116.6	8.69	87.0	110.4	3.9	2.9	6.7	117.0	8.52	87.9	107.5	4.0	5.3	12.3					
				150	112.3	11.11	74.4	134.9	3.0	1.2	2.7	112.4	10.89	75.2	129.7	3.0	2.8	6.4	112.5	10.67	76.1	127.2	3.1	5.1	11.7					
				170	OPERATION NOT RECOMMENDED												110.3	12.31	68.3	139.8	2.6	2.7	6.2	110.2	12.06	69.1	137.2	2.7	5.0	11.5
	60 EWT	1.4	3.2	60	129.4	5.46	110.8	77.4	6.9	1.5	3.5	130.2	5.35	111.9	71.3	7.1	3.3	7.7	131.0	5.24	113.1	68.5	7.3	6.0	13.8					
				80	125.7	7.04	101.7	96.9	5.2	1.4	3.2	126.3	6.90	102.7	91.3	5.4	3.1	7.1	126.8	6.76	103.8	88.3	5.5	5.6	13.0					
				100	121.6	8.96	91.0	116.2	4.0	1.3	2.9	121.9	8.78	92.0	110.9	4.1	2.9	6.7	122.3	8.60	92.9	108.0	4.2	5.3	12.3					
	60	30.0	6.8	120	117.2	11.22	78.9	135.4	3.1	1.2	2.7	117.2	11.00	79.7	130.2	3.1	2.8	6.4	117.3	10.78	80.5	127.7	3.2	5.1	11.7					
				130													115.8	12.43	73.4	139.9	2.7	2.7	6.2	117.1	12.19	74.1	137.3	2.8	5.0	11.5
				150	133.0	5.51	114.2	78.0	7.1	1.5	3.5	133.8	5.40	115.3	71.9	7.3	3.3	7.7	134.6	5.30	116.5	69.0	7.4	6.0	13.8					
	60	30.0	15.6	160	129.4	7.11	105.1	97.2	5.3	1.4	3.2	130.0	6.97	106.2	91.6	5.5	3.1	7.1	130.6	6.83	107.3	88.6	5.6	5.6	13.0					
				180	125.0	9.05	94.2	116.4	4.1	1.3	2.9	125.4	8.87	95.1	111.1	4.1	2.9	6.7	125.7	8.69	96.1	108.2	4.2	5.3	12.3					
				200	119.9	11.34	81.2	135.6	3.1	1.2	2.7	120.0	11.11	82.1	130.5	3.2	2.8	6.4	120.0	10.89	82.9	127.9	3.2	5.1	11.7					
	60	30.0	14.8	220	117.5	12.56	74.7	140.3	2.7	2.7	6.2	117.5	12.46	74.7	140.3	2.7	2.7	6.2	117.4	12.17	74.7	137.3	2.8	5.0	11.5					
				240	129.7	5.51	110.9	78.5	6.9	1.5	3.5	130.5	5.40	112.1	71.7	7.1	3.3	7.7	131.3	5.30	113.2	68.6	7.3	6.0	13.8					
				260	129.6	7.09	105.4	98.1	5.4	1.4	3.2	130.2	6.95	106.5	91.8	5.5	3.1	7.1	130.9	6.81	107.6	88.6	5.6	5.6	13.0					
	60	30.0	14.8	280	127.3	8.98	96.7	117.6	4.2	1.3	2.9	127.7	7.02	97.7	115.5	4.3	2.9	6.7	128.2	6.83	98.7	108.4	4.4	5.3	12.3					
				300	122.8	11.19	84.7	136.7	3.2	1.2	2.7	123.0	10.97	85.6	130.9	3.3	2.8	6.4	123.2	10.75	86.5	128.0	3.4	5.1	11.7					
				320	135.3	7.16	110.9	98.7	5.5	1.4	3.2	136.																		

Performance Data — HEW120 - Heating

Table Continued from Previous Page

SOURCE			LOAD																							
EWT °F	Flow		EWT °F	Flow 15.0 GPM						Flow 22.5 GPM						Flow 30.0 GPM										
	GPM	WPD PSI		HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI	HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI	HC Mbtuh	Power kW	HE Mbtuh	LWT °F	COP	WPD PSI					
70	15.0	1.2	2.7	60	137.2	5.62	118.0	80.1	7.2	1.5	3.5	138.1	5.51	119.3	72.6	7.3	3.3	7.7	138.9	5.40	120.5	69.2	7.5	6.0	13.8	
				80	139.6	7.21	115.0	100.0	5.7	1.4	3.2	140.3	7.07	116.2	92.8	5.8	3.1	7.1	141.1	6.93	117.4	89.4	6.0	5.6	13.0	
		1.2		100	138.3	9.01	107.3	119.5	4.5	1.3	2.9	138.8	8.92	108.4	112.6	4.6	2.9	6.7	139.4	8.74	109.6	109.3	4.7	5.3	12.3	
				120	133.3	11.27	94.9	138.5	3.5	1.2	2.7	133.6	11.05	95.9	132.0	3.5	2.8	6.4	133.9	10.83	96.9	128.9	3.6	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										130.0	12.02	88.9	138.6	3.2	5.0	11.5					
	22.5	3.3	7.6	60	141.5	5.68	122.1	80.7	7.3	1.5	3.5	142.3	5.57	123.3	73.2	7.5	3.3	7.7	143.2	5.46	124.6	69.7	7.7	6.0	13.8	
				80	145.0	7.29	120.1	100.5	5.8	1.4	3.2	145.7	7.14	121.4	93.3	6.0	3.1	7.1	146.5	7.00	122.6	89.9	6.1	5.6	13.0	
		3.3		100	144.1	9.22	112.7	119.9	4.6	1.3	2.9	144.7	9.03	113.9	113.1	4.7	2.9	6.7	145.2	8.85	115.0	109.7	4.8	5.3	12.3	
				120	138.9	11.46	99.7	139.0	3.5	1.2	2.7	139.1	11.24	100.8	132.4	3.6	2.8	6.4	139.4	11.01	101.8	129.3	3.7	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										136.1	12.15	94.6	138.9	3.3	5.0	11.5					
80	30.0	6.1	14.1	60	146.9	5.74	127.3	80.9	7.5	1.5	3.5	147.8	5.62	128.6	73.4	7.7	3.3	7.7	148.7	5.50	129.9	70.0	7.9	6.0	13.8	
				80	150.8	7.36	125.7	100.7	6.0	1.4	3.2	151.6	7.21	126.9	93.5	6.2	3.1	7.1	152.3	7.07	128.2	90.1	6.3	5.6	13.0	
		6.1		100	150.1	9.33	118.3	120.2	4.7	1.3	2.9	150.7	9.15	119.5	113.3	4.8	2.9	6.7	151.3	8.97	120.7	109.9	4.9	5.3	12.3	
				120	144.9	11.66	105.1	139.2	3.6	1.2	2.7	145.2	11.43	106.2	132.7	3.7	2.8	6.4	145.5	11.20	107.3	129.5	3.8	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										140.8	12.27	98.9	139.2	3.4	5.0	11.5					
	15.0	1.1	2.5	60	144.7	5.73	125.2	81.7	7.4	1.5	3.5	145.6	5.62	126.5	73.5	7.6	3.3	7.7	146.5	5.51	127.8	69.8	7.8	6.0	13.8	
				80	149.6	7.34	124.6	101.8	6.0	1.4	3.2	150.4	7.19	125.9	93.9	6.1	3.1	7.1	151.2	7.05	127.2	90.2	6.3	5.6	13.0	
		1.1		100	149.3	9.21	117.9	121.4	4.8	1.3	2.9	149.9	9.03	119.1	113.8	4.9	2.9	6.7	150.6	8.85	120.4	110.2	5.0	5.3	12.3	
				120	143.8	11.35	105.1	140.4	3.7	1.2	2.7	144.2	11.13	106.2	133.2	3.8	2.8	6.4	144.5	10.91	107.3	129.8	3.9	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										139.8	12.00	98.9	139.4	3.4	5.0	11.5					
80	22.5	3.1	7.1	60	147.5	5.79	127.7	82.3	7.5	1.5	3.5	148.4	5.67	129.0	74.1	7.7	3.3	7.7	149.3	5.56	130.3	70.3	7.9	6.0	13.8	
				80	154.7	7.41	129.4	102.3	6.1	1.4	3.2	155.5	7.26	130.7	94.3	6.3	3.1	7.1	156.3	7.12	132.0	90.6	6.4	5.6	13.0	
		3.1		100	155.4	9.34	123.5	121.8	4.9	1.3	2.9	156.0	9.16	124.8	114.2	5.0	2.9	6.7	156.7	8.97	126.1	110.6	5.1	5.3	12.3	
				120	149.7	11.59	110.2	140.7	3.8	1.2	2.7	150.1	11.35	111.3	133.5	3.9	2.8	6.4	150.4	11.13	112.5	130.1	4.0	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										146.2	12.13	104.9	139.7	3.5	5.0	11.5					
	30.0	5.8	13.4	60	153.9	8.85	133.9	82.4	7.7	1.5	3.5	154.8	5.73	135.3	74.2	7.9	3.3	7.7	155.8	5.62	136.6	70.4	8.1	6.0	13.8	
				80	161.5	7.49	135.9	102.5	6.3	1.4	3.2	162.3	7.34	137.3	94.5	6.5	3.1	7.1	163.2	7.19	138.7	90.8	6.7	5.6	13.0	
		5.8		100	162.7	9.48	130.3	122.0	5.0	1.3	2.9	163.3	9.29	131.6	114.4	5.2	2.9	6.7	164.0	9.10	133.0	110.8	5.3	5.3	12.3	
				120	157.4	11.82	117.1	141.0	3.9	1.2	2.7	157.8	11.59	118.3	133.8	4.0	2.8	6.4	158.2	11.36	119.4	130.4	4.1	5.1	11.7	
				130	OPERATION NOT RECOMMENDED										152.5	12.25	110.7	139.9	3.6	5.0	11.5					

Interpolation is permissible, extrapolation is not.

All performance data is based upon the lower voltage of dual voltage rated units.

Operation below 40°F EWT is based upon 15% methanol antifreeze solution.

See performance data notes for operation in the shaded areas. Calculation to determine percentage of antifreeze required on source side.

Performance stated is at the rated power supply, performance may vary as the power supply varies from the rated

WPD Adder For Required Strainer			
CV	GPM	PSI	FT HD
24	15.0	.6	1.4
24	22.5	.9	2.1
24	30.0	1.3	3.0


Physical Data

Model	036	060	120
Compressor (qty)	Scroll (1)		Scroll (2)
Factory Charge HFC-410A (oz) [kg] Per Circuit	50 [1.41]	68 [1.93]	68 [1.93]
Water Connection Size			
Source/Load	1" Swivel		1-1/2 FPT
HWG (in)	1" Swivel		1/2" FPT
Weight			
Weight - Operating (lbs) [kg]	295 [134]	268 [122]	541 [245]
Weight - Packaged (lbs) [kg]	320 [145]	293 [133]	585 [265]
Water Volume (Source)			
Gallons (Liters)	0.56 [2.1]	0.7 [2.7]	1.4 [5.3]

Dual isolated compressor mounting
 Balanced port expansion valve (TXV)
 Insulated Source and Load Water Coils standard
 Insulated Refrigerant Circuit standard
 Compressor on (green) and fault (red) light

Unit Maximum Water Working Pressure PSIG (kPa)	
Unit	145 [100]
Maximum Water Flow Through Unit GAL (L)	
036	25 [94.6]
060, 120	35 [132.5]


Dimensions - HEW036, HEW060 & HEW120

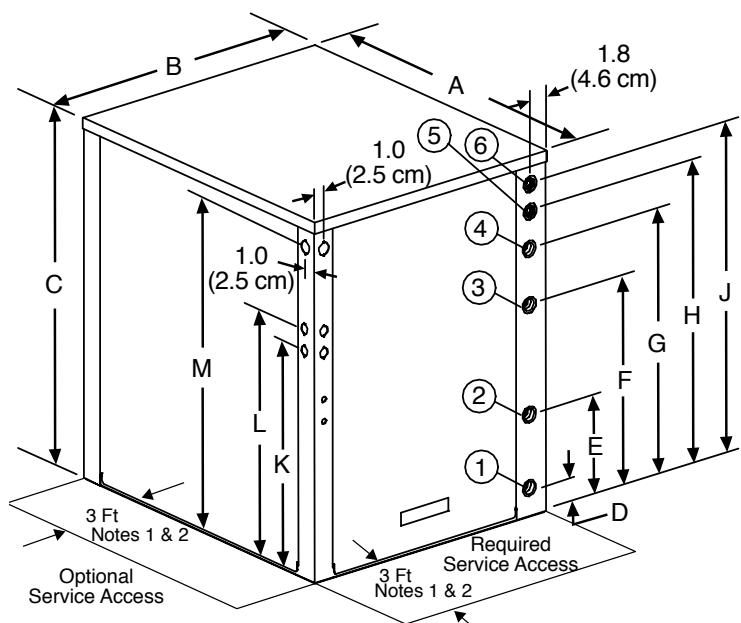

HEW 036, 060

Notes:

- Front & side access is preferred for service access. However, all components may be serviced from the front access panel if side access is not available.
- While clear access to all removable panels is not required, installer should take care to comply with all building codes and allow adequate clearance for future field service.

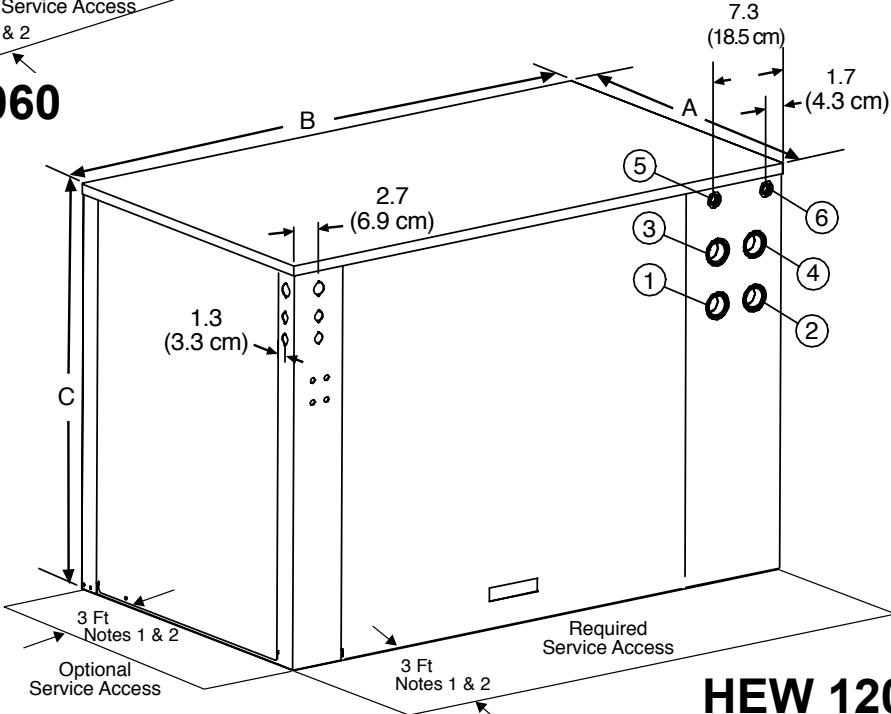

HEW 120


Water to Water			Overall Cabinet			Water Connections						Electric Access Plugs		
						1	2	3	4	5	6			
		A Depth	B Width	C Height	D Source (Outdoor) Water In	E Source (Outdoor) Water Out	F Load (Indoor) Water In	G Load (Indoor) Water Out	H HWG Water In	J HWG Water Out	K Low Voltage	L External Pump	M Power Supply	
036-060	in.	30.6	25.4	33	2.7	9.4	19.4	24.5	27.9	30.4	20.9	22.9	30.9	
	cm.	77.8	64.5	83.8	6.9	23.9	49.3	62.2	70.9	77.2	53.1	58.2	78.5	
120	in.	30.6	52.9	37	25.2	25.2	30.1	30.1	34.9	34.9	29.9	31.9	34.4	
	cm.	77.8	134.4	94	64.0	64.0	76.5	76.5	88.6	88.6	75.9	81.0	87.4	

Electrical Data


Model	Voltage Code	Rated Voltage	Min/Max Voltage	Compressor			HWG Pump FLA	EXT Loop Pump FLA	Total Unit FLA	Min Circuit Amps	Max Fuse/HACR
				RLA	LRA	QTY					
036	G	208-230/60/1	197/252	16.7	79.0	1	0.5	4.0	21.2	25.3	40
060	G	208-230/60/1	197/252	26.3	134.0	1	0.5	4.0	30.8	37.3	60
120	G	208-230/60/1	197/252	26.3	134.0	2	0.5	4.0	57.1	63.6	80

HACR circuit breaker in USA only
 Residential units come standard with 75VA transformer, HWG pump, and HWG connections

HEW036 & HEW060 Electrical Wiring Diagram - 96B0223N10

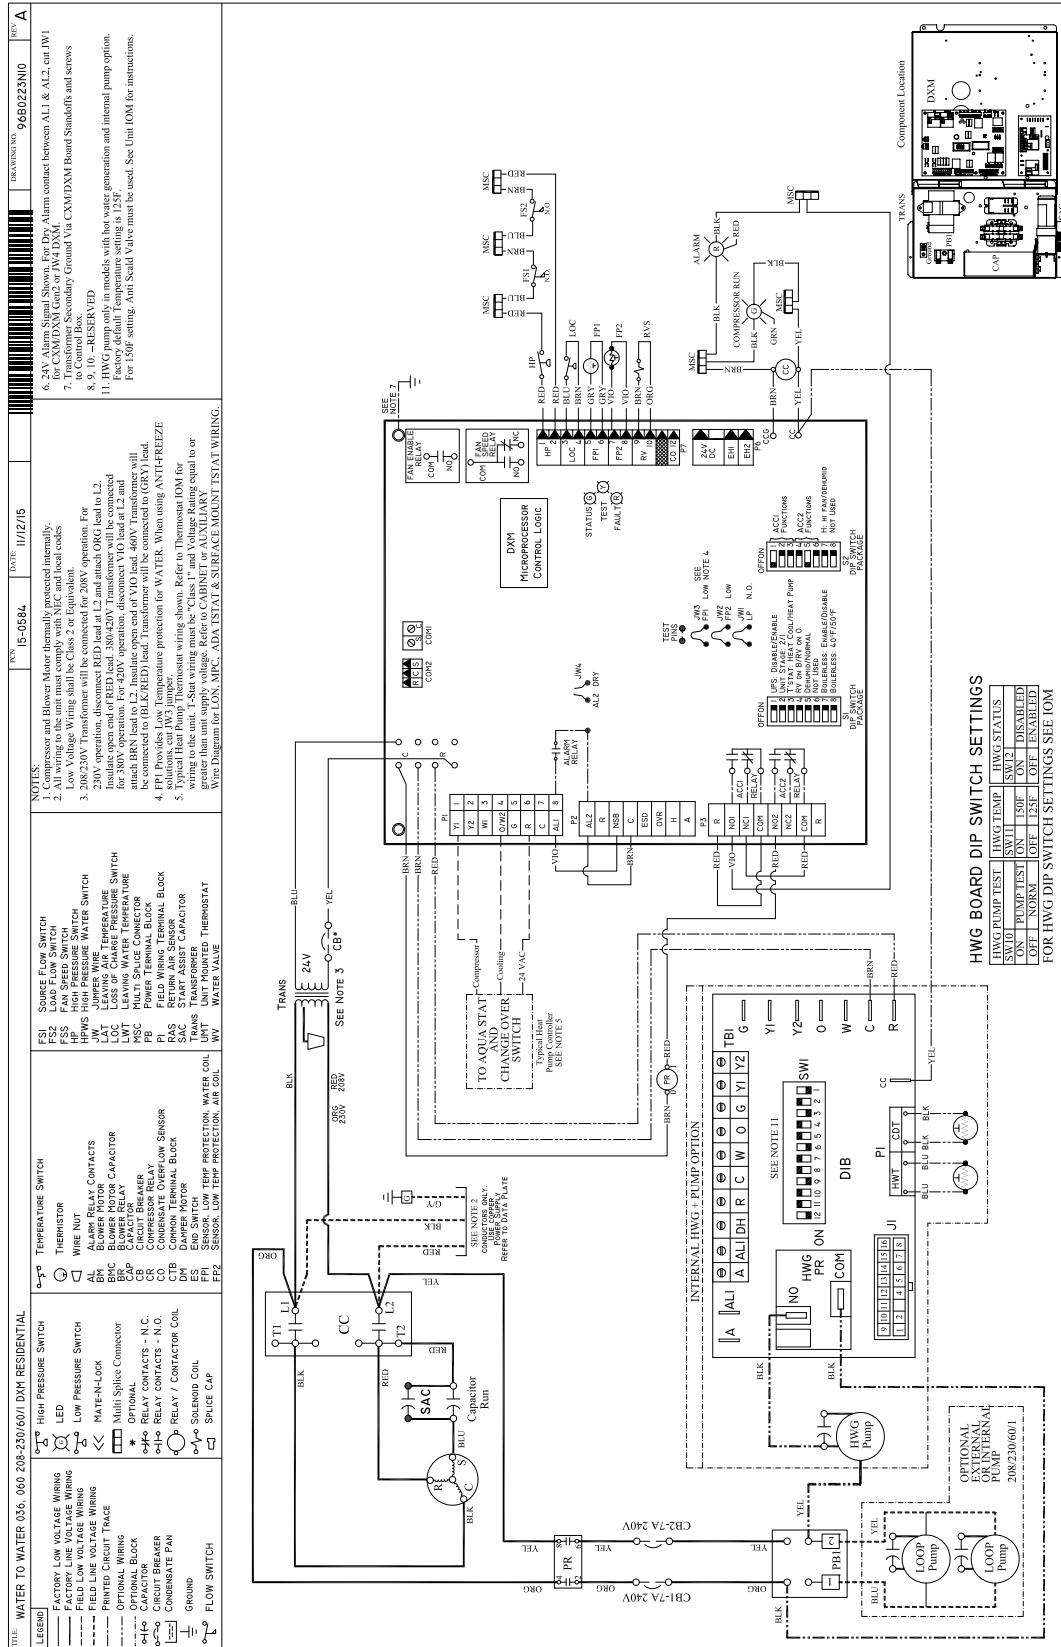

HEW120 Electrical Wiring Diagram - 96B0225N10

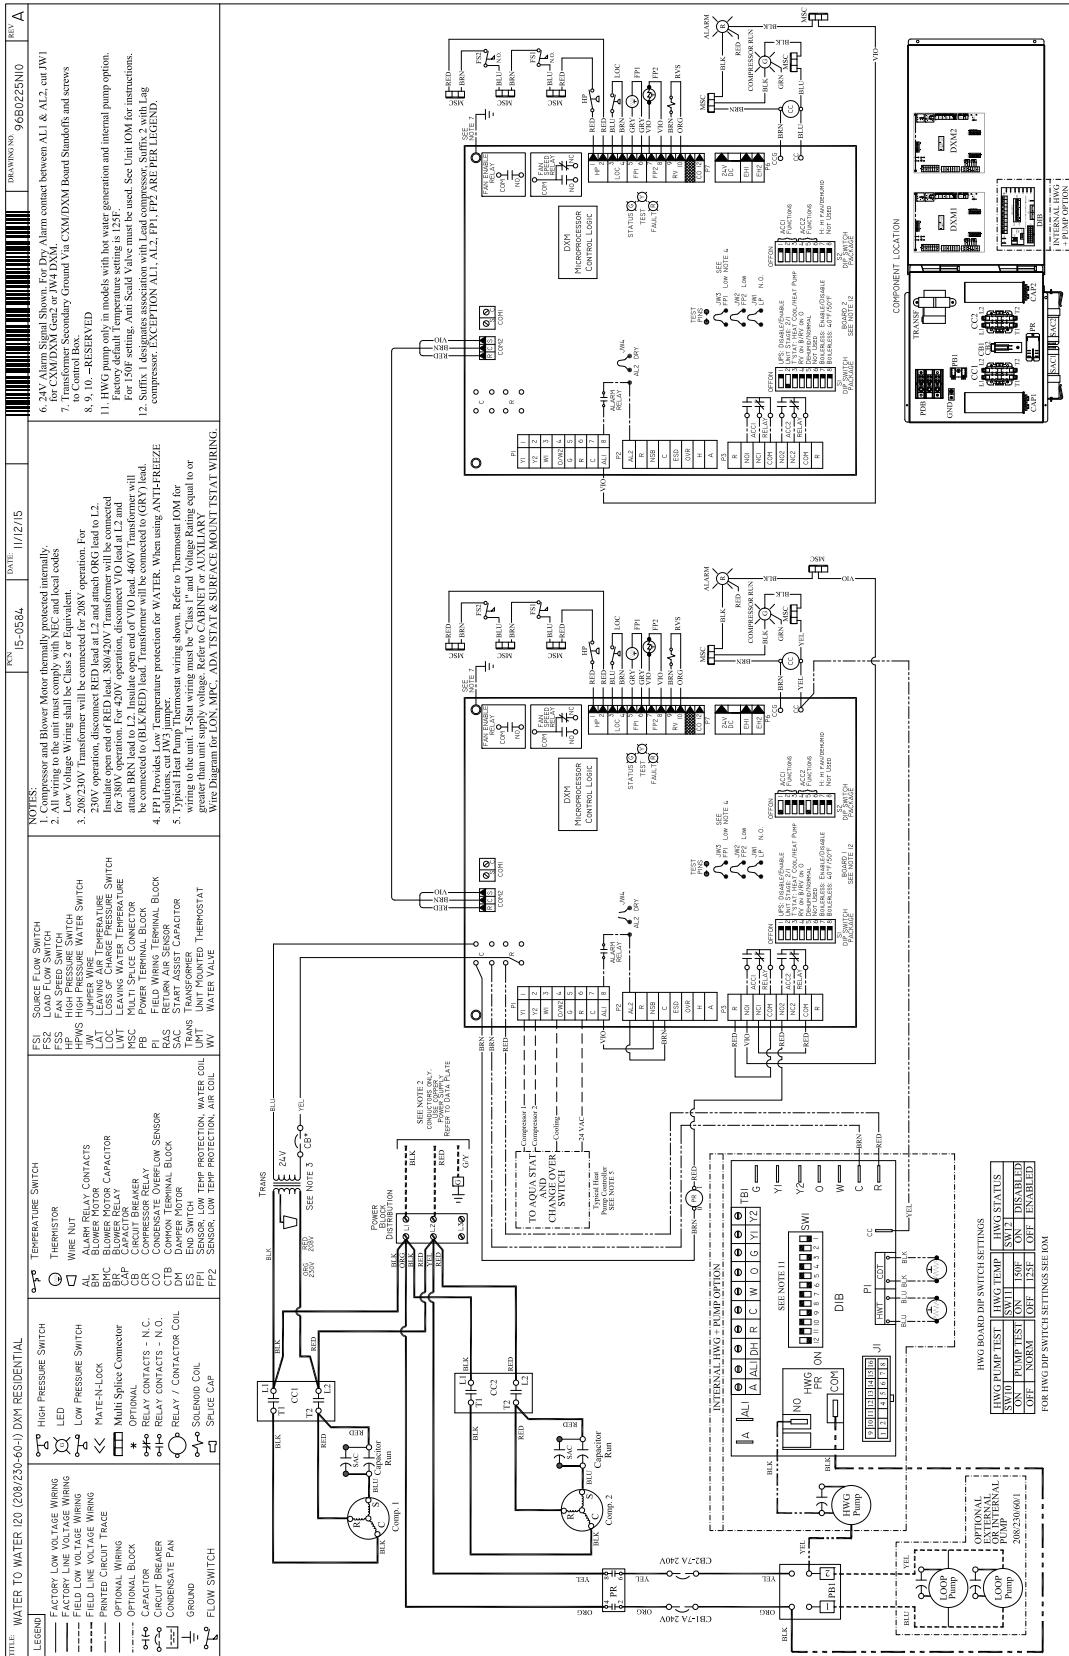

Engineering Guide Specifications

General

The TBW water-to-water heating/cooling units shall be supplied completely factory built for an entering source water temperature range from 20° to 120°F [-6.7° to 48.9°C] and entering load water temperature range from 50° to 130°F [10.0° to 54.4°C] as standard. All equipment listed in this section must be rated in accordance with Air-Conditioning, Heating and Refrigeration Institute / International Standards Organization (AHRI / ISO) and Environmental Testing Laboratories for United States and Canada (ETL-US-C). The units shall have the ETL-US-C label. The units shall be Energy Star certified for ground loop applications.

All units shall be fully quality tested by factory run testing under normal operating conditions and water flow rates as described herein. Quality control system shall automatically perform via computer: triple leak check, pressure tests, evacuate and accurately charge system, perform detailed heating and cooling mode tests, and quality cross check all operational and test conditions to pass/fail data base. Detailed report card will ship with each unit displaying all test performance data. Note: If unit fails on any cross check, system shall not be allowed unit to ship. Serial numbers will be recorded by factory and furnished to contractor on report card for ease of unit warranty status. Each unit shall be pallet mounted and shipped in clear shrink wrap for visual shipping damage inspection.

The units shall be warranted by the manufacturer against defects in materials and workmanship for a period of five years on all parts, and ten years on the compressor and refrigerant circuit parts with a service labor allowance during the first five years. An optional extended warranty is available for the Tranquility™ Series units, which adds a labor allowance and trip charge.

Furnish and install MARS/Heat Controller WSHP, as indicated on the plans. Equipment shall be completely assembled, piped and internally wired. Capacities and characteristics as listed in the schedule and the specifications that follow.

Casing and Cabinet

All units must have multiple access panels for serviceability of compressor compartment. The heat pumps shall be fabricated from heavy gauge galvanized steel with powder coat paint finish and a stainless steel front access panel. Both sides of the steel shall be painted for added protection. All interior surfaces shall be lined with 1/2 inch [12.7mm] thick, dual density, acoustic type glass fiber insulation. Insulation placement shall be designed in a manner that will eliminate any exposed edges.

Cabinets shall have separate holes and knockouts for entrance of line voltage and low voltage control wiring. All factory-installed wiring passing through factory knockouts and openings shall be protected from sheet metal edges at openings by plastic ferrules.

Unit(s) shall have exterior indicator lights showing, 1) compressor operation (on/off) and 2) unit "fault" status. Contractor shall be responsible for providing control circuitry and indicator lights for units not providing this feature.

Refrigerant Circuit

Units shall have a sealed refrigerant circuit including a high efficiency scroll compressor designed for heat pump operation, a thermostatic expansion valve for refrigerant metering, a reversing valve, brazed plate refrigerant to water heat exchangers, and safety controls including a high pressure switch, low pressure switch (loss of charge), and low temperature sensors. Access fittings shall be factory installed on high and low pressure refrigerant lines to facilitate field service. 120 units shall have 2 independent refrigeration circuits. Activation of any safety device shall prevent compressor operation via a microprocessor lockout circuit.

Hermetic compressors shall be internally sprung. The compressor(s) shall have a dual level vibration isolation system. Compressor(s) will be mounted on rubber grommets to a large heavy gauge compressor mounting plate, which is then isolated from the cabinet base with rubber grommets for maximized vibration attenuation. Compressor shall have thermal overload protection. Refrigerant to water heat exchangers shall be stainless steel brazed plate, rated to withstand 650 PSIG [4481 kPa] working refrigerant and water pressure.

Refrigerant metering shall be accomplished by thermostatic expansion valve only. Expansion valves shall be dual port balanced types with external equalizer for optimum refrigerant metering. Units shall be designed and tested for operating ranges of entering water temperatures from 20° to 120°F. Reversing valve shall be four-way solenoid activated refrigerant valve, which shall default to heating mode should the solenoid fail to function.

Water Circuit

Both load and source circuit shall have internal factory installed and wired flow switch. Strainers (20 mesh) for both load and source shall be included for field installation. All water tubing and brazed plate heat exchangers shall be insulated to prevent condensation at low liquid temperatures.

Water Connections

For 036 and 060 size units, supply and return water connections (and optional HWG connections) shall be of gasketed brass swivel union type and provide a working pressure rating to 450 psi [3101 kPa]. For 120 units, copper threaded fittings are mechanically fastened to the cabinet, eliminating the need to use a back-up wrench when making field piping connections. The threaded copper adaptors shall be low-temperature soldered to prevent misshaping or weakening of the fitting, eliminating potential start-up piping leaks. All water piping shall be insulated to prevent condensation at low liquid temperatures.

Accessories & Options

Hot Water Generator

An optional heat reclaiming desuperheater coil of vented double-wall construction suitable for potable water shall be provided. The coil and hot water circulating pump shall be factory mounted inside the unit. A high limit and low compressor discharge line temperature switch shall be provided to disable the pump when these conditions occur.

Flow Controller (field installed)

A self-contained module shall provide all fluid pumping, fill and connection requirements for ground-source closed-loop systems up to 20 GPM. The Flow Controller shall provide 1" pump isolation valves and 3-way service valves. Pump heads shall be removable from the volute for easy replacement. The Flow Controller shall be enclosed in a polystyrene case and fully insulated with urethane foam to prevent condensation. The Flow Controller shall have a 5- year warranty on all parts.

Hose Connection Kit (field installed)

An accessory hose kit shall provide 150psi 1" rubber hose with brass fittings equipped with service pressure/temperature ports for connection between the unit and Flow Controller.

Notes

Notes

Revision History

Date	Page #	Description
January 4, 2016	8-19	Included WPD adder to performance data pages and edited strainer table
November 20, 2015	All	First Published



RP962

Due to ongoing product improvements, specifications and dimensions are subject to change and correction without notice or incurring obligations. Determining the application and suitability for use of any product is the responsibility of the installer. Additionally, the installer is responsible for verifying dimensional data on the actual product prior to beginning any installation preparations.

Incentive and rebate programs have precise requirements as to product performance and certification. All products meet applicable regulations in effect on date of manufacture; however, certifications are not necessarily granted for the life of a product. Therefore, it is the responsibility of the applicant to determine whether a specific model qualifies for these incentive/rebate programs.

Comfort-Aire[®] *Century*[®]

1900 Wellworth Ave., Jackson, MI 49203 • Ph. 517-787-2100 • www.comfort-aire.com • www.century-hvac.com



www.marsdelivers.com • www.heatcontroller.com