

Hazardous Location Equipment - United States



Equipment listed in this category for Hazardous (Classified) Locations is also suitable for installations in areas that are unclassified locations and, unless referenced in the listing to another part of the Approval Guide, has been examined only for its hazardous location suitability

The equipment is listed alphabetically, by manufacturer.

Installation and maintenance of equipment listed in this category shall be according to the National Electrical Code[®] (NEC) or other applicable code. Two different Hazardous Location rating systems are defined by Articles 500 and 505 of the National Electrical Code[®]. The following are explanations of the two systems:

Hazardous Location Coding System - NEC 500.

Class I / II / III, Division 1 / 2

Type of Protection		
XP	=	Explosionproof
IS	=	Intrinsically Safe Apparatus
AIS	=	Associated Apparatus with Intrinsically Safe Connections
ANI	=	Associated Nonincendive Field Wiring Circuit
PX,PY,PZ	=	Pressurized
APX,APY,APZ	=	Associated Pressurization Systems/Components
NI	=	Nonincendive apparatus and nonincendive field wiring apparatus
DIP	=	Dust-Ignitionproof
S	=	Special Protection
<i>Equipment utilizing more than one type of protection is shown by joining the applicable types of protection with hyphens, see Example 2.</i>		
Class		
I	=	Class I
II	=	Class II
III	=	Class III
Division		
1	=	Division 1
2	=	Division 2

Group		
A	=	Group A
B	=	Group B
C	=	Group C
D	=	Group D
<i>The chemical formula of a specific gas or vapor for which the apparatus is Approved may be shown alone or concatenated with an apparatus group.</i>		
E	=	Group E
F	=	Group F
G	=	Group G

Temperature Class		
T1	=	T1 (450°C)
T2	=	T2 (300°C)
T2A	=	T2A (280°C)
T2B	=	T2B (260°C)
T2C	=	T2C (230°C)
T2D	=	T2D (215°C)
T3	=	T3 (200°C)
T3A	=	T3A (180°C)
T3B	=	T3B (165°C)
T3C	=	T3C (160°C)
T4	=	T4 (135°C)
T4A	=	T4A (120°C)
T5	=	T5 (100°C)
T6	=	T6 (85°C)
XXX°C	=	XXX°C

The temperature class is based on a 40°C ambient unless a higher ambient is shown, e.g. "T4 Ta = 60°C".

A temperature class is not shown for associated apparatus designed to be located in an unclassified location.

Control Documentation

When critical details for the installation are specified in a control drawing, instruction manual, installation diagram, etc. - the document number will be specified.

Entity

Intrinsically Safe apparatus Approved under the Entity concept shows the word "Entity" and may include the entity parameters in the Listing.

FISCO

Intrinsically Safe apparatus Approved under the Fieldbus Intrinsically Safe Concept shows the word "FISCO" and may include the FISCO parameters in the Listing.

Nonincendive Field Wiring

Apparatus Approved under the Nonincendive Field Wiring concept shows the word "NIFW" and may include the nonincendive field wiring parameters in the listing.

FNICO

Nonincendive apparatus Approved under the Fieldbus Nonincendive Concept shows the word "FNICO" and may include the FNICO parameters in the Listing.


Enclosure Type

Enclosure type/ingress protection designation per ANSI/NEMA 250 and/or IEC 60529.

Special Conditions of Use

Some products, typically components, include *Special Conditions of Use* that must be observed when installing and using the product. The conditions are shown following each applicable Listing.

APPROVAL DESIGNATION

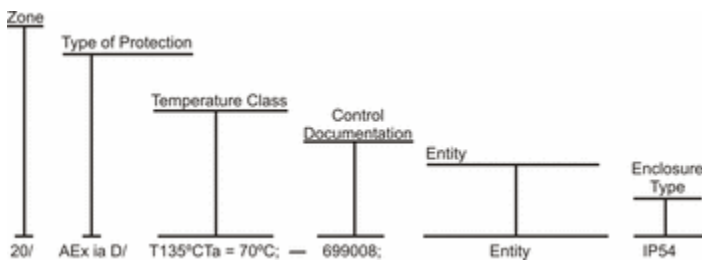

Example 1	123-abc. Temperature Transmitter.
	IS / I,II / 1 / CDEFG / T4 - 699007; Entity; Type 4X
	Entity Parameters: $V_{oc} = 18.4 \text{ V}$, $I_{sc} = 33 \text{ mA}$, $C_a = 0.9 \mu\text{F}$, $L_a = 110 \text{ mH}$
Example 2	456-def. Temperature Transmitter.
	XP-AIS / I / 1 / CD / T4 - 699008; Type 4X, IP66
	XP-AIS / I / 1 / IIB / T4 - 699008; Type 4X, IP66

Example 3	789-ghi. Temperature Transmitter.
	AIS / I,II,III / 1 / CDEFG - 699008; Type 12
Example 4	a1b34-c Temperature Transmitter
	NI / I / 2 / ABCD / T4 - 98123; NIFW; Type 4X
	Nonincendive Field Wiring Parameters: $V_{oc} = 24 \text{ V}$ $C_a = 650 \text{ nF}$

Hazardous Location Coding System - NEC 505.

Class I, Zone 0 / 1 / 2

Class		
I	=	Class I
[I]	=	Located in an unclassified nonhazardous location with connections for Class I
Zone		
0	=	Zone 0
1	=	Zone 1
2	=	Zone 2
[0/1/2]	=	Located in an unclassified nonhazardous location with connections for Zone 0/1/2
Explosion Protection		
AEx	=	Explosion Protected for North America

"Division" apparatus with supplemental "Zone" marking as permitted by Section 505-9 (c) (1) of the NEC does NOT show the "AEx" designation, see Example 2.

Type of Protection		
d	=	Flameproof
e	=	Increased safety
ia	=	Intrinsic safety (Zone 0)
ib	=	Intrinsic safety (Zone 1)

[ia]	=	Associated apparatus with I.S. connections for Zone 0
[ib]	=	Associated apparatus with I.S. connections for Zone 1
m	=	Encapsulation
nA	=	Non-sparking apparatus
nC	=	Protected contacts
nR	=	Restricted breathing
o	=	Oil immersion
p	=	Pressurization
q	=	Powder filled

Equipment utilizing more than one type of protection is shown by adjacent codes for types of protection, see Examples 5 and 6.

"Division" apparatus with supplemental "Zone" marking as permitted by Section 505.9 (c) (2) of the NEC does NOT show an AEx "Type of Protection" designation, but does show the same "Type of Protection" prefix as the "Division" apparatus, see Example 2.

Group		
IIA	=	Group IIA
IIB	=	Group IIB
		<i>Apparatus marked with Group IIB is also suitable for use in Group IIA.</i>
IIC	=	Group IIC
		<i>Apparatus marked with Group IIC is also suitable for use in Group IIB or IIA.</i>

The chemical formula of a specific gas or vapor for which the apparatus is Approved may be shown alone or concatenated with an apparatus group - e.g. "H₂" or "IIB + H₂", see Example 6.

Temperature Class		
T1	=	T1 (450°C)
T2	=	T2 (300°C)
T3	=	T3 (200°C)
T4	=	T4 (135°C)
T5	=	T5 (100°C)
T6	=	T6 (85°C)
XXX°C	=	XXX°C

The temperature class is based on a 40°C ambient unless a higher ambient is shown, e.g. "T4 Ta = 60°C".

A temperature class is not shown for associated apparatus designed to be located in an unclassified location.

Control Documentation

When critical details for the installation are specified in a control drawing, instruction manual, installation diagram, etc - the document number will be specified.

Entity

Intrinsically Safe apparatus Approved under the Entity concept shows the word "Entity" and may include the entity parameters in the Listing.

FISCO

Intrinsically Safe apparatus Approved under the Fieldbus Intrinsically Safe Concept shows the word "FISCO" and may include the FISCO parameters in the Listing.

FNICO

Nonincendive apparatus Approved under the Fieldbus Nonincendive Concept shows the word "FNICO" and may include the FNICO parameters in the Listing.


Enclosure Type

Enclosure type / ingress protection designation per ANSI/NEMA 250 and/or IEC 60529.

Special Conditions of Use

Some products, typically components, include *Special Conditions of Use* that must be observed when installing and using the product. The conditions are shown following each applicable Listing.

APPROVAL DESIGNATION

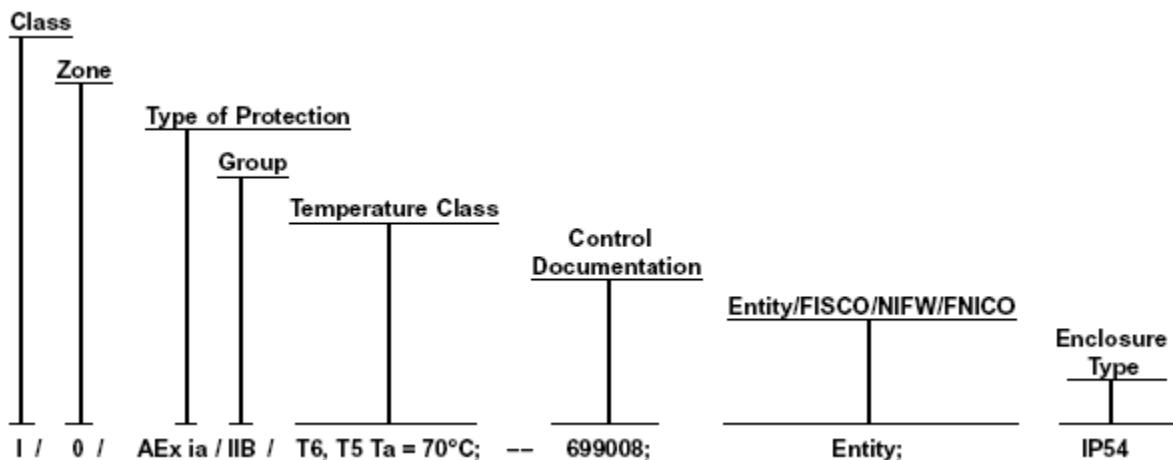

Example 5	123-abc. Temperature Transmitter.
	I / 0 / AEx ia / IIB / T4 - 699007; Entity; FISCO; Type 4X
	Entity Parameters: $V_{oc} = 18.4 \text{ V}$, $I_{sc} = 33 \text{ mA}$, $C_a = 0.9 \text{ }\mu\text{F}$, $L_a = 110 \text{ mH}$
	FISCO Parameters: $V_{max} = 17.5 \text{ V}$, $I_{max} = 380 \text{ mA}$, $P_i = 5.32 \text{ W}$, $C_i = 2,2 \text{ nF}$, $L_i = 7 \text{ }\mu\text{H}$
Example 6	456-def. Temperature Transmitter.
	I / 1 / AEx d [ia] / IIB / T4 - 699008; Type 4X, IP66
Example 7	789-ghi. Temperature Transmitter.
	I / 1 / AEx de / IIB / + H ₂ /T6; IP54
Example 8	1001-abc. Temperature Transmitter.
	[I/0] AEx [ia] / IIB - 699008; Type 12

Hazardous Location Coding System - NEC 506.

Zone 20 / 21 / 22

Zone		
20	=	Zone 20
21	=	Zone 21
22	=	Zone 22
[20/21/22]	=	Located in an unclassified (nonhazardous) location with connections for Zone 20/21/22
Explosion Protection		
AEx	=	Explosion Protected for North America
Type of Protection		
iaD	=	Intrinsic safety (Zone 20)
ibD	=	Intrinsic safety (Zone 21)
ia	=	Intrinsic safety (Zone 20)
ib		Intrinsic safety (Zone 21)
ic		Intrinsic safety (Zone 22)

[iaD]	=	Associated apparatus with I.S. connections for Zone 20
[ibD]	=	Associated apparatus with I.S. connections for Zone 21
[ia]	=	Associated apparatus with I.S. connections for Zone 20
[ib]	=	Associated apparatus with I.S. connections for Zone 21
[ic]	=	Associated apparatus with I.S. connections for Zone 22
maD	=	Encapsulation (Zone 20)
mbD	=	Encapsulation (Zone 21)
ma	=	Encapsulation (Zone 20)
mb	=	Encapsulation (Zone 21)
pD	=	Pressurization
tD	=	Protection by enclosure
ta	=	Protection by enclosure (Zone 20)
tb	=	Protection by enclosure (Zone 21)
tc	=	Protection by enclosure (Zone 22)

Equipment utilizing more than one type of protection is shown by adjacent codes for types of protection, see Examples 10 and 11.

Group		
IIIA	=	Group IIIA
IIIB	=	Group IIIB
		<i>Apparatus marked with Group IIIB is also suitable for use in Group IIIA.</i>
IIIC	=	Group IIIC
		<i>Apparatus marked with Group IIIC is also suitable for use in Group IIIB or IIIA.</i>

Temperature Class		
TXXX°C	=	XXX°C (Maximum surface temperature in degrees Celsius)

The temperature class is based on a 40°C ambient unless a higher ambient is shown, e.g. "T135°C Ta = 60°C".

A temperature class is not shown for associated apparatus designed to be located in an unclassified location.

When critical details for the installation are specified in a control drawing, instruction manual, installation diagram, etc - the document number will be specified.

Entity

Intrinsically Safe apparatus Approved under the Entity concept shows the word "Entity" and may include the entity parameters in the Listing.



Enclosure Type

Enclosure type / ingress protection designation per ANSI/NEMA 250 and/or IEC 60529.

Special Conditions of Use

Some products, typically components, include Special Conditions of Use that must be observed when installing and using the product. The conditions are shown following each applicable Listing.

APPROVAL DESIGNATION

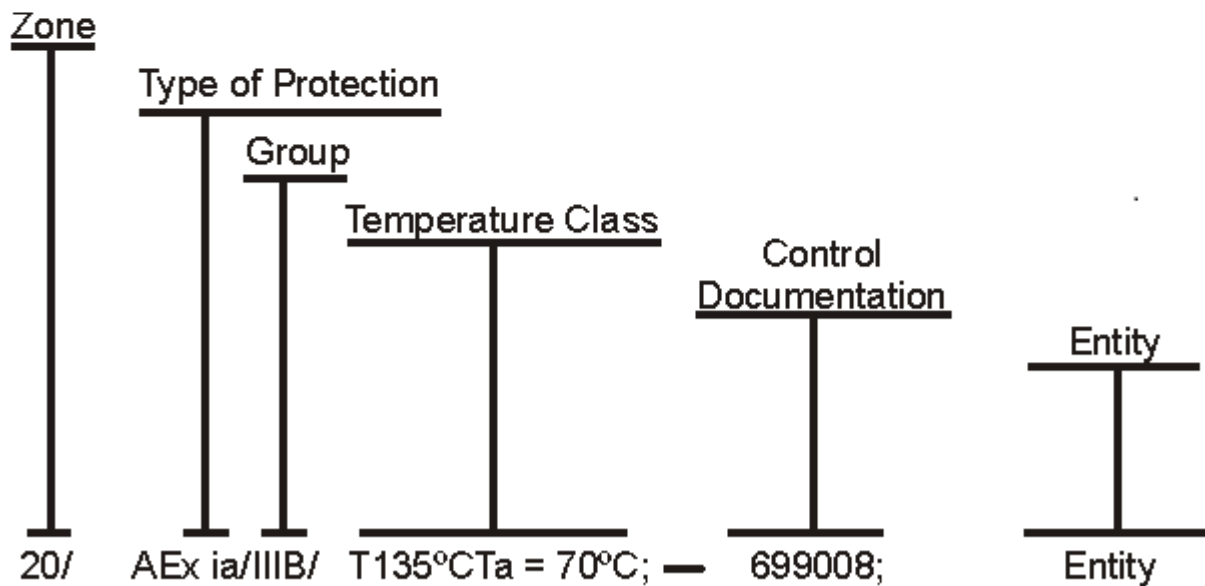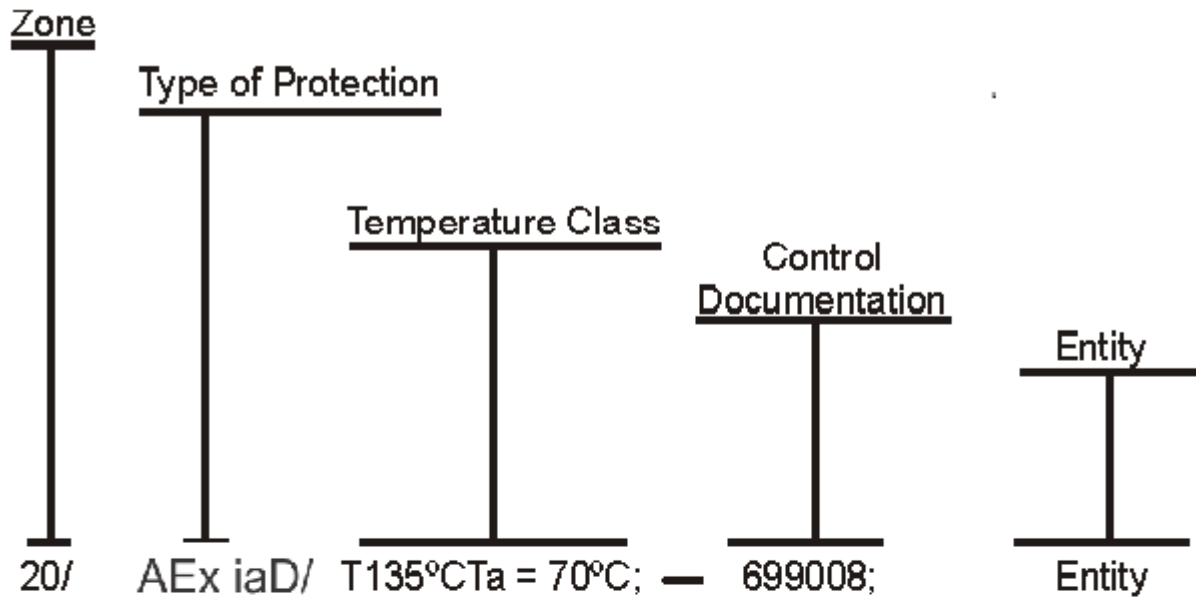

Example 9	123-abc. Temperature Transmitter.
	20 / AEx iaD / T135°C - 699007; Entity; Type 4X
	20 / AEx iaD / IIC / T135°C - 699007; Entity; Type 4X
	Entity Parameters: $V_{max} = 17.5 \text{ V}$, $I_{max} = 380 \text{ mA}$, $P_i = 5.32 \text{ W}$, $C_i = 2,2 \text{ nF}$, $L_i = 7 \text{ }\mu\text{H}$

Example 10	456-def. Temperature Transmitter.
	21 / AEx tD [iaD] / T135°C - 699008; Type 4X, IP66
	21 / AEx tb [ia] / IIIB / T135°C - 699008; Type 4X, IP66
Example 11	789-ghi. Temperature Transmitter.
	21 / AEx tD mbD / T85°C; IP54
	21 / AEx tb mb / IIIB / T85°C; IP54
Example 12	1001-abc. Temperature Transmitter.
	[20] AEx [iaD] - 699008; Type 12
	[20] AEx [ia] / IIIC - 699008; Type 12

Class I, Division 1, Groups A, B, C & D

Class I, Division 1 locations are those in which hazardous concentrations of flammable gases or vapors exist continuously, intermittently or periodically under normal operating conditions. Electrical equipment for use in such locations may be "explosionproof," "intrinsically safe," "purged" or otherwise protected to meet the intent of Articles 500 of the National Electrical Code®.

Explosionproof protection consists of equipment designed to be capable of containing an internal explosion of a specified flammable vapor-air mixture. In addition, the equipment must operate at a safe temperature with respect to the surrounding atmosphere.

Intrinsically safe electrical equipment and associated wiring are incapable of releasing sufficient electrical or thermal energy to cause ignition of a specific hazardous material under "normal" or "fault" operating conditions. Normal operation assumes maximum supply voltage and rated environmental extremes; fault conditions assume any single or dual independent electrical faults plus field wiring open, shorts or connections to ground. Equipment rated as intrinsically safe is recognized by Article 500 as safe for use in hazardous locations without special enclosures or physical protection that would otherwise be required.

Purged systems have fresh air or an inert gas under positive pressure to exclude ignitable quantities of flammables from the electrical equipment enclosure.

Equipment Approved for Division 1 locations shall be permitted in Division 2 locations of the same class, group and temperature class and shall comply with (a) or (b) as applicable.

(a) Intrinsically safe apparatus having a control drawing requiring the installation of associated apparatus for a Division 1 installation shall be permitted to be installed in a Division 2 location if the same associated apparatus is used for Division 2.

(b) Equipment that is required to be explosionproof shall incorporate explosionproof conduit or cable seals when Division 2 wiring methods are employed.

Class I, Division 2, Groups A, B, C & D

Class I, Division 2 locations are those in which hazardous concentrations of flammables exist only under unlikely conditions of operation. As such, equipment and associated wiring which are incapable of releasing sufficient electrical and thermal energy to ignite flammable gases or vapors under "normal" operation and environmental conditions are safe to use in Class I, Division 2 locations.

Class I, Zone 0, Groups IIC, IIB & IIA

A Class I, Zone 0 location is a location (1) in which ignitable concentrations of flammable gases or vapors are present continuously; or (2) in which ignitable concentrations of flammable gases or vapors are present for long periods of time. Electrical apparatus for use in such locations may be type of protection "ia" Intrinsic Safety.

Class I, Zone 1, Groups IIC, IIB & IIA

A Class I, Zone 1 location is a location (1) in which ignitable concentrations of flammable gases or vapors are likely to exist under normal operating conditions; or (2) in which ignitable concentrations of flammable gases or vapors may exist frequently because of repair or maintenance operations or because of leakage; or (3) in which equipment is operated or processes are carried on, of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of flammable gases or vapors and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition; or (4) that is adjacent to a Class I, Zone 0 location from which ignitable concentrations of vapors could be communicated, unless communication is prevented by adequate positive-pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided. Electrical apparatus for use in such locations may be type of protection "d" Flameproof, "e" Increased Safety, "ib" Intrinsic Safety, "m" Encapsulation, "o" Oil Immersion, "p" Pressurized or "q" Powder-Filled.

Note: Electrical apparatus Approved for use in Class I, Zone 0 locations shall be permitted in Class I, Zone 1 locations of the same gas group and temperature class.

Class I, Zone 2, Groups IIC, IIB & IIA

A Class I, Zone 2 location is a location (1) in which ignitable concentrations of flammable gases or vapors are not likely to occur in normal operation and if they do occur will exist only for a short period; or (2) in which volatile flammable liquids, flammable gases or flammable vapors are handled, processed or used, but in which the liquids, gases or vapors normally are confined within closed containers or closed systems from which they can escape only as a result of accidental rupture or breakdown of the containers or system or as the result of the abnormal operation of the equipment with which the liquids or gases are handled, processed or used; or (3) in which ignitable concentrations of flammable gases or vapors normally are prevented by positive mechanical ventilation, but which may become hazardous as the result of failure or abnormal operation of the ventilation equipment; or (4) that is adjacent to a Class I, Zone 1 location, from which ignitable concentrations of flammable gases or vapors could be communicated, unless such communication is prevented by adequate positive-pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided. Electrical apparatus for use in such locations may be type of protection "nA" Non-Sparking, "nC" Protected contacts, "nR" Restricted Breathing or "p" Pressurized.

Note: Electrical apparatus Approved for use in Class I, Zone 0 or Zone 1 locations shall be permitted in Class I, Zone 2 locations of the same gas group and temperature class.

Zone 20 (Groups IIIC, IIIB & IIIA)

A Zone 20 location is a location (1) in which ignitable concentrations of combustible dust or ignitable fibers/flyings are present continuously; or (2) in which ignitable concentrations of combustible dust or ignitable fibers/flyings are present for long periods of time.

Electrical apparatus for use in such locations may be types of protection Intrinsic Safety "iaD" or encapsulation "maD". Equipment Approved for Zone 20, Group III locations may be types of protection Intrinsic Safety "ia", encapsulation "ma", or Protection by Enclosure "ta".

Zone 21 (Groups IIIC, IIIB & IIIA)

A Zone 21 location is a location (1) in which ignitable concentrations of combustible dust or ignitable fibers/flyings are likely to exist occasionally under normal operating conditions; or (2) in which ignitable concentrations of combustible dust or ignitable fibers/flyings may exist frequently because of repair or maintenance operations or because of leakage; or (3) in which equipment is operated or processes are carried on, of such a nature that equipment breakdown or faulty operations could result in the release of ignitable concentrations of combustible dust or ignitable fibers/flyings and also cause simultaneous failure of electrical equipment in a mode to cause the electrical equipment to become a source of ignition; or (4) that is adjacent to a Zone 20 location from which ignitable concentrations of dust or ignitable fibers/flyings could be communicated, unless communication is prevented by adequate positive pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

Electrical apparatus for use in such locations may be types of protection Intrinsic Safety "iaD", Intrinsic Safety "ibD", Encapsulation "maD", Encapsulation "mbD", Pressurization "pD", or Protection by Enclosure "tD". Equipment Approved for Zone 21, Group III locations may be types of protection Intrinsic Safety "ia", Intrinsic Safety "ib", Encapsulation "ma", Encapsulation "mb", Pressurization "p", Protection by Enclosure "ta", or Protection by Enclosure "tb".

Note: Electrical apparatus Approved for use in Zone 20 locations shall be permitted in Zone 21 locations of the same group and temperature classification.

Zone 22 (Groups IIIC, IIIB & IIIA)

A Zone 22 location is a location (1) in which ignitable concentrations of combustible dust or ignitable fibers/flyings are not likely to occur in normal operation and, if they do occur, will only persist for a short period; or (2) in which combustible dust or fibers/flyings are handled, processed, or used but in which the dust or fibers/flyings are normally confined within closed containers of closed systems from which they can escape only as a result of the abnormal operation of the equipment with which the dust or fibers/flyings are handled, processed, or used; or (3) that is adjacent to a Zone 21 location, from which ignitable concentrations of dust or fibers/flyings could be communicated, unless such communication is prevented by adequate positive pressure ventilation from a source of clean air and effective safeguards against ventilation failure are provided.

Electrical apparatus for use in such locations may be types of protection Intrinsic Safety "iaD", Intrinsic Safety "ibD", Encapsulation "maD", Encapsulation "mbD", Pressurization "pD", or Protection by Enclosure "tD". Equipment Approved for Zone 22, Group III locations may be types of protection Intrinsic Safety "ia", Intrinsic Safety "ib", Encapsulation "ma", Encapsulation "mb", Pressurization "p", Protection by Enclosure "ta", Protection by Enclosure "tb", or Protection by Enclosure "tc".

Note: Electrical apparatus Approved for use in Zone 20 or Zone 21 locations shall be permitted in Zone 22 locations of the same group and temperature classification.

Class II, Divisions 1 & 2, Groups E, F & G

Electrical equipment suitable for use in Class II locations, as defined by the National Electrical Code[®], is constructed to exclude ignitable amounts of dust from the equipment enclosure. Approved equipment of this type has also been evaluated to assure that hazardous surface temperatures do not exist. Equipment listed as suitable for Class II locations is "dust-ignitionproof" or otherwise designed to meet the intent of Articles 500 and 502 of the National Electrical Code[®].

Class III, Divisions 1 & 2

Class III locations are those which are hazardous because of the presence of ignitable fibers or flyings. Equipment listed for installation in Class III locations is designed to exclude the fibers and flyings from the equipment enclosure and to function without developing excessive surface temperatures.

Entity Concept

Under entity requirements, the concept allows interconnection of intrinsically safe apparatus to associated apparatus, not specifically examined in such combination. The criteria for interconnection is that the maximum input voltage and current, which intrinsically safe apparatus can receive and remain intrinsically safe, considering faults, must be equal to or greater than the maximum output voltage and current levels which can be delivered by the associated apparatus, considering faults and applicable factors. In addition, the maximum internal capacitance and inductance of the intrinsically safe apparatus, including interconnecting wiring, must be less than or equal to the maximum allowed capacitance and inductance which can be safely connected to the associated apparatus. If these criteria are met, then the combination may be connected and remain intrinsically safe.

FM Approvals defines the entity parameters as follows:

<i>Electrical Parameter</i>	<i>"Division"</i>	<i>"Zone"</i>
	<i>Apparatus (Traditional US format)</i>	<i>Apparatus (IEC format)</i>
<i>For Associated Apparatus</i>		
Maximum output voltage	V_{oc}	U_o
Maximum output voltage - Multiple Channel Apparatus	V_t	U_o
Maximum output current	I_{sc}	I_o
Maximum output current - Multiple Channel Apparatus	I_t	I_o
Maximum allowed capacitance	C_a	C_o
Maximum allowed inductance	L_a	L_o
Maximum output power	P_o	P_o
External inductance-to-resistance ratio	L_a / R_a	L_o / R_o
<i>For Intrinsically safe apparatus</i>		
Maximum input voltage	V_{max}	U_i
Maximum input current	I_{max}	I_i
Maximum internal capacitance	C_i	C_i
Maximum internal inductance	L_i	L_i
Maximum input power	P_i	P_i
Internal inductance-to-resistance ratio	L_i / R_i	L_i / R_i

FISCO Concept

Under the FISCO concept the interconnection of Fieldbus Intrinsically Safe Apparatus to Associated Apparatus not specifically examined in such combination is allowed. The FISCO concept eliminates the need to calculate the cable parameters of the circuit. This is an alternative to the Entity Concept.

FNICO Concept

Under the FNICO concept the interconnection of Fieldbus Nonincendive Apparatus to Associated Apparatus not specifically examined in such combination is allowed. The FNICO concept eliminates the need to calculate the cable parameters of the circuit. This is an alternative to Nonincendive Field Wiring. Apparatus Approved under this concept allows the installer to use wiring methods permitted for unclassified locations.

Nonincendive Field Wiring

Under the Nonincendive Field wiring concept, normal operation includes opening, shorting and grounding the field wiring. Apparatus Approved under this concept allows the installer to use wiring methods permitted for unclassified locations.

Enclosure Types

I. The following enclosure types are defined by ANSI/NEMA 250, *Enclosures for Electrical Equipment*.

Type 1 - Enclosures constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment and to provide a degree of protection against falling dirt.

Type 2 - Enclosures constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment, to provide a degree of protection against falling dirt and to provide a degree of protection against dripping and light splashing of liquids.

Type 3 - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt, rain, sleet, snow and windblown dust; and that will be undamaged by the external formation of ice on the enclosure.

Type 3R - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt, rain, sleet and snow; and that will be undamaged by the external formation of ice on the enclosure.

Type 3S - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt, rain, sleet, snow and windblown dust; and in which the external mechanism(s) remain operable when ice laden.

Type 4 - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt, rain, sleet, snow, windblown dust, splashing water and hose-directed water; and that will be undamaged by the external formation of ice on the enclosure.

Type 4X - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt, rain, sleet, snow, windblown dust, splashing water, hose-directed water and corrosion; and that will be undamaged by the external formation of ice on the enclosure.

Type 5 - Enclosures constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against settling airborne dust, lint, fibers and flyings; and to provide a degree of protection against dripping and light splashing of liquids.

Type 6 - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against hose-directed water and the entry of water during occasional temporary submersion at a limited depth; and that will be undamaged by the external formation of ice on the enclosure.

Type 6P - Enclosures constructed for either indoor or outdoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against hose-directed water and the entry of water during prolonged submersion at a limited depth; and that will be undamaged by the external formation of ice on the enclosure.

Type 12 - Enclosures constructed (without knockouts) for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against circulating dust, lint, fibers and flyings; and against dripping and light splashing of liquids.

Type 12K - Enclosures constructed (with knockouts) for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against circulating dust, lint, fibers and flyings; and against dripping and light splashing of liquids.

Type 13 - Enclosures constructed for indoor use to provide a degree of protection to personnel against incidental contact with the enclosed equipment; to provide a degree of protection against falling dirt; against circulating dust, lint, fibers and flyings; and against the spraying, splashing and seepage of water, oil and noncorrosive coolants.

II. The following "Ingress Protection" designations for enclosures are defined by IEC 60529, *Degrees of Protection Provided by Enclosures*.

The ingress protection (IP) of an enclosure is designated by the letters "IP" followed by two arabic numerals.

First numeral (protection against solid bodies):

X	=	Protection not assessed
0	=	No protection.
1	=	Objects greater than 50 mm.
2	=	Objects greater than 12 mm.
3	=	Objects greater than 2.5 mm.
4	=	Objects greater than 1 mm.
5	=	Dust-protected.
6	=	Dust-tight.

Second numeral (protection against liquid):

X	=	Protection not assessed
0	=	No protection
1	=	Vertically dripping water.
2	=	75° to 90° dripping water.
3	=	Sprayed water.
4	=	Splashed water.
5	=	Water jets.
6	=	Heavy seas.
7	=	Effects of immersion.
8	=	Indefinite immersion.

...

Input/Output (I/O)

ET 200S System

Modules for the ET200S System.

NI / 1 / 2 / ABCD / T*

NI / 1 / 2 / IIC / T**

Model No.	Description	T-Code*	T-Code**	Tambient
6ES7 131-1BH01-a	Digital Input, 16 Channels	T4A	T4	60°C
6ES7 131-1BH12-a	Digital Input, 16 Channels	T4A	T4	60°C
6ES7 131-1BL01-a	Digital Input, 32 Channels	T4A	T4	60°C
6ES7 131-1BL12-a	Digital Input, 32 Channels	T4A	T4	60°C
6ES7 131-4BB00-a	2 Digital Input DC 24V	T4A	T4	60°C
6ES7 131-4BB01-a	2 DI DC 24V HF	T4A	T4	60°C
6ES7 131-4BD00-a	Digital Input 24 V dc	T4A	T4	60°C
6ES7 131-4BD01-a	4 DI DC 24V HF	T4A	T4	60°C
6ES7 131-4BD01-a	Digital Input 24 V dc	T4A	T4	60°C
6ES7 131-4BD51-a	4DI Source Input	T4A	T4	60°C
6ES7 131-4BF00-a	8DI DC24V HD	T4	T4	60°C
6ES7 131-4BF50-a	8 DI DC 24V Source Input	T4	T4	60°C
6ES7 131-4CD00-a	4DI, 24/48 V ac	T4	T4	60°C
6ES7 131-4CD02-a	4DI UC24...48V	T4	T4	60°C
6ES7 131-4RD02-a	4 DI NAMUR	T4	T4	60°C
6ES7 131-4EB00-a	Electronics Module - 2 Point Input 120 V ac	T4	T4	60°C
6ES7 131-4FB00-a	Electronics Module - 2 Point Input 230 V ac	T4	T4	60°C
6ES7 131-4RD00-a	ETS200S 2DO 4DI NAMUR Digital Electronic Module	T4	T4	60°C
6ES7 132-4BB00-a	Digital Output Module, 24V/0.5A	T4A	T4	60°C
6ES7 132-4BB01-a	Digital Output Module 24 V/0.5 A	T4A	T4	60°C
6ES7 132-4BB30-a	Digital Output Module, 24V/2A	T4A	T4	60°C
6ES7 132-4BB31-a	Digital Output, 24 V dc	T4	T4	60°C
6ES7 132-4BD00-a	4DO DC24V / 0.5A High Feature	T4	T4	60°C
6ES7 132-4BD01-a	Digital Output Module 24 V/0.5 A	T4A	T4	60°C
6ES7 132-4BD02-a	4 DO 24DC/0.5A	T4A	T4	60°C
6ES7 132-4BD30-a	4DO DC24V / 2A High Feature	T4	T4	60°C
6ES7 132-4BD31-a	Digital Output Module 24 V/2 A	T4	T4	60°C
6ES7 132-4BD32-a	4DO DC24V/2A	T4	T4	60°C

<i>Model No.</i>	<i>Description</i>	<i>T-Code*</i>	<i>T-Code**</i>	<i>Tambient</i>
6ES7 132-4BD50-a	4 DO DC24V / 0,5A HD	T4	T4	60°C
6ES7 132-4BF00-a	8 DO DC 24V/0.5A HF	T4	T4	60°C
6ES7 132-4BF50-a	8 DO DC 24V/0.5A Sink Output	T4	T4	60°C
6ES7 132-4FB00-a	Electronics Module – 2 Point Output 120/230Vac	T4	T4	60°C
6ES7 132-4FB01-a	2 DO AC 24...230V	T4	T4	60°C
6ES7 132-4HB00-a	Digital Output Module, 24...230V/5A	T4A	T4	60°C
6ES7 132-4HB01-a	Digital Output Module, 24-230 V/5 A output	T4A	T4	60°C
6ES7 132-4HB10-a	2DO, Relay	T4	T4	60°C
6ES7 132-4HB12-a	2 RO NO/NC 24-48VDC/5A, 24-230VDC/5A	T4	T4	60°C
6ES7 132-4HB50-a	2RO NO/NC	T4	T4	60°C
6ES7 133-1BL01-a	Digital Input/Output, 16 Channels	T4	T4	60°C
6ES7 133-1BL11-a	Digital Input/Output, 16 + 16	T4A	T4	60°C
6ES7 134-4FB00-a	Analogue Input Module (Voltage)	T4A	T4	60°C
6ES7 134-4FB01-a	2 AI U ST	T4A	T4	60°C
6ES7 134-4FB50-a	Analog Input, high speed, voltage	T4A	T4	60°C
6ES7 134-4FB51-a	ET200S, 2AI U	T4	T4	60°C
6ES7 134-4FB52-a	2 AI I U HS	T4A	T4	60°C
6ES7 134-4GB00-a	Analog Input Module (2 Wire)	T4A	T4	60°C
6ES7 134-4GB01-a	Analog Input Module (2-wire)	T4A	T4	60°C
6ES7 134-4GB10-a	Analog Input Module (4 Wire)	T4A	T4	60°C
6ES7 134-4GB11-a	Analog Input Module (4-wire)	T4A	T4	60°C
6ES7 134-4GB50-a	Analog Input, high speed, current 2-wire	T4A	T4	60°C
6ES7 134-4GB51-a	2AI I, 2 Wire	T4	T4	60°C
6ES7 134-4GB52-a	2 AI I HS 2Wire	T4A	T4	60 °C
6ES7 134-4GB60-a	Analog Input, high speed, current 4-wire	T4A	T4	60°C
6ES7 134-4GB61-a	2AI I, 4 Wire	T4	T4	60°C
6ES7 134-4GB62-a	2 AI I HS 4Wire	T4A	T4	60 °C
6ES7 134-4JB00-a	Analog Input Module (TC)	T4A	T4	60°C
6ES7 134-4JB01-a	2AI TC Standard	T4A	T4	60 °C
6ES7 134-4JB50-a	Analog Input Module (RTD)	T4A	T4	60°C
6ES7 134-4JB51-a	2AI RTD Standard	T4A	T4	60 °C
6ES7 134-4JD00-a	4AI TC Standard	T4	T4	60 °C
6ES7 134-4LB00-a	Input, voltage	T4	T4	60°C
6ES7 134-4LB02-a	2AI U HF	T4	T4	60°C
6ES7 134-4MB00-a	Input, current	T4	T4	60°C
6ES7 134-4MB02-a	2 AI I 2Wire High Feature	T4A	T4	60 °C

<i>Model No.</i>	<i>Description</i>	<i>T-Code*</i>	<i>T-Code**</i>	<i>Tambient</i>
6ES7 134-4NB01-a	Analog Input Module (TC HF)	T5	T5	60°C
6ES7 134-4NB51-a	2 Analog Input Module (RTD high feature)	T5	T5	60°C
6ES7 135-4FB00-a	Analog Output Module (Voltage)	T4A	T4	60°C
6ES7 135-4FB01-a	Analogue Output Module (Voltage)	T4A	T4	60°C
6ES7 135-4FB52-a	2 AO U HS	T4A	T4	60°C
6ES7 135-4GB00-a	Analogue Output Module (Current)	T4A	T4	60°C
6ES7 135-4GB52-a	2 AO I HS	T4A	T4	60 °C
6ES7 135-4LB01-a	Analog Output Module	T4	T4	60°C
6ES7 135-4LB02-a	2AO U HF	T4	T4	60°C
6ES7 135-4MB01-a	Analog Output Module	T4	T4	60°C
6ES7 135-4MB02-a	2AO I HF	T4	T4	60°C
6ES7 138-4AA00-a	Reserve Module	T4A	T4	60°C
6ES7 138-4AA01-a	Reserve Module (15 mm)	T4A	T4	60°C
6ES7 138-4AA10-a	Power Module PM-E DC 24..48 V	T4	T4	60°C
6ES7 138-4AA11-a	Reserve Module (30 mm)	T4A	T4	60°C
6ES7 138-4CA00-a	Power Module	T4A	T4	60°C
6ES7 138-4CA01-a	Power Module PM-E DC 24 V	T4A	T4	60°C
6ES7 138-4CA50-a	PM-E DC..48V	T4	T4	60°C
6ES7 138-4CA60-a	PM-E DC24V High Feature	T4	T4	60°C
6ES7 138-4CA80-a	PM-E DC24V / 8A RO	T4	T4	60°C
6ES7 138-4CB10-a	Power Module	T4	T4	60°C
6ES7 138-4CB11-a	PM-E DC24V / AC120/230V	T4	T4	60 °C
6ES7 138-4CF01-a	PM-E-F DC24V PROFIsafe	T4A	T4	60°C
6ES7 138-4CF02-a	PM-E-F DC24V PROFIsafe	T4A	T4	60°C
6ES7 138-4CF03-a	PM-E-F DC24V PROFIsafe	T4A	T4	60°C
6ES7 138-4CF40-a	Power Module PM-E F	T4A	T4	60°C
6ES7 138-4CF41-a	Power Module PM-E F	T4A	T4	60°C
6ES7 138-4CF42-a	Power Module PM-E F	T4A	T4	60°C
6ES7 138-4DA01-a	Counter Module	T4	T4	60°C
6ES7 138-4DA02-a	Counter Module	T4	T4	60°C
6ES7 138-4DA03-a	Counter Module	T4	T4	60°C
6ES7 138-4DA032-a	Counter Module 5V/500kHz	T4	T4	60°C
6ES7 138-4DA04-a	Counter Module 5V/500kHz	T4	T4	60°C
6ES7 138-4DB00-a	SSI Module	T4A	T4	60°C
6ES7 138-4DB01-a	SSI Module	T4A	T4	60°C
6ES7 138-4DB03-a	ISSI Fast IO Module	T4A	T4	60°C

<i>Model No.</i>	<i>Description</i>	<i>T-Code*</i>	<i>T-Code**</i>	<i>Tambient</i>
6ES7 138-4DC00-a	Step Module	T4A	T4	60°C
6ES7 138-4DC01-a	Step Module	T4A	T4	60°C
6ES7 138-4DD00-a	Two Pulse Module	T4	T4	60°C
6ES7 138-4DD01-a	2-Pulse Module	T4	T4	60°C
6ES7 138-4DE01-a	Counter Module 5V/500kHz	T4	T4	60°C
6ES7 138-4DG00-a	1 Pos Inc/Digital	T4	T4	60°C
6ES7 138-4DH00-a	1 Pos SSI/Digital	T4	T4	60°C
6ES7 138-4DJ00-a	1 Pos Inc/Analog	T5	T5	60°C
6ES7 138-4DK00-a	1 Pos SSI/Analog	T5	T5	60°C
6ES7 138-4FA01-a	4/8 F-DI DC 24V PROFIsafe	T4A	T4	60°C
6ES7 138-4FA02-a	4/8 F-DI DC 24V PROFIsafe	T4A	T4	60°C
6ES7 138-4FA03-a	4/8 F-DI DC 24V PROFIsafe	T4A	T4	60°C
6ES7 138-4FA04-a	4/8 F-DI DC 24V PROFIsafe	T4A	T4	60°C
6ES7 138-4FB01-a	8 F-DO DC24/2A PROFIsafe	T4A	T4	60°C
6ES7 138-4FB02-a	8 F-DO DC24/2A PROFIsafe	T4A	T4	60°C
6ES7 138-4FB03-a	8 F-DO DC24/2A PROFIsafe	T4A	T4	60°C
6ES7 138-4FC00-a	4F-DI/3F-DO DC24V	T4	T4	60°C
6ES7 138-4FC01-a	4F-DI/3F-DO DC24V	T4	T4	60°C
6ES7 138-4FD00-a	4 POTDIS Module	T4	T4	60°C
6ES7 138-4FR00-a	1F-RO DC24V/AC 24...230V/5A	T4	T4	60°C
6ES7 138-4GA00-a	4 IQ-Sense	T4A	T4	60°C
6ES7 138-4GA50-a	4 SI IO – Link	T4	T4	60 °C
6ES7 138-4HA00-a	DP-Master	T4	T4	60°C
6ES7 141-1BF10-a	Digital Input, 8 Channels	T4A	T4	55°C
6ES7 142-1BD20-a	Digital Output, 4 Channels	T4A	T4	55°C
6ES7 151-1AA03-a	Interface Module IM 151-1	T4A	T4	60°C
6ES7 151-1AA04-a	IM 151-1 Standard	T4A	T4	60°C
6ES7 151-1AA05-a	IM151-1 Standard	T4A	T4	60°C
6ES7 151-1AB02-a	Interface Module IM 151 FO	T4A	T4	60°C
6ES7 151-1AB05-a	IM151-1 FO	T4	T4	60°C
6ES7 151-1BA00-a	Interface Module IM 151-1 w/Terminator	T5	T5	60°C
6ES7 151-1BA01-a	IM 151-1 (High Feature)	T5	T5	60°C
6ES7 151-1BA02-a	IM 151-1 (High Feature)	T5	T5	60°C
6ES7 151-1CA00-1a	IM 151-1 Compact 32DI	T4	T4	60°C
6ES7 151-1CA00-3a	IM 151-1 Compact 16DI/16DO	T4	T4	60°C
6ES7 151-1CA00-a	Interface Module IM 151-1 Basic	T5	T5	60°C

<i>Model No.</i>	<i>Description</i>	<i>T-Code*</i>	<i>T-Code**</i>	<i>Tambient</i>
6ES7 151-3AA00-a	Interface Module IM 151-3PN	T4A	T4	60°C
6ES7 151-3AA10-a	Interface Module IM 151-3PN	T4	T4	60°C
6ES7 151-3AA20-a	IM151-3PN Standard	T4	T4	60 °C
6ES7 151-3AA23-a	IM151-3 Standard	T4	T4	60 °C
6ES7 151-3BA00-a	Interface Module IM 151-3PN	T4	T4	60°C
6ES7 151-3BA20-a	IM151-3PN High Feature	T4	T4	60 °C
6ES7 151-3BA23-a	IM151-3 High Feature	T4	T4	60 °C
6ES7 151-3BA50-a	IM 151-3 Fast IO Interface Module	T4	T4	60°C
6ES7 151-3BA60-a	IM151-3 FastIO	T4	T4	60 °C
6ES7 151-3BB21-a	Interface Module, IM 151-3 PN FO	T4	T4	60°C
6ES7 151-3BB22-a	Interface Module IM 151-3 PN FO	T4	T4	60°C
6ES7 151-3BB23-a	Interface Module IM 151-3 PN FO	T4	T4	60°C
6ES7 151-7AA00-a	Interface Module, IM 151-1/CPU	T5	T5	60°C
6ES7 151-7AA11-a	Interface Module IMI 151-7/CPU Terminator	T4A	T4	60°C
6ES7 151-7AA13-a	Interface Module IMI 151-7/CPU Terminator	T4A	T4	60°C
6ES7 151-7AA20-a	Interface Module IMI 151-7/CPU Terminator	T4A	T5	60°C
6ES7 151-7AB00-a	Interface Module IM 151-1/CPU/FO	T4A	T4	60°C
6ES7 151-7FA01-a	Interface Module IM 151-7/F-CPU w/Terminator	T4A	T3	60°C
6ES7 151-7FA20-a	Interface Module IM 151-7/F-CPU w/Terminator	T4A	T4	60°C
6ES7 151-8AB00-a	IM151-8 PN/DP CPU	T4	T4	60 °C
6ES7 151-8AB01-a	IM151-8 PN/DP CPU	T4	T4	60 °C
6ES7 151-8FB00-a	IM151-8 F- CPU PN	T4	T4	60 °C
6ES7 151-8FB01-a	IM151-8 PN/DP F-CPU	T4	T4	60 °C
6ES7 153-1AA03-a	Supply and I/O Module	T4A	T4	60°C
6ES7 153-2AB03-a	Interface Module IM 153-2-FO	T5	T5	60°C
6ES7 153-2BA00-a	Interface Module IM 153-2-CU	T4A	T4	60°C
6ES7 153-2BB00-a	Interface Module IM 153-2-FO	T4A	T4	60°C
6ES7 157-0AA82-a	Interface Module	T5	T5	60°C
6ES7 157-0AE80-a	Interface Module	T5	T5	60°C
6ES7 158-3AD00-a	PN/PN IO-Coupler (Vertical Mounting)	T4	T4	60°C
6ES7 158-3AD01-a	PN/PN IO-Coupler	T4	T4	60°C
6ES7 193-4CA20-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CA30-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CA40-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CA50-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CB00-a	Terminal Module (Screw)	T4A	T4	60°C

<i>Model No.</i>	<i>Description</i>	<i>T-Code*</i>	<i>T-Code**</i>	<i>Tambient</i>
6ES7 193-4CB10-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CB20-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CB30-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CC20-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CC30-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CD20-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CD30-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CE00-a	Terminal Module (Screw)	T4A	T4	60°C
6ES7 193-4CE10-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CF40-a	Terminal Module, TM-E30S46-A1	N/A	N/A	N/A
6ES7 193-4CF50-a	Terminal Module, TM-E30C46-A1	N/A	N/A	N/A
6ES7 193-4CG03-a	Terminal Module	–	–	60°C
6ES7 193-4CG20-a	Terminal Module	–	–	60°C
6ES7 193-4CG30-a	Terminal Module (Snap)	T4A	T4	60°C
6ES7 193-4CK20-a	Terminal Module, TM-P30S44-A0	N/A	N/A	N/A
6ES7 193-4CK30-a	Terminal Module, TM-P30C44-A0	N/A	N/A	N/A
6ES7 193-4CL20-a	Terminal Module (screw type w/temp. sensor)	N/A	N/A	N/A
6ES7 193-4CL30-a	Terminal Module (snap type w/temp. sensor)	N/A	N/A	N/A
6ES7 193-4DL00-a	Terminal Module (snap type)	N/A	N/A	60°C
6ES7 193-4DL10-a	Terminal Module (screw type)	N/A	N/A	60°C
6ES7 193-4FL00-a	Terminal Module (snap type)	N/A	N/A	60°C
6ES7 193-4FL10-a	Terminal Module (screw type)	N/A	N/A	60°C
6ES7 193-4JA00-a	Terminal Module (Abschlußmod)	T4A	T4	60°C
6ES7 195-7HA00-a	Interconnect Module IM 153	T6	T6	60°C
6ES7 195-7HB00-a	Interconnect Module 40 mm	T6	T6	60°C
6ES7 195-7HC00-a	Interconnect Module 80 mm	T6	T6	60°C
6ES7 195-7HD00-a	Basic Module BM IM/IM	T4	T4	60°C
6ES7 195-7HD10-a	Basic Module BM IM/IM	T6	T6	60°C
6ES7 195-7HD80-a	Basic Module BM IM/IM	T6	T6	60°C
6ES7 197-1LB00-a	Y-Coupler	T5	T5	60°C
6ES7 654-0YK00-a	Y-Coupler Module	T5	T5	60°C
6ES7 654-0YS00-a	Y-IM Module	T5	T5	60°C
6ES7 654-7HY00-a	Interconnect Module	T5	T5	60°C
6GK1 500-0AA10	Profibus Busterminal 12M	T6	T6	60°C

a = Options not affecting safety, any 2 or 4 digit letter or number referring to non-electrical properties as product associates, language, delivery packing, documentation, etc.

Special Conditions of Use:

- 1. Shall be installed in compliance with the enclosure, mounting, spacing and segregation requirements of the ultimate application, including a tool removable cover.*
- 2. The maximum ambient temperature is reduced to 40°C when mounted vertically.*

Company Name:	Siemens AG - I IA AS RD ST TT
Company Address:	Werner-von-Siemens-Strasse 50, 92224 Amberg, Germany
Company Website:	http://www.siemens.com
Listing Country:	Germany
Certification Type:	FM Approved
Hazardous Location Classification:	NI / I / 2 / ABCD / T3C Ta = 60°C, T4 Ta = 60°C, T4A Ta = 60°C, T5 Ta = 60°C, T6 Ta = 60°C, NI / I / 2 / IIC / T3 Ta = 60°C, T4 Ta = 60°C, T5 Ta = 60°C, T6 Ta = 60°C