

Transformers

SPECIAL EDITION: SUPERCONDUCTIVITY 2021


MAGAZINE

PREPRINT

Superconducting fault current limiters for grid protection



ISSN 1849-7268 (Digital)



9 771849 331006



ERGON

HyVolt
Dielectric Fluids

**DO YOU HAVE A
TRANSFORMER
THAT'S STANDING
THE TEST OF TIME?**

Enter Ergon's
Filled-to-Last Photo Contest
at hyvoltfilledtolast.com.

The Power to Deliver


The preferred choice of the world's leading transformer manufacturers and utilities, Ergon's HyVolt dielectric fluids are known for consistent quality, low pour points, oxidation stability, and excellent heat transfer and electrical properties. With a robust transportation and terminaling network, Ergon provides rapid mobilization and delivery — the power of secure supply delivering what you need, where you need it, and when you need it.

Family owned and operated since 1954, Ergon is the world's leading producer of naphthenic specialty products and electrical insulating oils.

ergonnsa.com
North & South America 601-933-3000

ergoninternational.com
EMEA +32 2 351 23 75 | Asia +65 6808 1547



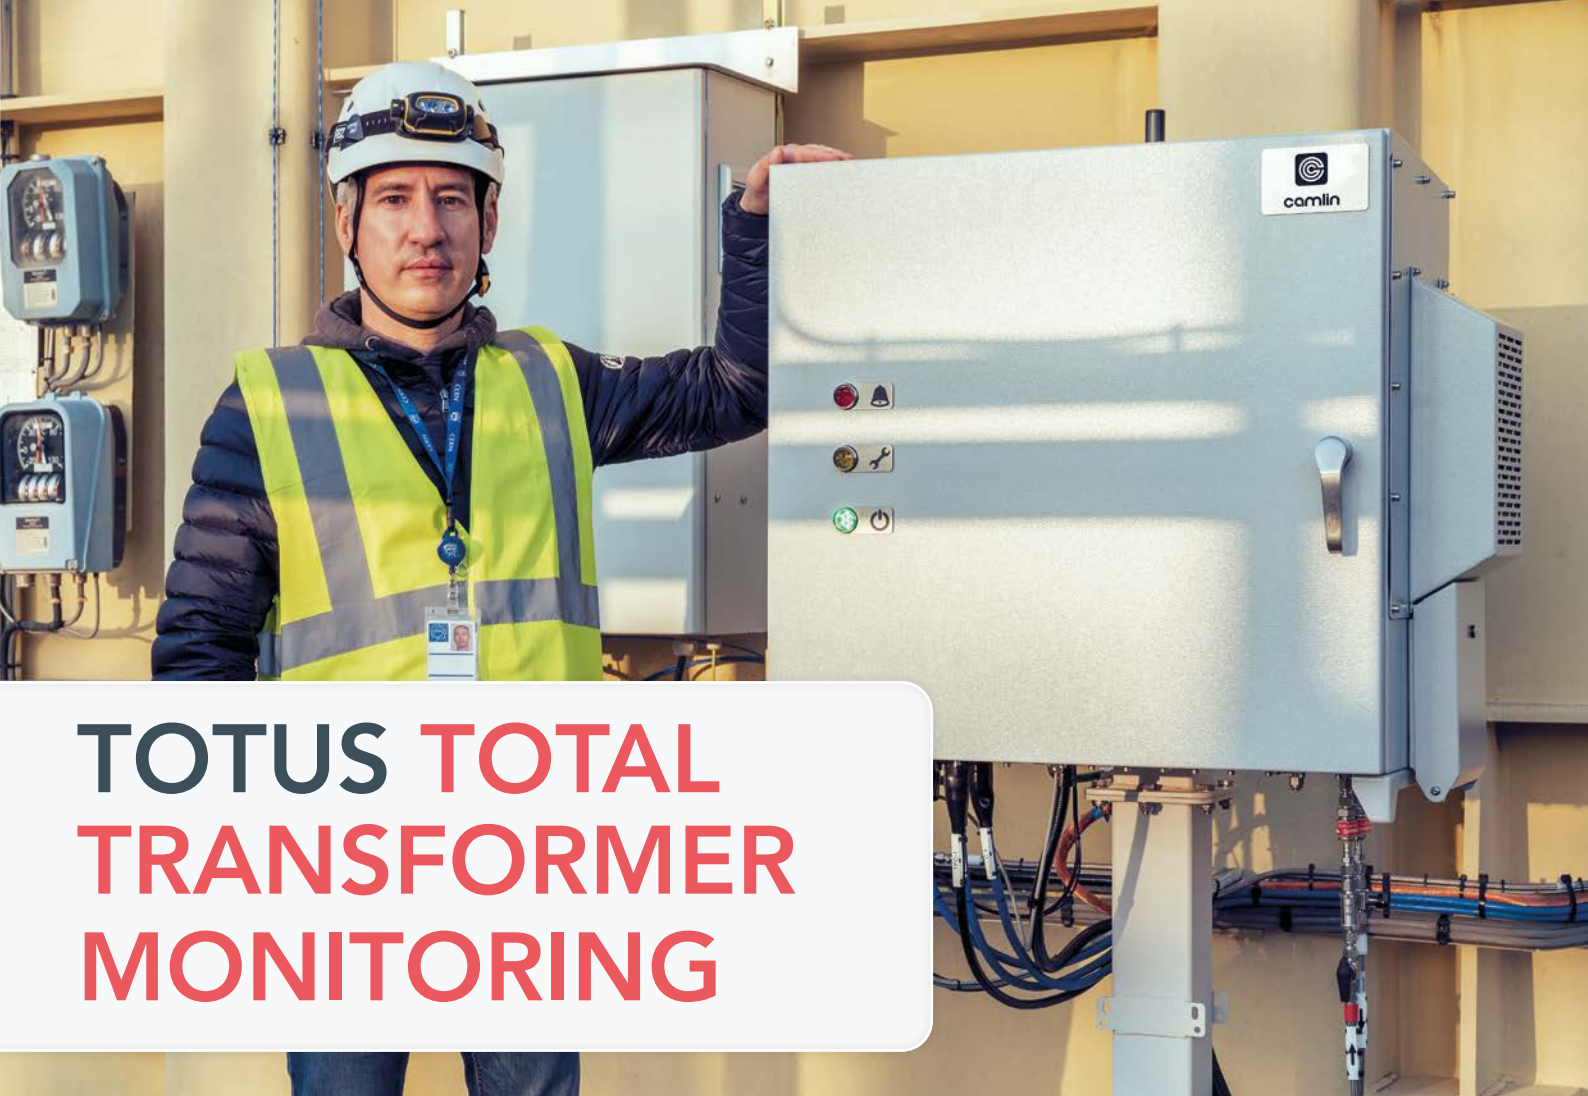

TOTUS TOTAL TRANSFORMER MONITORING

TOTUS is the only system that can diagnose arcing in a transformer

The Challenge for Asset Managers.

DGA is typically used to detect discharge of high energy (D2), with Acetylene being the primary marker. The challenge for asset managers is little visibility on when an arc has occurred and in which phase and winding, as well as no tracking on the number of arcing events.

How Does TOTUS Total Transformer Monitoring Drive Value?

Whereas other monitors can provide basic information detecting acetylene in the transformer, TOTUS delves deeper into arcing activities, identifying the phase and winding, as well as visibility on the number of arcing events. TOTUS gives asset managers the ability to correlate data to generate a deeper understanding of changes in the transformer, driving accurate decision making about asset health.

Learn More...

Check out the new Camlin Group website at <https://camlingroup.com/global/energy/asset-monitoring>, to learn more about how we are driving reliable decision making for asset managers.



camlin energy

www.camlingroup.com



ABSTRACT


Superconducting fault current limiters are novel equipment for grid engineers. It presents unique features like ultra-fast current limitation, efficient reduction of fault current and very small footprint. It is eco-friendly and non-flammable. The article briefly discusses device basics, available options and recent practical advances in this field. As well, a forward-looking analysis of future SFCL opportunities for application in the electrical grid is presented.

KEYWORDS:

cryogenics, economics, fault currents, fault current limiters, superconductors

Superconducting fault current limiters for grid protection

Will SFCL technology soon mature for widespread use?

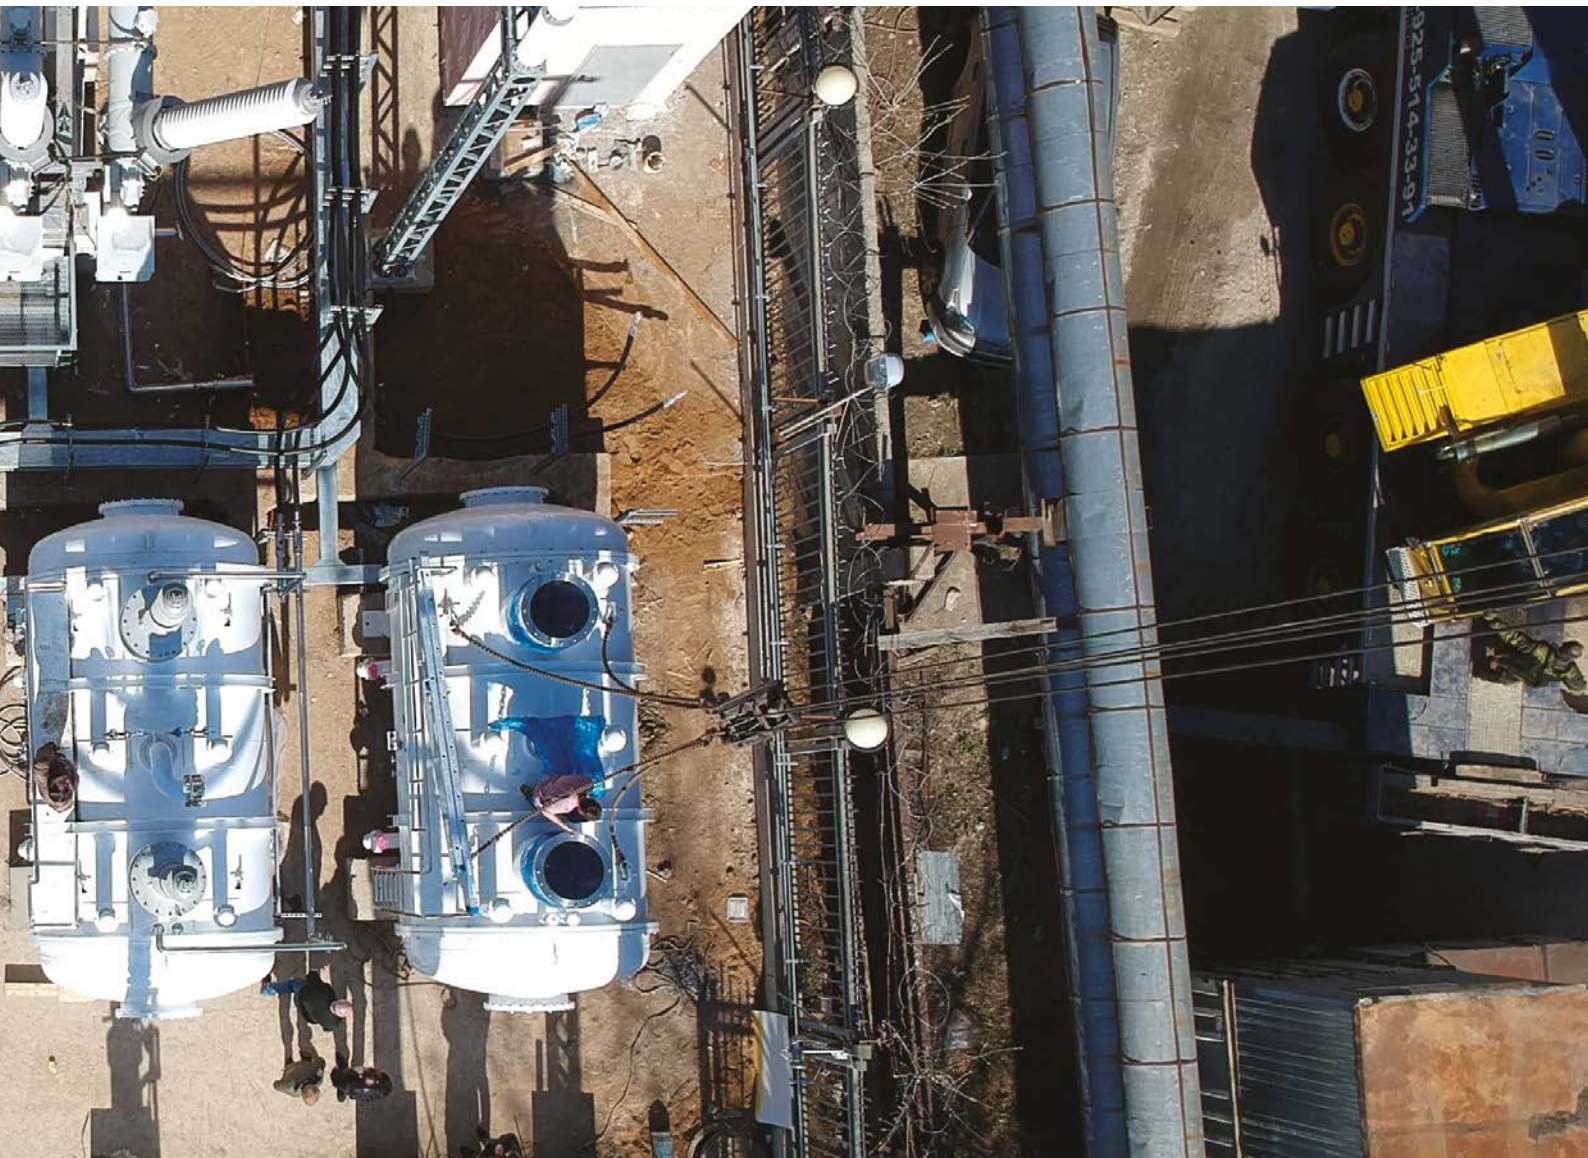

1. Introduction

The electrical grid gets more complex in order to respond to electrical consumption growth. If it is the grid of a megacity or a large industrial area, the grid density dramatically increases. An increase of transmitted power, a decrease of distances, cabling of transmission lines, and introduction of distributed generation sources – all this leads to the growth of fault current level. We have a fundamental problem here: by becoming larger, the grid inevitably starts to be much more vulnerable to short circuit events. As a result of the grid growth, the impact of fault currents becomes exponentially more significant and expensive. Although the problem needs proper attention at all voltage levels and at the connection between voltage levels through transformers, it is medium and high voltage levels where the

cost of the problem is the largest. And that is exactly the point where many new fault current limiting devices start to be applied to the grid.

Fault current issue is normally addressed by grid sectioning, installing current-limiting devices (inductive reactors, Is-limiters, semiconducting devices) [1], or increasing the rating of switchgears. These approaches have their pros and cons. Grid sectioning is easy and cheap,

but it leads to increased losses and a higher probability of blackouts. Using conventional current-limiting devices leads to additional losses, and the number of problems they can solve is limited. For instance, Is-limiters and semiconducting devices are available only for medium voltage range, while inductive reactors have a limited impedance value and produce stray magnetic fields at operation. Increasing the rating of switchgears ultimately leads to rating increases

Increase of transmitted power, a decrease of distances, cabling of transmission lines, and introduction of distributed generation sources – all this leads to the growth of fault current level

Very high speed of current limitation, a large reduction of fault current, and small footprint are the major technical advantages of superconducting fault current limiters

for all grid components, including cables, transformers and busbars. Such serious grid renovation is a costly adventure.

The opportunity – and challenge – for superconducting fault current limiter (SFCL) technology lies in solving of fault current limitation task without the aforementioned flaws.

2. How superconductors help

The discovery of high-temperature superconductivity (HTS) in the late 1980s and the emergence of practical HTS tapes in the 2000s brought about a completely new instrument based on the unique physics of these new materials. Although typical HTS materials operate at about -200 °C, the term “high-temperature superconductors” is widely used to differentiate them from low-temperature superconductors, which operate at around -270 °C – in MRI machines and particle accelerators, for example. Due to their odd quantum nature, superconductors happen to “switch” reversibly between superconducting and highly resistive state depending on the level of

current passing through. Important for grid: this transition is ultrafast, reliable, and reproducible (Fig. 1). After the fault is cleared, the current-limiting element automatically returns back to the superconducting state. A couple of definitions: the threshold value, above which superconductivity is lost, is called a “critical current” I_c , and the transition property itself is often referred to as a “quench”. The current below I_c passes the superconductor with almost no losses. If the current is larger than the designed threshold value, the superconductor turns resistive (as it quenches), and the current level is automatically limited. Superconductor thus serves as a natural “fault current limiter”. All you need to do is to keep the superconductor cold and dissipate Joule heat after the fault event.

Very high speed of current limitation, a large reduction of the fault current, and a small footprint are the major technical features that lead to the economic benefit of SFCLs compared to conventional technologies. One may note that the economic benefit can be found today in a limited number of cases, but as the su-

perconducting technology develops and matures, their number will grow. It looks like the grid reliability problems grow in number and impact size while superconducting device cost gradually goes down: it sounds like a perfect scenario for rapid market development.

Engineers offered a variety of ways to make use of the current-limiting property of superconductor [1-3]:

- resistive stand-alone superconducting fault current limiter (r-SFCL),
- inductive stand-alone superconducting fault current limiter (i-SFCL),
- fault current limiting cable,
- fault current limiting transformer,
- superconducting fault current limiting inductive reactor.

The functional principle of these devices is most evident from their very names. The “quenchable” superconductor is placed either in low inductance coils or meanders (resistive SFCL), cable core, or coils (inductive SFCL, superconducting transformer [3] or reactor). Typically, liquid nitrogen serves as a coolant and high voltage insulation at once. All these devices provide ultrafast fault current limitation, as well as not rarely outperform traditional counterparts in other physical characteristics, such as footprint, for example. Further in the text, we will refer to all these different technical approaches collectively as “SFCL” technologies.

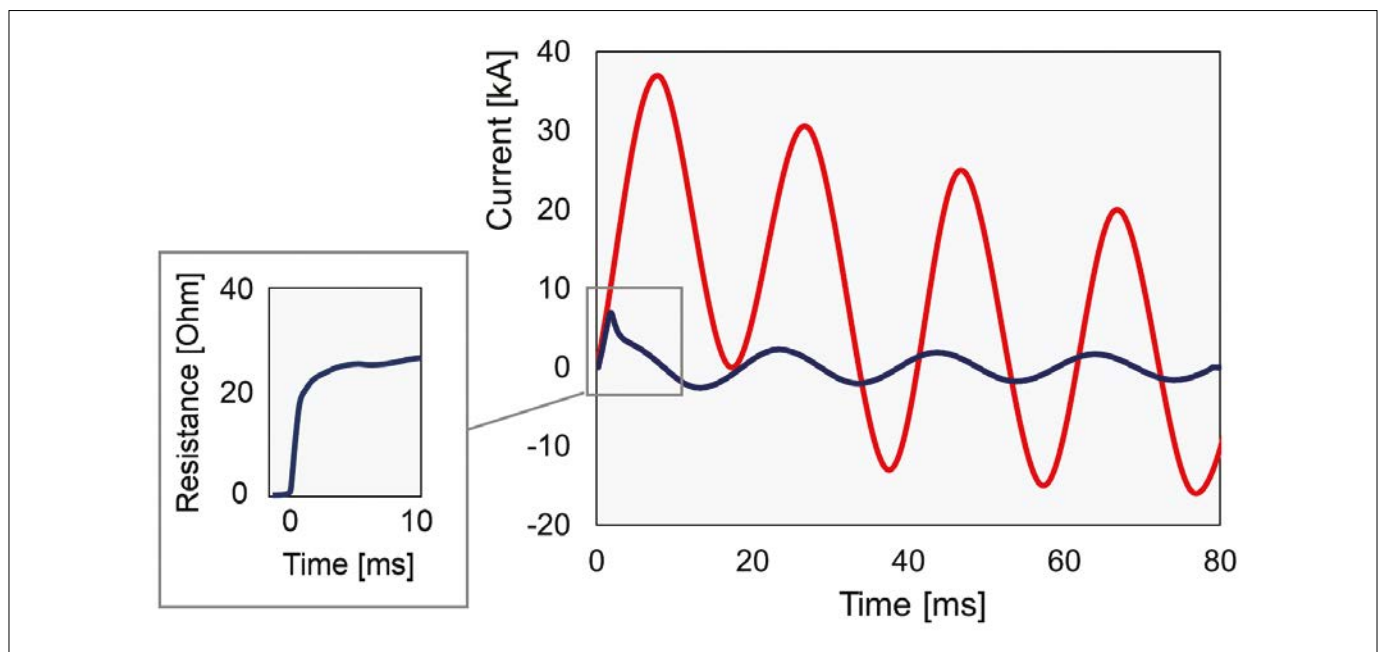


Figure 1. A typical fault current limitation with a superconducting device – ultrafast and extremely effective [10]

3. Wider acceptance and economy of scale will promote each other

To find the way into the real grid, SFCL technologies have to show their viability by winning a cost competition. Superconductors are new materials with a current market price in 150-250 \$/kAm range and the perspective to go way down to 50 \$/kAm, as a significant production level is reached (Fig. 2). Future engineering is expected to help reduce the amount of HTS tape needed to build SFCLs. The same is true for cryogenics cooling system, which can be expected to become much more affordable, especially if the development of LNG and LH2 production and distribution will progress as planned. The third important constituent of the price is the cost of power testing and corresponding freight costs (Fig. 3). Unlike many other devices, high voltage SFCL needs extraordinarily high power to test its fault current limitation efficiency. For example, SuperOx 220 kV/1,2 kA SFCL was tested with a power of about 2 GW. This type of tests is available only in few test centres worldwide (KEMA Labs in the Netherlands [8] and KERI in South Korea [9] are the most known examples of such centres), making logistics time-consuming and costly. When SFCLs will be serially produced, and international standards in place, producers will benefit from less frequent power tests, thus reducing the selling price for customers. Combined with technology development, the reduction of cost of superconductor and cryogenic equipment, optimization of logistics / tests procedure and scale effect could decrease SFCL price significantly, making it applicable in wider market segments. Today, the price for r-SFCL could be estimated at \$50-70 per one kilowatt of nominal power level, while less than one large device is commissioned per year worldwide. It is really a “boutique type” production today. The cost of \$20-30 per one kilowatt of nominal power seems to be a reasonable cost for an r-SFCL if the production scale reaches a moderate 10 devices/year target. Until the mass market is reached, r-SFCL will find its application in cases where the problem cannot be cured by cheaper countermeasures. The “good” news is that there are many such cases, and we will continue to see new interesting SFCL projects in nearest future.

Another mighty driver, which could lead to the rapid acceptance of superconduct-

Superconductors are new materials with a current market price in 150-250 \$/kAm range and the perspective to go way down to 50 \$/kAm, as a significant production level is reached

ing fault current limiters is the development of DC technology. Superconductors may greatly help to solve the problem of controlling large DC currents in UVDC and HVDC transmission lines, data centres, electrolysis plants or similar installations. Although there are no grid installations so far, active R&D work has already begun: 160 kV / 1 kA DC r-SFCL is being developed in China [10], EU funds the project to develop 50 kV / 1kA DC r-SFCL [11], and 1.5 kA / 400 mH HTS DC reactor was developed in Korea [12].

Last but not least, SFCL technology is very ecology-friendly and intrinsically fireproof. Liquid nitrogen is a major constituent of the air, and no flammable components are included. The use of solid-state insulated bushings instead of SF6 insulation was shown to be effective for SFCL. This aspect could become very important

for future SFCL technology destiny, as these aspects will play a larger role as climate concerns rise.

4. Cases where SFCL already work

Today, superconducting fault current limiting technologies have already started being applied in a real grid. No wonder this penetration takes place in cases with extraordinary costly and urgent problems – in large cities.

Probably, the most famous example is the 12 kV / 2400 A SFCL protecting 10 kV / 40 MVA superconducting cable in Essen, known as the AMPACITY project, developed by Nexans [13] for RWE (now Innogy). Essen is a part of a large urban agglomeration (Ruhr area), which has over 5 million people and is a giant industrial dis-

Superconducting fault current limiters are ecology-friendly and intrinsically fireproof

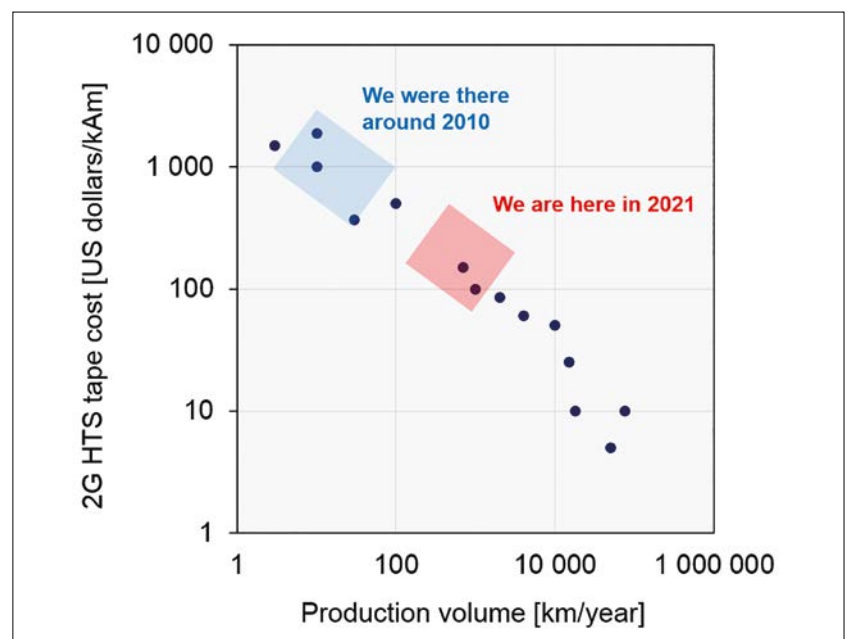


Figure 2. The cost of second-generation high temperature superconductor tape based on various expert opinions [4-7]



Figure 3. One phase of SuperOx 220 kV SFCL in KERI test centre, February 2018

Today, superconducting fault current limiters help to solve costly and urgent grid problems – in large cities, for example

tract. The AMPACITY SFCL has a 2,4-kA rating that is the highest value for r-SFCLs installed in the grid so far. The device went live in 2014 and has operated smoothly for many years since its commissioning. Another example is the use of SFCL to control fault currents in 220 kV grid of Moscow by UNECO grid company. The Russian capital is a very dense city with more than 12 million people and over 100 TWh yearly consumption of electricity. Due to the need for centralized heating in winter, a significant part of electrical generation is placed inside the city, making generation-consumer distances unusually short. Intensive XLPE cable introduction and simultaneous rapid consumption growth in the 21st century caused fault current level to double in the last 20 years. To ad-

dress this, 220 kV / 1,2 kA SFCL was designed and built by SuperOx [14]. This SFCL was installed in 2019, and there are high chances that more high voltage SFCL devices will follow in the next 5 years. To date, this is the most powerful HTS device installed in the grid worldwide. In Chicago, IL, ComEd is setting up to install the world's first fault current limiting cable in 2021 with the ultimate goal to connect neighbouring substations in the city centre at a distribution level of 14 kV in a "loop". There is no practical way to interconnect such city substations without increasing fault current levels, and the SFCL cable provides a perfect "two-in-one" solution. The project is run by AMSC and is known as REG (resilient electrical grid) [15]. It is important to note that it is the fault-cur-

rent limiting behaviour of superconductors that ensures this grid resiliency. Such mesh- or circle-like city interconnection is crucial to cope with a threat of potential power outages due to malicious attacks and / or extreme weather influence, which are known to be very costly. Following the Chicago project, it is expected that more US cities will adopt the REG solution.

5. Where future directions will lead us

Practical examples given above prove that SFCL technology has reached enough maturity to start its way in a real grid. As with any perspective high tech, the more you learn, the more work appears to be ahead. Although predicting the future is a tough job, we will try to show directions here, as they are seen from 2021. As it seems, the engineers will spend the decade focusing on one or more of these challenges:

- Reach better device performance: e.g., decrease AC losses in a superconduc-



tor, increase fault withstand time, decrease device cost,

- Develop internationally accepted standards for SFCL equipment and test procedures,
- Create SFCL solutions for yet “untouched” areas with great market potential, such as 220-750 kV AC grids, HVDC and UVDC, 10 + kA busbars, on-board protection systems of railways, ships and aeroplanes, smooth starters for large motors, protection for arc ovens and electrolysis equipment, etc.,
- Develop competitive two-in-one or three-in-one solutions: FCL transformer, FCL cable, SFCL reactor, etc.

If any of these directions will bring results, it will be good for SFCL. The greatest challenge for SFCL, however, is to overcome its present niche-type presence in city grids and become a truly diversified and widespread technology. Only this would provide enough resources for the SFCL market to grow fast.

Conclusion

A high level of fault currents presents a serious threat to the development of electrical grids in densely populated megacities or large industrial areas. Superconducting fault current limiter technology appears to be able to address existing challenges in a number of cases, and this drives first applications in a real grid. As the technology matures, it will benefit from ever-growing electrical grid complexity and more stringent requirements for a stable supply of electricity to customers.

Bibliography

[1] N. Tleis, *Control of high short-circuit fault currents and fault current limiters*, in Power Systems Modelling and Fault Analysis, Academic Press, 2019

[2] P. Tixador, ed., *Superconducting fault current limiter*, Innovation for the Electric Grids, World Scientific, 2019

[3] M. Yazdani-Asrami et al., *Fault current limiting HTS transformer with extended fault withstand time*, Supercond. Sci. Technol., Vol. 32, 2019, 035006

[4] V. Matias, R. H. Hammond, *YBCO superconductor wire based on IBAD-textured templates and RCE of YBCO: Process economics*, Physics Procedia, Vol. 36, 2012, pp. 1440-1444

[5] P. M. Grant, T. P. Sheahen, *Cost projections for high temperature superconductors*, 2002, arXiv: cond-mat/0202386

[6] S. H. Moon, *HTS Development and industrialization at SuNAM*, Presented at 1st Workshop on Accelerator Magnets in HTS, 2014, <https://indico.cern.ch/event/308828/contributions/1680708/>

[7] T. F. Lehner, *SuperPower 2G HTS wire for demanding electric power applications*, Presented at 10th EPRI Superconductivity Conference, 2011

[8] CESI KEMA Labs, <https://www.cesi.it/about-us/overview/kema/>

[9] Korea Electrotechnology Research Institute, www.keri.re.kr/html/en/

[10] M. Song, et al., *The parameter design and system simulation of 160-kV / 1-kA resistive-type superconducting DC fault current limiter*, IEEE Transactions on Applied Superconductivity, Vol. 29, 2019, 5603706

[11] FASTGRID Project, <https://www.fastgrid-h2020.eu/>

[12] J. I. Lee, et al., *Design and performance analysis of a 1500 A, 400 mH superconducting DC reactor coil using 2G multi-ply HTS wire*, Journal of Physics: Conference Series, Vol. 1054, 2018, 01207

[13] M. Stemmler, et al., *AmpaCity — Advanced superconducting medium voltage system for urban area power supply*, IEEE PES T&D Conference and Exposition, Chicago, IL, USA, 2014, pp. 1-5, DOI 10.1109/TDC.2014.6863566

[14] M. Moyzykh et al., *First Russian 220 kV superconducting fault current limiter (SFCL) for application in city grid*, IEEE Transactions on Applied Superconductivity, Vol. 31, 2021, in press, DOI 10.1109/TASC.2021.3066324

[15] AMSC resilient electrical grid white paper, 2014, <https://kafactor.com/content/technical-resources/reg-white-paper.pdf>

Author



Sergey Samoilenkov completed a PhD in chemistry in 1999 at Moscow State University. After working for 5 years at Technical University Braunschweig in Germany, he participated in the founding of SuperOx company in 2006 and became its first technical director. Since 2013, he has been the CEO of SuperOx. His work had involved superconductor material and power equipment development. Today, he is an active member of the CIGRE D1.64 working group and a member of the Scientific Council of ROSSETI – one of the largest grid companies in the world.