



PRESSURE &
DESIGN DATA

Design

Tech Data Sheets: G810, G820, G830

Rigid Joints

GRINNELL Rigid Couplings provide rigid gripping of the pipe. They are designed to bring the pipe ends close together and to ensure the coupling clamps firmly onto the pipe OD and the bottom of the grooves. Because rigid couplings clamp around the entire pipe surface, they provide resistance to flexural and torsional loads and therefore permit longer spacing to ASME/ANSI B 31.1 (Power Piping) and ASME/ANSI B 39.1 (Building Services) requirements.




Flexible Joints


GRINNELL Flexible Couplings act as an "expansion joint", allowing linear and angular movement of the pipe. They are designed with the coupling keys engaging the pipe without gripping on the bottom of the grooves, while still providing for a restrained mechanical joint. This is particularly useful to allow for pipe expansion/contraction and piping misalignment.

Linear Movement (Flexible Couplings)

For thermal expansion with flexible couplings, the pipe ends at each joint should be fully gapped to the maximum amount. This can be accomplished by pressurizing the system and then anchoring the system.



For thermal contraction with flexible couplings, the pipe ends at each joint should be fully butted. The system can then be anchored in place to prevent the pipe ends from opening up to the maximum end gap when pressurized.



For design purposes, the maximum pipe end gap should be reduced to account for field practices as follows:

End Gap Reduction	
Pipe Size mm Inches	Maximum Pipe End Gap
42.4 – 88.9 1 1/4 – 3	50%
114.3 – 610.0 4 – 24	25%


The following values should be used as available pipe end movements for GRINNELL Figure 705, 707, and 716 Flexible Couplings:

Pipe End Movements		
Pipe Size mm Inches	Cut Grooved mm Inches	Roll Grooved mm Inches
42.4 – 88.9 1 1/4 – 3	0 – 1.6 0 – 0.063	0 – 0.8 0 – 0.031
114.3 – 610.0 4 – 24	0 – 2.4 0 – 0.188	0 – 2.4 0 – 0.094

* Roll grooved joints provide half the available movement of cut grooved joints.


Angular Deflection

GRINNELL Flexible Couplings are capable of accommodating angular deflection.



Expansion/Contraction

GRINNELL Flexible Couplings are capable of accommodating pipe thermal movements provided they are properly gapped and a sufficient quantity of flexible couplings are used. Note that flexible couplings will not accommodate both full maximum linear movement and the maximum available angular deflection concurrently at the same joint.

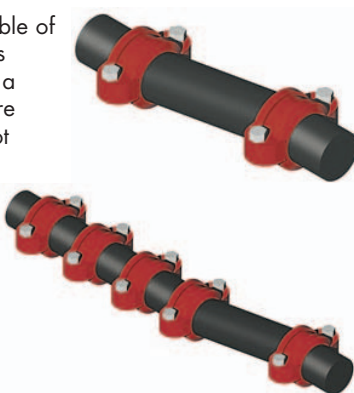

If it is desired to have both deflection and linear movement available, then the system should have sufficient flexible joints to accommodate the requirement.

The deflection published is a maximum value. For design purposes the maximum deflection should be reduced to account for field practices as shown:

Deflection	
Pipe Size mm Inches	Maximum Pipe Deflection Reduction
42.4 – 88.9 1 1/4 – 3	50%
114.3 – 610.0 4 – 24	25%

Thermal Movement


Tech Data Sheets: G810, G820, G830

The following guidelines are similar to any expansion joint:

It is recommended that anchors be installed at changes of direction on the pipe lines to control the pipe movement. The thermal expansion/contraction in the piping system can be accommodated using GRINNELL Flexible Couplings. In designing anchoring systems, it is suggested that the following be taken into consideration:

- Pressure Thrusts
- Frictional Resistance of Any Guides or Supports
- Centrifugal Thrust Due to Velocity at Changes of Direction
- Activation Force Required to Compress or Expand a Flexible Coupling

Three methods are available as examples to accommodate thermal expansion/contraction:

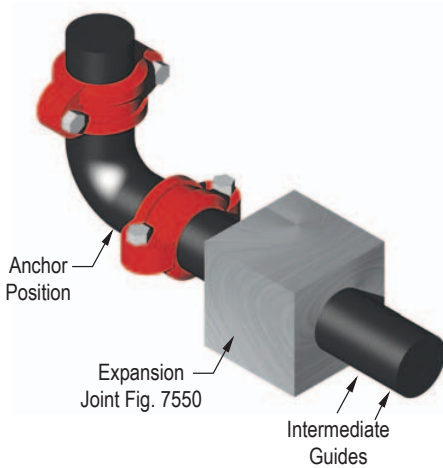


- (1) Design the system with rigid couplings and place expansion joints at the proper locations. Expansion joints may be a series of flexible grooved couplings of a sufficient quantity to accommodate the movement.
- (2) Design the system with flexible and/or rigid couplings and allow the pipe to move in directions desired, with the use of anchors and guides if so required. With this method, it is important to ensure that movement at branch connections, changes of direction, equipment hookup, etc., will not cause damage or harmful stresses.

- (3) Design the system with flexible couplings utilizing the expansion/contraction capabilities of these products.

The following example illustrates this method:

- 150mm (6") Schedule 40 steel pipe, roll grooved, 45.7m (150') long, anchored at each end
- Maximum Temperature = 93.3°C (200°F)
- Minimum Temperature = 4.4°C (40°F)
- Install Temperature = 26.6°C (80°F)

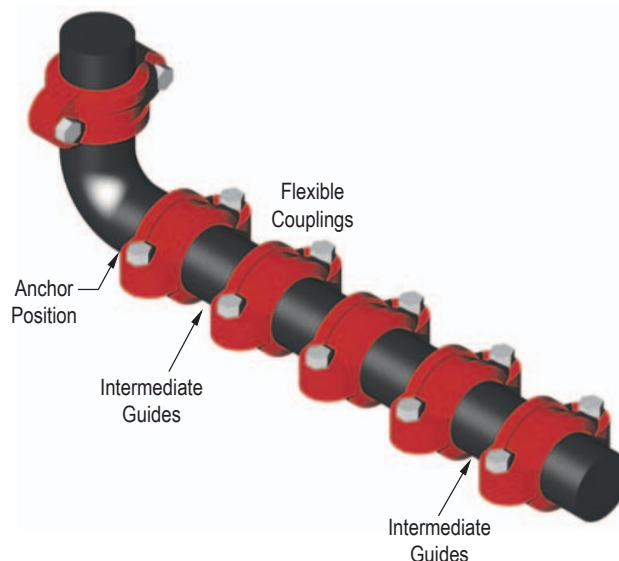

Activation Force	
Pipe Size mm Inches	Activation Force N Lbs.
42.4	156
1 1/4	35
48.3	200
1 1/2	45
60.3	311
2	70
73.0	645
2 1/2	100
76.1	489
76,1mm	110
88.9	645
3	145
114.3	1068
4	240
141.3	1668
5	375
165.1	2224
165,1mm	500
168.3	2313
6	520
219.1	3914
8	880
273.0	6072
10	1365
323.9	8518
12	1915

Thermal Movement

Tech Data Sheets: G810, G820, G830

Directions to calculate the number of couplings required to compensate for the thermal expansion and contraction of pipe (by example):

(1) Thermal Contraction

Utilize the Thermal Expansion Table. Allowance for the minimum installation temperature, in this case 26.6°C to 4.4°C (80°F to 40°F), is calculated as:

26.6°C = 15,5mm per 30,5m
 4.4°C = 7,6mm per 30,5m
 Difference = 7,9mm per 30,5m
 For 45,7m of pipe = 7,9mm x 1.5 = 11,9mm per 45,7m

(80°F = 0.61" per 100'
 40°F = 0.30" per 100'
 Difference = 0.31" per 100'
 For 150' of pipe = 0.31" x 1.5 = 0.47" per 150')

(2) Thermal Expansion

Utilize the Thermal Expansion Table. Allowance for the minimum installation temperature, in this case 26.6°C to 93.3°C (80°F to 200°F), is calculated as:

93.3°C = 38,6mm per 30,5m
 26.6°C = 15,5mm per 30,5m
 Difference = 23,1mm per 30,5m
 For 45,7m of pipe = 23,1mm x 1.5 = 34,5mm per 45,7m

(200°F = 1.52" per 100'
 80°F = 0.61" per 100'
 Difference = 0.91" per 100'
 For 150' of pipe = 0.91 x 1.5 = 1.36" per 150')

(3) Couplings Required

Available linear movement for a 150mm (6") Figure 707 Flexible Coupling on roll grooved pipe = 2.4mm (0.094") per coupling.

Fully butted together for contraction only. Therefore the number of Figure 707 Flexible Couplings required:

- 11.9mm / 2.4mm per coupling = 4.96
 (0.47" / 0.094" per coupling = 5.0)



- Use 5 Figure 707 couplings for pipe contraction
- (b) Fully gapped apart for expansion only. Therefore the number of Figure 707 Flexible Couplings required:

- 34.5mm / 2.4mm per coupling = 14.38
 (1.36" / 0.094" per coupling = 14.47)



- Use 15 Figure 707 Flexible Couplings for pipe expansion

Thermal Expansion of Carbon Steel in millimeters/30.5 Meters (Inches/100 Feet) Between 0°F (-18°C) and Indicated Temperature

Temperature C° F°	Thermal Expansion mm/30.5m Inches/100 Feet
-40.0	-7.72
-40	-0.30
-34.4	-5.79
-30	-0.23
-28.9	-3.86
-20	-0.15
-23.3	-1.93
-10	-0.08
-17.8	0.00
0	0.00
-12.2	1.93
10	0.08
-6.7	3.86
20	0.15
-1.1	5.79
30	0.23
4.4	7.72
40	0.30
10.0	9.65
50	0.38
15.6	11.58
60	0.46
21.1	13.51
70	0.53
26.7	15.44
80	0.61
32.2	17.37
90	0.68
37.8	19.30
100	0.76
43.3	21.23
110	0.84
48.9	23.16
120	0.91
54.4	25.09
130	0.99
60.0	27.02
140	1.06
65.6	28.95
150	1.14
71.1	30.88
160	1.22
76.7	32.81
170	1.29
82.2	34.74
180	1.37
87.8	36.67
190	1.44
93.3	38.60
200	1.52
98.9	40.53
210	1.60
104.4	42.46
220	1.67
110.0	44.39
230	1.75

Mean Coef. of thermal expansion = 0.00001139 mm/mm/°C
 Source: ASME B31.9

Misalignment and Deflection

Tech Data Sheets: G810, G820, G830


GRINNELL Flexible Couplings provide for restrained joints and allow for deflection to aid where the pipe or equipment is misaligned.

Note that flexible couplings will not accommodate both full maximum linear movement and the maximum available angular deflection concurrently at the same joint.

Design Deflection for Roll Grooved Pipe



If it is desired to have both deflection and linear movement available, then the system should have sufficient flexible joints to accommodate the requirement.

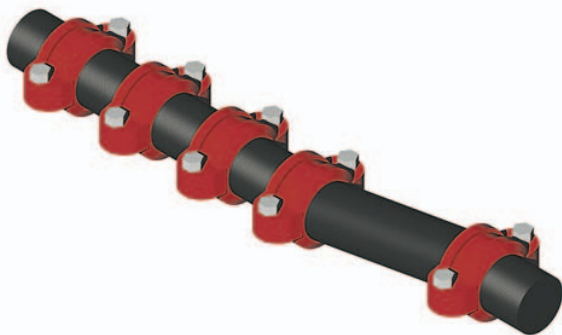

Flexible couplings are also useful in laying out curved piping systems.

$$R = \frac{L}{(2) \left(\sin \frac{\phi}{2}\right)}$$

$$L = (2) (R) \left(\sin \frac{\phi}{2}\right)$$

$$N = \frac{T}{\phi}$$


R = Radius of curve

L = Pipe length

ϕ = Deflection from centre line, in degrees, for each coupling (see table)

N = Number of flexible couplings needed

T = Total deflection, in degrees, required

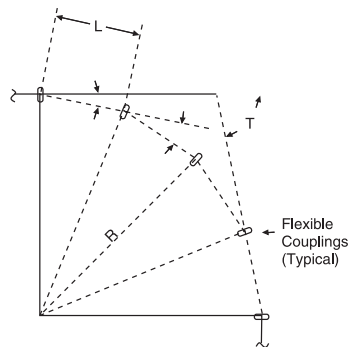

Deflection ϕ (Roll Grooved Pipe)	
Pipe Size mm Inches	Figures 705 & 707
42.4 1 1/4	1.08°
48.3 1 1/2	0.94°
60.3 2	0.75°
73.0 2 1/2	0.62°
76.1 76,1mm	0.60°
88.9 3	0.51°
114.3 4	1.19°
141.3 5	0.97°
165.1 165,1mm	0.83°
168.3 6	0.81°
219.1 8	0.63°
273.0 10	0.50°
323.9 12	0.42°

Incorporates the recommended safety factor reduction for field practices (50% for sizes 32mm - 80mm (1 1/4" - 3") and 25% for sizes 100mm - 300mm (4" - 12")).

Pipe Support

Tech Data Sheets: G810, G820, G830

All piping systems require that the support system accommodate the weight of the pipe, joint connections, fluid, and other system components. In addition, consideration may be necessary in reducing stresses, accommodating thermal expansion or contraction, building settlement, seismic movement, etc. The following tables provide guidelines for grooved steel piping products without concentrated loads between supports.

Flexible Joints

For pipe runs when linear movement is accommodated by the flexible coupling:

Pipe Size mm Inches	Number of Hangers Per Pipe Length							
	Pipe Length in Meters Feet							
	10 3.3	12 3.7	15 4.6	22 6.7	25 7.6	30 9.1	35 10.7	40 12.2
42.4 – 60.3 1 1/4 - 2	2	2	2	3	4	4	5	6
73.0 – 114.3 2 1/2 - 4	1	2	2	2	2	3	4	4
141.3 – 609.6 5 - 24	1	1	2	2	2	3	3	3

For pipe runs when linear movement is not required:

Distance Between Supports	
Nominal Size mm Inches	Maximum Distance Between Supports Meters Feet
42.4 - 48.3 1 1/4 - 1 1/2	3.7 12
60.3 - 219.1 2 - 8	4.6 15
273.0 - 323.9 10 - 12	4.9 16
355.6 - 406.4 14 - 16	5.5 18
457.2 - 609.6 18 - 24	6.1 20


Note: The requirements of ANSI, ASME or other code groups may require additional supports.

Rigid Joints

For pipe runs with rigid couplings:

Pipe Size		Suggested Maximum Span Between Supports – Meters Feet					
Nominal DN In.	O.D. mm In.	Water Service			Air Service		
		I	II	III	I	II	III
25 1	33.4 1.315	2.1 7	2.7 9	3.7 12	2.7 9	9 2.7	3.7 12
32 1 1/4	42.4 1.660	2.1 7	3.4 11	3.7 12	2.7 9	11 3.4	3.7 12
40 1 1/2	48.3 1.900	2.1 7	3.7 12	4.6 15	2.7 9	13 4.0	4.6 15
50 2	60.3 2.375	3.0 10	4.0 13	4.6 15	4.0 13	15 4.6	4.6 15
65 2 1/2	73.0 2.875	3.4 11	4.3 14	4.6 15	4.3 14	16 4.9	4.6 15
65 76.1mm	76.1 3.000	3.4 11	4.3 14	4.6 15	4.3 14	16 4.9	4.6 15
80 3	88.9 3.500	3.7 12	4.6 15	4.6 15	4.6 15	17 5.2	4.6 15
100 4	114.3 4.500	4.3 14	5.2 17	4.6 15	5.2 17	21 6.4	4.6 15
125 133.0mm	133.0 5.236	4.9 16	5.8 19	4.6 15	6.1 20	24 7.3	4.6 15
125 139.7mm	139.7 5.500	4.6 15	5.5 18	4.6 15	5.2 19	23 7	4.6 15
125 5	141.3 5.563	4.9 16	5.8 19	4.6 15	6.1 20	24 7.3	4.6 15
150 165.1mm	165.1 6.500	5.2 17	6.1 20	4.6 15	6.4 21	25 7.6	4.6 15
150 6	168.3 6.625	5.2 17	6.1 20	4.6 15	6.4 21	25 7.6	4.6 15
200 8	219.1 8.625	5.8 19	6.4 21	4.6 15	7.3 24	28 8.5	4.6 15
250 10	273.0 10.750	5.8 19	6.4 21	4.6 15	7.3 24	31 9.4	4.6 15
300 12	323.9 12.750	7 23	6.4 21	4.6 15	9.1 30	33 10.1	4.6 15
350 14	355.6 14.000	7 23	6.4 21	4.6 15	9.1 30	33 10.1	4.6 15
400 16	406.4 16.000	8.2 27	6.4 21	4.6 15	10.7 35	33 10.1	4.6 15
450 18	457.2 18.000	8.2 27	6.4 21	4.6 15	10.7 35	33 10.1	4.6 15
500 20	508.0 20.000	9.1 30	6.4 21	4.6 15	11.9 39	33 10.1	4.6 15
600 24	609.6 24.000	9.8 32	6.4 21	4.6 15	12.8 42	33 10.1	4.6 15

I - Spacing by ANSI B31.1 Power Piping Code
 II - Spacing by ANSI B39.1 Building Piping Code
 III - Spacing by NFPA 13 Sprinkler Systems
 (Steel Pipe except Threaded Lightwall)

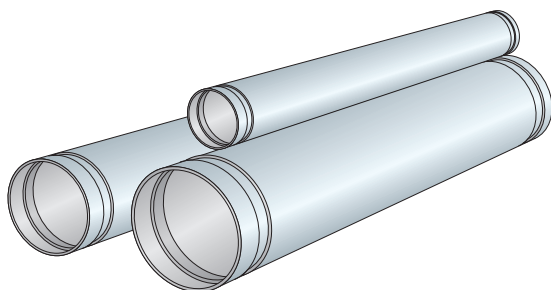


Pipe Support

Tech Data Sheets: G810, G820, G830

Rotational Movement

GRINNELL Flexible Couplings are suitable for use in seismic as well as mining applications. The inherent capability of the flexible coupling to allow for linear movement, angular deflection, and rotational movement make it an excellent choice for reducing stresses in a piping system and to increase pipe life in slurry applications.

For mining applications where the pipe needs to be rotated, the system should be depressurized. The pipe coupling bolts/nuts can be loosened, pipe rotated, the bolts/nuts re-tightened, and the system be put back in service.

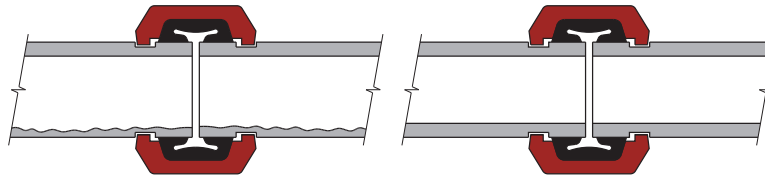

Even distribution of pipe wear can be achieved with this method on the inner service of the pipe.

Note: Precautions are necessary to monitor pipe wall thickness to evaluate pressure capability of the pipe with reduced wall.


Linear Movement

Flexible couplings are designed with the couplings keys engaging the pipe without gripping on the bottom of the groove while still providing for a restrained mechanical joint.



The inherent flexibility of the coupling must be considered when deciding on support arrangements for the piping system as movement can occur in more than one plane (linear movement, angular deflection, and rotational movement).

Upon system pressurization, each pipe end within the flexible couplings will expand to the maximum published value. The coupling keys make contact with the face of the groove and restrain the joint. In piping systems, this movement will be accumulative.

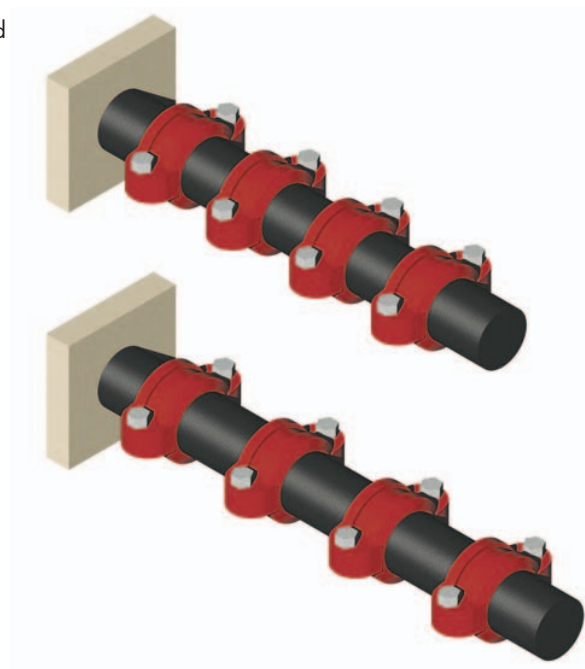

Pipe Support

Tech Data Sheets: G810, G820, G830

Angular Movement

System movement can be accommodated by providing for sufficient offset lengths. Temperature increases/decreases can further increase this movement.

When systems are anchored with partially deflected joints, the system can move to the fully deflected condition upon pressurization resulting in the "snaking" of the piping system. Lightweight hangers may not be suitable to prevent the lateral movement.






Pipe Support

Pipe hanger positioning is important when considering pipe "sagging" due to the flexible nature of the piping system. Proper positioning of hangers near the elbow, for example, should be considered.

The use of spring hangers or other methods can be considered to accommodate vibrations. Base supports, pressure thrust anchors, and pipe offsets can be used to direct pipe movement.


The use of rigid couplings can be considered to reduce the movement available with flexible couplings. Consideration of other methods of accommodation of pipe movements may be required.

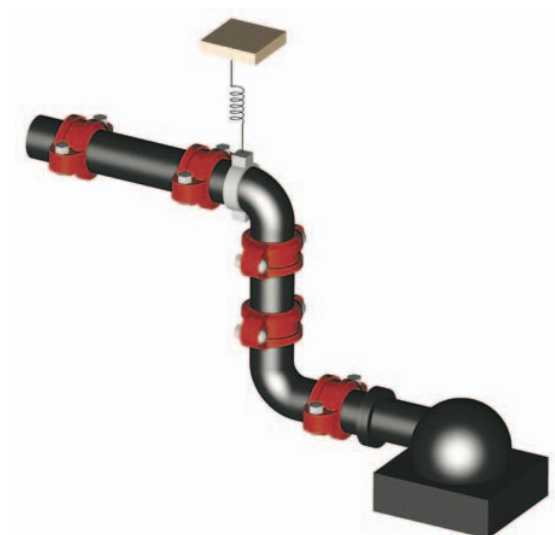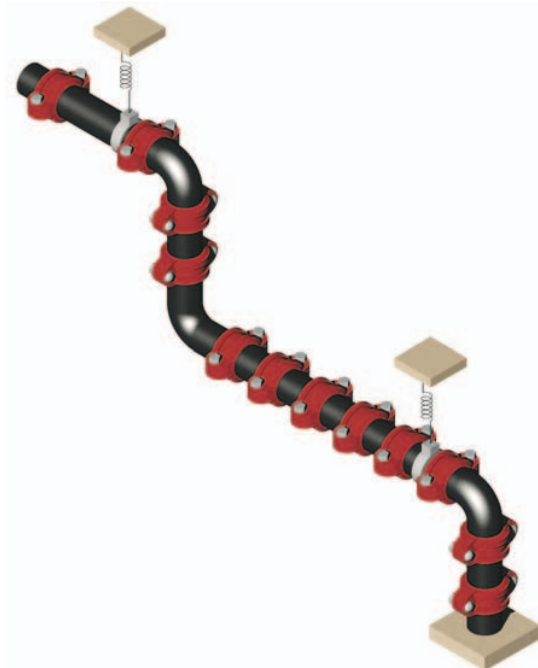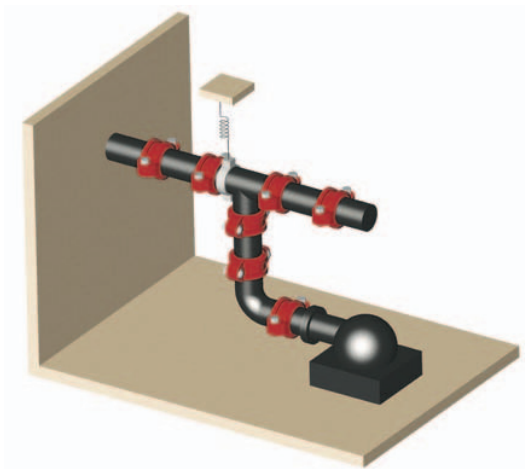

Vertical Piping

Tech Data Sheets: G810, G820, G830

Risers comprised of rigid couplings can be considered instead of welded or flanged systems. Where thermal movement exists, expansion joints and/or flexible couplings with offsets may be required.

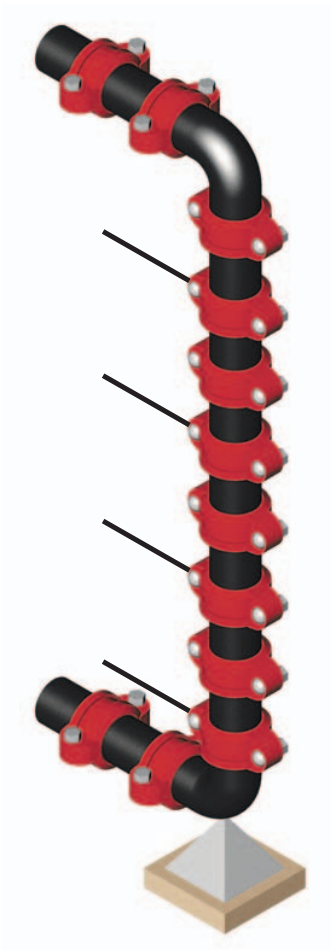


When using flexible couplings, the movement that occurs in long lengths of piping needs to be considered. Each joint can move up to the maximum pipe end separation published. This movement can accumulate and result in the growth of the piping system, for example at the top. Offsets may be necessary.

Should the riser contain branch connections, the movement which occurs at these locations with flexible couplings will also need to be considered.

One solution would be to anchor the vertical piping at appropriate locations to prevent movement which can cause stresses at the branches or equipment. The use of rigid couplings can be an advantage.

As always, good piping practice should prevail. It is the designer's responsibility to select products suitable for the intended service and to ensure that pressure ratings and performance data is not exceeded. Never remove any piping component or correct or modify any piping deficiencies without first depressurizing and draining the system. Material and gasket selection should be verified to be compatible for the specific application.

Pipe Data

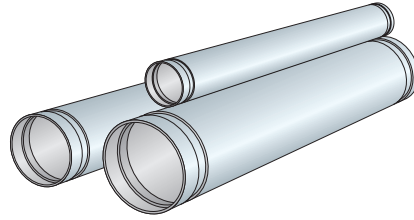

Pipe Size		Conversion Table Wall Thickness - mm inches								
Nominal DN In.	O. D. mm In.	Pipe ANSI B36.10						Pipe DIN Norm		
		Sch. 5	Sch. 10	Sch. 20	Sch. 30	Sch. 40	Sch. 80	DIN 2440	DIN 2448	DIN 2458
20	26.9	1.65	2.77	-	-	2.87	3.91	2.65	2.3	2
¾	1.050	0.06	0.11	-	-	0.11	0.15	0.10	0.09	0.08
25	33.4	1.65	2.77	-	-	3.38	4.55	3.25	2.6	2
1	1.315	0.06	0.11	-	-	0.13	0.18	0.13	0.10	0.08
32	42.4	1.65	2.77	-	-	3.56	4.83	3.25	2.6	2.3
1¼	1.660	0.06	0.11	-	-	0.14	0.19	0.13	0.10	0.09
40	48.3	1.65	2.77	-	-	3.68	5.08	3.25	2.6	2.3
1½	1.900	0.06	0.11	-	-	0.14	0.20	0.13	0.10	0.09
50	60.3	1.65	2.77	-	-	3.91	5.54	3.65	2.9	2.6
2	2.375	0.06	0.11	-	-	0.15	0.22	0.14	0.11	0.10
65	73.0	2.11	3.05	-	-	5.16	7.01	-	-	-
2½	2.875	0.08	0.12	-	-	0.20	0.28	-	-	-
65	76.1	-	-	-	-	-	-	3.65	2.9	2.6
76.1mm	3.000	-	-	-	-	-	-	0.14	0.11	0.10
80	88.9	2.11	3.05	-	-	5.49	7.61	4.05	3.2	2.9
3	3.500	0.08	0.12	-	-	0.22	0.30	0.16	0.13	0.11
100	108.0	-	-	-	-	-	-	-	3.6	2.9
108.0mm	4.252	-	-	-	-	-	-	-	0.14	0.11
100	114.3	2.11	3.05	-	-	6.02	8.56	4.5	3.6	3.2
4	4.500	0.08	0.12	-	-	0.24	0.34	0.18	0.14	0.13
125	133.0	-	-	-	-	-	-	-	4	3.6
133.0mm	5.236	-	-	-	-	-	-	-	0.16	0.14
125	139.7	-	-	-	-	-	-	4.85	-	-
139.7mm	5.500	-	-	-	-	-	-	0.19	-	-
125	141.3	2.77	3.4	-	-	6.55	9.53	-	-	-
5	5.563	0.11	0.13	-	-	0.26	0.38	-	-	-
150	159.0	-	-	-	-	-	-	-	4.5	4
159.0mm	6.260	-	-	-	-	-	-	-	0.18	0.16
150	165.1	-	-	-	-	-	-	4.85	4.5	4
165.1mm	6.500	-	-	-	-	-	-	0.19	0.18	0.16
150	168.3	2.77	3.4	-	-	7.11	10.97	-	-	4.5
6	6.625	0.11	0.13	-	-	0.28	0.43	-	-	0.18
200	219.1	2.77	3.76	6.35	7.04	8.18	12.7	-	6.3	4.5
8	8.625	0.11	0.15	0.25	0.28	0.32	0.50	-	0.25	0.18
250	273.0	3.4	4.19	6.35	7.8	9.27	15.06	-	6.3	5
10	10.750	0.13	0.16	0.25	0.31	0.36	0.59	-	0.25	0.20
300	323.9	3.96	4.57	6.35	8.38	10.31	17.45	-	7.1	5.6
12	12.750	0.16	0.18	0.25	0.33	0.41	0.69	-	0.28	0.22
350	355.6	4.19	6.35	7.94	9.53	11.1	19.05	-	8	5.6
14	14.000	0.16	0.25	0.31	0.38	0.44	0.75	-	0.31	0.22
400	406.4	-	6.35	7.94	9.53	12.7	21.41	-	8.8	6.3
16	16.000	-	0.25	0.31	0.38	0.50	0.84	-	0.35	0.25
450	457.2	-	6.35	7.94	11.13	14.28	23.8	-	10	6.3
18	18.000	-	0.25	0.31	0.44	0.56	0.94	-	0.39	0.25
500	508.0	-	6.35	9.53	12.7	15.06	26.19	-	11	6.3
20	20.000	-	0.25	0.38	0.50	0.59	1.03	-	0.43	0.25
600	609.6	-	6.35	9.53	14.28	17.45	30.94	-	12.5	6.3
24	24.000	-	0.25	0.38	0.56	0.69	1.22	-	0.49	0.25

Working Pressure Ratings Bar (psi) on ISO Size Steel Pipe

(Page 1 of 3)

Pipe Size		Nominal Wall Thickness mm Inches	GRINNELL Coupling Working Pressure Ratings (Bar psi) on Roll Grooved ISO Size Steel Pipe							
mm Inches	O.D.		Fig. 705 Flexible	Fig. 707 Flexible	Fig. 740 Rigid	Fig. 772 Rigid	Fig. 770 Rigid	Fig. 774 Rigid	Fig. 716 Reducing	Fig. 71 Flange
25 1	33.7 1.315	1.8	20.7	51.7	-	-	-	20.7	-	-
		0.071	300	750	-	-	-	300	-	-
		2.9	34.5	51.7	-	-	-	34.5	-	-
		0.114	500	750	-	-	-	500	-	-
		3.2	34.5	69.0	-	-	-	34.5	-	-
		0.126	500	1001	-	-	500	-	-	
32 1 ¼	42.4 1.660	1.8	20.7	51.7	-	51.7	-	20.7	-	-
		0.071	300	750	-	750	-	300	-	-
		2.9	34.5	51.7	-	51.7	-	34.5	-	-
		0.114	500	750	-	750	-	500	-	-
		3.6	34.5	69.0	-	51.7	-	34.5	-	-
		0.142	500	1001	-	750	-	500	-	
40 1 ½	48.3 1.900	1.8	34.5	34.5	-	34.5	-	34.5	-	-
		0.071	500	500	-	500	-	500	-	-
		2.9	34.5	51.7	-	51.7	-	34.5	-	-
		0.114	500	750	-	750	-	500	-	-
		3.6	34.5	69.0	-	51.7	-	34.5	-	-
		0.142	500	1001	-	750	-	500	-	
50 2	60.3 2.375	1.8	34.5	34.5	-	34.5	34.5	34.5	24.1	13.8
		0.071	500	500	-	500	500	500	350	200
		2.9	34.5	51.7	41.4	51.7	51.7	34.5	24.1	17.2
		0.114	500	750	600	750	750	500	350	249
		3.6	34.5	69.0	51.7	51.7	69.0	34.5	34.5	20.7
		0.142	500	1001	750	750	1001	500	500	300
65 2 ½	73.0 2.875	2.0	34.5	34.5	-	34.5	34.5	34.5	24.1	13.8
		0.079	500	500	-	500	500	500	350	200
		3.2	34.5	41.3	41.4	41.3	41.3	34.5	24.1	17.2
		0.126	500	599	600		599	500	350	249
		5.0	34.5	69.0	51.7	51.7	69.0	34.5	34.5	20.7
		0.197	500	1001	750	750	1001	500	500	300
65 76.1mm	76.1 3.000	2.0	34.5	34.5	-	34.5	-	34.5	24.1	13.8
		0.079	500	500	-	500	-	500	350	200
		3.2	34.5	41.3	-	41.3	-	34.5	24.1	17.2
		0.126	500	599	-	599	-	500	350	249
		5.0	34.5	69.0	-	51.7	-	34.5	34.5	20.7
		0.197	500	1001	-	750	-	500	500	300
80 3	88.9 3.500	2.0	34.5	34.5	-	34.5	34.5	34.5	24.1	13.8
		0.079	500	500	-	500	500	500	350	200
		3.2	34.5	41.3	41.4	41.3	41.3	34.5	24.1	17.2
		0.126	500	599	600	599	599	500	350	249
		5.6	34.5	69.0	51.7	51.7	69.0	34.5	34.5	20.7
		0.220	500	1001	750	750	1001	500	500	300
100 108.0mm	108.0 4.252	2.0	27.6	-	-	-	-	-	-	-
		0.079	400	-	-	-	-	-	-	-
		3.2	34.5	-	-	-	-	-	-	-
		0.126	500	-	-	-	-	-	-	-
		5.6	34.5	-	-	-	-	-	-	-
		0.220	500	-	-	-	-	-	-	

Working Pressure Ratings Bar (psi) on ISO Size Steel Pipe

(Page 2 of 3)

Pipe Size		Nominal Wall Thickness mm Inches	GRINNELL Coupling Working Pressure Ratings (Bar psi) on Roll Grooved ISO Size Steel Pipe								
mm Inches	O.D.		Fig. 705 Flexible	Fig. 707 Flexible	Fig. 740 Rigid	Fig. 772 Rigid	Fig. 770 Rigid	Fig. 774 Rigid	Fig. 716 Reducing	Fig. 71 Flange	
100 4	114.3 4.500	2.0	27.6	27.6	–	27.6	27.6	27.6	24.1	13.8	
		0.079	400	400	–	400	400	400	350	200	
		3.2	34.5	41.3	34.5	41.3	41.3	41.3	34.5	24.1	17.2
		0.126	500	599	500	599	599	500	350	249	
		5.6	34.5	69.0	51.7	51.7	69.0	34.5	34.5	20.7	
		0.220	300	300	300	300	300	300	300		
125 133.0mm	133.0 5.236	2.9	24.1	–	–	–	–	–	–	–	
		0.114	300	–	–	–	–	–	–	–	
		3.6	31.0	–	–	–	–	–	–	–	
		0.142	300	–	–	–	–	–	–	–	
		6.3	31.0	–	–	–	–	–	–	–	
		0.248	300	–	–	–	–	–	–		
125 139.7mm	139.7 5.500	2.9	24.1	24.1	–	24.1	–	24.1	–	13.8	
		0.114	300	300	–	300	–	300	–	300	
		3.6	31.0	34.5	–	31.0	–	31.0	–	17.2	
		0.142	300	300	–	300	–	300	–	300	
		6.3	31.0	69.0	–	51.7	–	31.0	–	20.7	
		0.248	300	300	–	300	–	300	300		
125 5	141.3 5.563	2.9	24.1	24.1	–	24.1	–	24.1	24.1	13.8	
		0.114	300	300	–	300	–	300	300	300	
		3.6	31.0	34.5	34.5	31.0	–	31.0	24.1	17.2	
		0.142	300	300	300	300	–	300	300	300	
		6.3	31.0	69.0	51.7	51.7	–	31.0	34.5	20.7	
		0.248	300	300	300	300	–	300	300		
150 159.0mm	159.0 6.260	2.9	24.1	–	–	–	–	–	–	–	
		0.114	300	–	–	–	–	–	–	–	
		3.6	31.0	–	–	–	–	–	–	–	
		0.142	300	–	–	–	–	–	–	–	
		7.1	31.0	–	–	–	–	–	–	–	
		0.280	300	–	–	–	–	–	–		
150 165.1mm	165.1 6.500	2.9	24.1	24.1	–	24.1	–	24.1	24.1	13.8	
		0.114	300	300	–	300	–	300	300	300	
		3.6	31.0	31.0	–	34.5	–	31.0	24.1	17.2	
		0.142	300	300	–	300	–	300	300	300	
		7.1	31.0	69.0	–	48.2	–	31.0	27.6	20.7	
		0.280	300	300	–	300	–	300	300		
150 6	168.3 6.625	2.9	24.1	24.1	–	24.1	24.1	24.1	24.1	13.8	
		0.114	300	300	–	300	300	300	300	300	
		3.6	31.0	31.0	34.5	34.5	34.5	31.0	24.1	17.2	
		0.142	300	300	300	300	300	300	300	300	
		7.1	31.0	69.0	48.3	48.2	69.0	31.0	27.6	20.7	
		0.280	300	300	300	300	300	300	300		
200 8	219.1 8.625	2.9	17.2	17.2	–	17.2	17.2	17.2	13.8	13.8	
		0.114	300	300	–	300	300	300	300	300	
		5.0	20.7	20.7	20.7	20.7	20.7	20.7	20.7	13.8	
		0.197	300	300	300	300	300	300	300	300	
		8.0	31.0	55.1	41.4	41.3	55.1	31.0	27.6	20.7	
		0.315	300	300	300	300	300	300	300		

Working Pressure Ratings Bar (psi) on ISO Size Steel Pipe

(Page 3 of 3)

Pipe Size		Nominal Wall Thickness mm Inches	GRINNELL Coupling Working Pressure Ratings (Bar psi) on Roll Grooved ISO Size Steel Pipe							
mm Inches	O.D.		Fig. 705 Flexible	Fig. 707 Flexible	Fig. 740 Rigid	Fig. 772 Rigid	Fig. 770 Rigid	Fig. 774 Rigid	Fig. 716 Reducing	Fig. 71 Flange
250 10	273.0 10.750	3.6	20.7	17.2	–	17.2	17.2	20.7	–	13.8
		0.142	300	300	–	300	300	300	–	300
		5.0	24.1	20.7	–	20.7	20.7	24.1	–	13.8
		0.197	300	300	–	300	300	300	–	300
		8.0	24.1	34.5	–	27.6	55.1	24.1	–	17.2
		0.315	300	300	–	300	300	300	–	300
300 12	323.9 12.750	4.0	13.8	13.8	–	13.8	13.8	13.8	–	13.8
		0.157	300	300	–	300	300	300	–	300
		5.0	20.7	20.7	–	13.8	13.8	20.7	–	13.8
		0.197	300	300	–	300	300	300	–	300
		8.0	24.1	34.5	–	27.6	55.1	24.1	–	17.2
		0.315	300	300	–	300	300	300	–	300
350 14	355.6 14.000	4.0	–	8.6	–	8.6	–	–	–	8.6
		0.157	–	300	–	300	–	–	–	300
		6.3	–	17.2	–	24.1	–	–	–	13.8
		0.248	–	300	–	300	–	–	–	300
		8.8	–	20.7	–	24.1	–	–	–	13.8
		0.346	–	300	–	300	–	–	–	300
400 16	406.4 16.000	9.5	–	24.1	–	24.1	–	–	–	20.7
		0.374	–	300	–	300	–	–	–	300
		4.0	–	6.9	–	6.9	–	–	–	6.9
		0.157	–	300	–	300	–	–	–	300
		6.3	–	20.7	–	24.1	–	–	–	13.8
		0.248	–	300	–	300	–	–	–	300
450 18	457.2 18.000	8.8	–	20.7	–	24.1	–	–	–	13.8
		0.346	–	300	–	300	–	–	–	300
		5.0	–	6.9	–	24.1	–	–	–	13.8
		0.197	–	300	–	300	–	–	–	300
		6.3	–	15.5	–	24.1	–	–	–	13.8
		0.248	–	300	–	300	–	–	300	
500 20	508.0 20.000	8.8	–	20.7	–	24.1	–	–	–	20.7
		0.346	–	300	–	300	–	–	–	300
		5.0	–	3.4	–	3.4	–	–	–	3.4
		0.197	–	300	–	300	–	–	–	300
		6.3	–	6.9	–	13.8	–	–	–	6.9
		0.248	–	300	–	300	–	–	300	
600 24	609.6 24.000	8.8	–	20.7	–	24.1	–	–	–	20.7
		0.346	–	300	–	300	–	–	–	300
		5.0	–	1.7	–	1.7	–	–	–	1.7
		0.197	–	300	–	300	–	–	–	300
		6.3	–	5.2	–	13.8	–	–	–	6.9
		0.248	–	300	–	300	–	–	300	

Working Pressure Ratings Bar (psi) on Light Wall Roll Grooved Steel Pipe

(Page 1 of 2)

Pipe Size		Pipe Schedule	Nominal Wall Thickness mm Inches	GRINNELL Coupling Working Pressure Ratings (Bar PSI) on Light Wall Roll Grooved Steel Pipe					
mm Inches	O.D.			Fig. 705 Flexible	Fig. 774 Rigid	Fig. 707 Flexible	Fig. 772 Rigid	Fig. 716 Reducing	Fig. 71 Flange
25 1	33.7 1.315	5	1.7 0.065	- -	20.7 300	- -	- -	- -	- -
		10	2.8 0.109	- -	20.7 300	- -	- -	- -	- -
32 1 1/4	42.4 1.660	5	1.7 0.065	20.7 300	20.7 300	- -	51.7 750	- -	- -
		10	2.8 0.109	34.5 500	20.7 300	- -	51.7 750	- -	- -
40 1 1/2	48.3 1.900	5	1.7 0.065	34.5 500	20.7 300	34.5 500	34.5 500	24.1 350	- -
		10	2.8 0.109	34.5 500	20.7 300	51.7 750	51.7 750	24.1 350	- -
50 2	60.3 2.375	5	1.7 0.065	34.5 500	20.7 300	34.5 500	34.5 500	24.1 350	13.8 200
		10	2.8 0.109	34.5 500	20.7 300	51.7 750	51.7 750	24.1 350	17.2 250
65 2 1/2	73.0 2.875	5	2.1 0.083	34.5 500	20.7 300	34.5 500	34.5 500	24.1 350	13.8 200
		10	3.0 0.12	34.5 500	20.7 300	41.4 600	41.4 600	24.1 350	17.2 250
80 3	88.9 3.500	5	2.1 0.083	34.5 500	20.7 300	34.5 500	34.5 500	24.1 350	13.8 200
		10	3.0 0.12	34.5 500	20.7 300	41.4 600	41.4 600	24.1 350	17.2 250
100 4	114.3 4.500	5	2.1 0.083	27.6 400	20.7 300	27.6 400	27.6 400	24.1 350	13.8 200
		10	3.0 0.12	34.5 500	20.7 300	41.4 600	41.4 600	24.1 350	17.2 250
125 5	141.3 5.563	5	2.8 0.109	24.1 350	20.7 300	24.1 350	24.1 350	24.1 350	13.8 200
		10	3.4 0.134	31.0 450	20.7 300	34.5 500	31.0 450	24.1 350	17.2 250
150 6	168.3 6.625	5	2.8 0.109	24.1 350	20.7 300	24.1 350	24.1 350	- -	13.8 200
		10	3.4 0.134	31.0 450	20.7 300	31.0 450	34.5 500	- -	17.2 250
200 8	219.1 8.625	5	2.8 0.109	17.2 250	17.2 250	17.2 250	17.2 250	- -	13.8 200
		10	3.8 0.148	20.7 300	20.7 300	20.7 300	20.7 300	- -	13.8 200

Working Pressure Ratings Bar (psi) on Light Wall Roll Grooved Steel Pipe

(Page 2 of 2)

Pipe Size		Pipe Schedule	Nominal Wall Thickness mm Inches	GRINNELL Coupling Working Pressure Ratings (Bar PSI) on Light Wall Roll Grooved Steel Pipe					
mm Inches	O.D.			Fig. 705 Flexible	Fig. 774 Rigid	Fig. 707 Flexible	Fig. 772 Rigid	Fig. 716 Reducing	Fig. 71 Flange
250 10	273.0 10.750	5	3.4 0.134	20.7 300	- -	17.2 250	17.2 250	- -	13.8 200
		10	4.2 0.165	24.1 350	- -	20.7 300	20.7 300	- -	13.8 200
300 12	323.9 12.750	5	4.0 0.156	20.7 300	- -	13.8 200	13.8 200	- -	13.8 200
		10	4.6 0.18	24.1 350	- -	20.7 300	13.8 200	- -	13.8 200
350 14	355.6 14.000	5	4.0 0.156	- -	- -	8.6 125	- -	- -	- -
		10	6.4 0.25	- -	- -	17.2 250	- -	- -	- -
		20	7.9 0.312	- -	- -	19.0 275	- -	- -	- -
400 16	406.4 16.000	5	4.2 0.165	- -	- -	6.9 100	- -	- -	- -
		10	6.4 0.25	- -	- -	12.1 175	- -	- -	- -
		20	7.9 0.312	- -	- -	19.0 275	- -	- -	- -
450 18	457.2 18.000	10	6.4 0.25	- -	- -	6.9 100	- -	- -	- -
		20	7.9 0.312	- -	- -	12.1 175	- -	- -	- -
500 20	508.0 20.000	10	6.4 0.25	- -	- -	6.9 100	- -	- -	- -
		20 (Std.)	9.5 0.375	- -	- -	20.7 300	- -	- -	- -
600 24	609.6 24.000	10	6.4 0.25	- -	- -	5.2 75	- -	- -	- -
		20 (Std.)	9.5 0.375	- -	- -	17.2 250	- -	- -	- -

Maximum Pressure Ratings Bar (psi) on ANSI 304/316 Stainless Steel

(Page 1 of 2)

Pipe Size		Pipe Schedule	Wall Thickness mm In.	Maximum Pressure Ratings (Bar psi) on ANSI 304/316 Stainless Steel							
Nominal DN In.	O.D. mm In.			Figure 705	Figure 774	Figure 707	Figure 772	Figure 405	Figure 472	Figure 770	Figure 71
25 1	33.7 1.315	5	1.7 0.065	24.1 350	20.7 300	27.6 400	– –	24.1 350	– –	– –	– –
		10	2.8 0.109	34.5 500	20.7 300	34.5 500	– –	34.5 500	– –	– –	– –
		40	3.4 0.133	51.7 750	20.7 300	51.7 750	– –	51.7 750	– –	– –	– –
32 1 ¼	42.4 1.660	5	1.7 0.065	22.4 325	20.7 300	27.6 400	27.6 400	24.1 350	24.1 350	– –	– –
		10	2.8 0.109	34.5 500	20.7 300	34.5 500	51.7 750	34.5 500	34.5 500	– –	– –
		40	3.6 0.140	51.7 750	20.7 300	51.7 750	51.7 750	51.7 750	51.7 750	– –	– –
40 1 ½	48.3 1.900	5	1.7 0.065	22.4 325	20.7 300	27.6 400	27.6 400	24.1 350	24.1 350	– –	– –
		10	2.8 0.109	34.5 500	20.7 300	34.5 500	51.7 750	34.5 500	34.5 500	– –	– –
		40	3.7 0.145	44.8 650	20.7 300	51.7 750	51.7 750	51.7 750	51.7 750	– –	– –
50 2	60.3 2.375	5	1.7 0.065	17.2 250	17.2 250	22.4 325	24.1 350	24.1 350	24.1 350	24.1 350	12.1 175
		10	2.8 0.109	34.5 500	20.7 300	34.5 500	48.3 700	34.5 500	34.5 500	51.7 750	19.0 275
		40	3.9 0.154	34.5 500	20.7 300	51.7 750	51.7 750	34.5 500	41.4 600	51.7 750	19.0 275
65 2 ½	73.0 2.875	5	2.1 0.083	17.2 250	17.2 250	22.4 325	24.1 350	24.1 350	24.1 350	24.1 350	12.1 175
		10	3.0 0.120	34.5 500	20.7 300	34.5 500	48.3 700	34.5 500	34.5 500	51.7 750	19.0 275
		40	5.2 0.203	34.5 500	20.7 300	51.7 750	51.7 750	34.5 500	41.4 600	51.7 750	19.0 275
80 3	88.9 3.500	5	2.1 0.083	17.2 250	17.2 250	22.4 325	24.1 350	24.1 350	24.1 350	24.1 350	12.1 175
		10	3.0 0.120	27.6 400	20.7 300	34.5 500	34.5 500	34.5 500	34.5 500	51.7 750	19.0 275
		40	5.5 0.216	34.5 500	20.7 300	51.7 750	51.7 750	34.5 500	41.4 600	51.7 750	19.0 275
100 4	114.3 4.500	5	2.1 0.083	13.8 200	13.8 200	17.2 250	20.7 300	20.7 300	20.7 300	20.7 300	12.1 175
		10	3.0 0.120	27.6 400	20.7 300	34.5 500	34.5 500	27.6 400	27.6 400	51.7 750	19.0 275
		40	6.0 0.237	34.5 500	20.7 300	51.7 750	51.7 750	34.5 500	41.4 600	51.7 750	19.0 275

Maximum Pressure Ratings Bar (psi) on ANSI 304/316 Stainless Steel

(Page 2 of 2)

Pipe Size		Pipe Schedule	Wall Thickness mm In.	Maximum Pressure Ratings (Bar psi) on ANSI 304/316 Stainless Steel							
Nominal DN In.	O.D. mm In.			Figure 705	Figure 774	Figure 707	Figure 772	Figure 405	Figure 472	Figure 770	Figure 71
125 5	141.3 5.563	5	2.8 0.109	8.6 125	8.6 125	13.8 200	17.2 250	17.2 250	17.2 250	17.2 250	8.6 125
		10	3.4 0.134	24.1 350	20.7 300	34.5 500	34.5 500	24.1 350	24.1 350	24.1 350	13.8 200
		40	6.6 0.258	31.0 450	20.7 300	44.8 650	44.8 650	31.0 450	41.4 600	51.7 750	17.2 250
150 6	168.3 6.625	5	2.8 0.109	5.2 75	5.2 75	8.6 125	17.2 250	17.2 250	17.2 250	17.2 250	5.2 75
		10	3.4 0.134	13.8 200	13.8 200	20.7 300	20.7 300	17.2 250	20.7 300	24.1 350	8.6 125
		40	7.1 0.280	20.7 300	20.7 300	34.5 500	31.0 450	31.0 450	41.4 600	51.7 750	10.3 150
200 8	219.1 8.625	5	2.8 0.109	3.4 50	3.4 50	5.2 75	6.9 100	6.9 100	6.9 100	6.9 100	3.4 50
		10	3.8 0.148	13.8 200	13.8 200	20.7 300	20.7 300	13.8 200	20.7 300	24.1 350	5.2 75
		40	8.2 0.322	20.7 300	20.7 300	27.6 400	31.0 450	31.0 450	41.4 600	44.8 650	8.6 125
250 10	273.0 10.750	5	3.4 0.134	N/R N/R	N/R N/R	N/R N/R	N/R N/R	- -	N/R N/R	N/R N/R	N/R N/R
		10	4.2 0.165	5.2 75	5.2 75	8.6 125	20.7 300	- -	20.7 300	20.7 300	5.2 75
		40	9.3 0.365	5.2 75	5.2 75	22.4 325	31.0 450	- -	41.4 600	41.4 600	8.6 125
300 12	323.9 12.750	5	4.0 0.156	N/R N/R	N/R N/R	N/R N/R	10.3 150	- -	10.3 150	20.7 300	N/R N/R
		10	4.6 0.180	3.4 50	5.2 75	8.6 125	10.3 150	- -	10.3 150	17.2 250	3.4 50
		40	9.5 0.375	3.4 50	5.2 75	17.2 250	27.6 400	- -	41.4 600	41.4 600	8.6 125

Maximum Pressure Ratings Bar (psi) on ISO 304/316 Stainless Steel

(Page 1 of 2)

Pipe Size		Pipe Thickness Wall mm	Maximum Pressure Ratings (Bar psi) on ISO 304/316 Stainless Steel							
Nominal DN In.	O.D. mm In.		Figure 705	Figure 774	Figure 707	Figure 772	Figure 405	Figure 472	Figure 770	Figure 71
25 1	33.7 1.315	2.0	24	21	28	–	24	–	–	–
		0.079	350	300	400	–	350	–	–	–
		2.8	34	21	34	–	34	–	–	–
		0.110	500	300	500	–	500	–	–	–
		3.4	52	21	52	–	52	–	–	–
	0.134	750	300	750	–	750	–	–	–	
32 1 ¼	42.4 1.660	2.0	22	21	28	28	24	24	–	–
		0.079	325	300	400	400	350	350	–	–
		2.8	34	21	34	52	34	34	–	–
		0.110	500	300	500	750	500	500	–	–
		3.6	52	21	52	52	52	52	–	–
	0.142	750	300	750	750	750	750	–	–	
40 1 ½	48.3 1.900	2.0	22	21	28	28	24	24	–	–
		0.079	325	300	400	400	350	350	–	–
		2.8	34	21	34	52	34	34	–	–
		0.110	500	300	500	750	500	500	–	–
		3.7	45	21	52	52	52	52	–	–
	0.146	650	300	750	750	750	750	–	–	
50 2	60.3 2.375	2.0	17	17	22	24	24	24	24	12
		0.079	250	250	325	350	350	350	350	175
		2.8	34	21	34	48	34	34	52	19
		0.110	500	300	500	700	500	500	750	275
		3.9	34	21	52	52	34	41	52	19
	0.154	500	300	750	750	500	600	750	275	
65 2 ½	73.0 2.875	2.0	17	17	22	24	24	24	24	12
		0.079	250	250	325	350	350	350	350	175
		3.0	34	21	34	48	34	34	52	19
		0.118	500	300	500	700	500	500	750	275
		5.2	34	21	52	52	34	41	52	19
	0.205	500	300	750	750	500	600	750	275	
65 76.1mm	76.1 3.000	2.0	17	17	22	24	24	24	–	12
		0.079	250	250	325	350	350	350	–	175
		3.0	28	21	34	34	34	34	–	19
		0.118	400	300	500	500	500	500	–	275
		5.2	34	21	52	52	34	41	–	19
	0.205	500	300	750	750	500	600	–	275	
80 3	88.9 3.500	2.0	17	17	22	24	24	24	24	12
		0.079	250	250	325	350	350	350	350	175
		3.0	28	21	34	34	34	34	52	19
		0.118	400	300	500	500	500	500	750	275
		5.5	34	21	52	52	34	41	52	19
	0.217	500	300	750	750	500	600	750	275	
100 4	114.3 4.500	2.0	14	14	17	21	21	21	21	12
		0.079	200	200	250	300	300	300	300	175
		3.0	28	21	34	34	28	28	52	19
		0.118	400	300	500	500	400	400	750	275
		6.0	34	21	52	52	34	41	52	19
	0.236	500	300	750	750	500	600	750	275	

Maximum Pressure Ratings Bar (psi) on ISO 304/316 Stainless Steel

(Page 2 of 2)

Pipe Size		Pipe Thickness Wall mm	Maximum Pressure Ratings (Bar psi) on ISO 304/316 Stainless Steel							
Nominal DN In.	O.D. mm In.		Figure 705	Figure 774	Figure 707	Figure 772	Figure 405	Figure 472	Figure 770	Figure 71
125 139.7mm	139.7 5.500	2.8	9	9	14	17	17	17	–	9
		0.110	125	125	200	250	250	250	–	125
		3.4	24	21	34	34	24	24	–	14
		0.134	350	300	500	500	350	350	–	200
		6.4	31	21	45	45	31	41	–	17
		0.252	450	300	650	650	450	600	–	250
125 5	141.3 5.563	2.8	9	9	14	17	17	17	17	9
		0.110	125	125	200	250	250	250	250	125
		3.4	24	21	34	34	24	24	24	14
		0.134	350	300	500	500	350	350	350	200
		6.6	31	21	45	45	31	41	52	17
		0.260	450	300	650	650	450	600	750	250
150 165.1mm	165.1 6.500	2.8	5	5	9	17	17	17	–	5
		0.110	75	75	125	250	250	250	–	75
		3.4	14	14	21	21	17	21	–	9
		0.134	200	200	300	300	250	300	–	125
		7.1	21	21	34	31	31	41	–	10
		0.280	300	300	500	450	450	600	–	150
150 6	168.3 6.625	2.8	5	5	9	17	17	17	17	5
		0.110	75	75	125	250	250	250	250	75
		3.4	14	14	21	21	17	21	24	9
		0.134	200	200	300	300	250	300	350	125
		7.1	21	21	34	31	31	41	52	10
		0.280	300	300	500	450	450	600	750	150
200 8	219.1 8.625	2.8	3	3	5	7	7	7	7	3
		0.110	50	50	75	100	100	100	100	50
		3.8	14	14	21	21	14	21	24	5
		0.150	200	200	300	300	200	300	350	75
		8.2	21	21	28	31	31	41	45	9
		0.323	300	300	400	450	450	600	650	125
250 10	273.0 10.750	3.4	N/R	N/R	N/R	N/R	–	N/R	N/R	N/R
		0.134	N/R	N/R	N/R	N/R	–	N/R	N/R	N/R
		4.2	5	5	9	21	–	21	21	5
		0.165	75	75	125	300	–	300	300	75
		9.3	5	5	22	31	–	41	41	9
		0.366	75	75	325	450	–	600	600	125
300 12	323.9 12.750	4.0	N/R	N/R	N/R	10	–	10	21	NR
		0.157	N/R	N/R	N/R	150	–	150	300	
		4.6	3	5	9	10	–	10	17	3
		0.181	50	75	125	150	–	150	250	50
		9.5	3	5	17	28	–	41	41	9
		0.374	50	75	250	400	–	600	600	125

Global Pipe Size Designations

GRINNELL Mechanical Products product data is utilized worldwide and all technical data is shown in both metric and imperial terms. The following chart shows a comparison between typical metric and IPS pipe sizes.

Nominal Size (DN)		Outside Diameter (OD)								
Inches (Imperial)	mm (Metric)	mm (Specification Reference)	DIN mm	BS mm	ISO mm	JIS mm	ANSI Inches	GB China mm	India	
									IS 1239	IS3589
1/2	15	21.3mm	DN 15	DN 15	DN 15	21.7mm	1/2	DN 15	DN 15	-
3/4	20	26.7mm	26.9mm	DN 20	DN 20	27.2mm	3/4	DN 20	DN 20	-
1	25	33.4mm	33.7mm	DN 25	DN 25	34mm	1	DN 25	DN 25	-
1 1/4	32	42.2mm	42.4mm	DN 32	DN 32	42.7mm	1 1/4	DN 32	DN 32	-
1 1/2	40	48.3mm	DN 40	DN 40	DN 40	48.6mm	1 1/2	DN 40	DN 40	-
2	50	60.3mm	DN 50	DN 50	DN 50	60.5mm	2	DN 50	DN 50	-
2 1/2	65	73.1mm	-	-	-	-	2 1/2	-	-	-
		76.1mm BS/ISO	76.1mm	76.1mm	76.1mm	76.3mm	-	76.1mm **	76.1mm	-
3	80	88.9mm	DN 80	DN 80	DN 80	DN 80	3	DN 80	DN 80	-
3 1/2	90	101.6mm	-	-	-	-	-	-	-	-
4	100	108mm China (& old DIN)	DIN 133mm	-	-	-	-	108mm **	-	-
		114.3mm	DN 100	DN 100	DN 101	DN 100	4	DN 100	DN 100	-
-	127mm	127mm	-	-	-	-	-	-	-	-
5	125	133mm China	-	-	-	-	-	133mm **	-	-
		139.7mm BS/ISO	DN 125	139.7mm	139.7mm	139.8mm	-	139.7mm	139.7mm	-
		141.3mm	-	-	-	-	5	-	-	-
-	152.4mm	152.4mm	-	-	-	-	-	-	-	-
6	150	159mm China	-	-	-	-	-	159mm	-	-
		165.1mm JIS/BS	-	165.1mm	-	165.2mm	-	-	165.1mm	-
		168.3mm	DN 150	-	DN 150	-	6	DN 150	-	DN 150
-	175	193.7mm	-	-	-	-	-	-	-	193.7mm
-	203.2mm	203.2mm	-	-	-	-	-	-	-	-
8	200	216.3mm JIS	-	-	-	216.3mm	-	-	-	-
		219.1mm	DN 200	DN 200	DN 200	-	8	DN 200	DN 200	DN 200
-	254mm	254mm	-	-	-	-	-	-	-	-
10	250	267.4mm JIS	-	-	-	267.4mm	-	-	-	-
		273mm	DN 250	DN 250	DN 250	-	10	DN 250	DN 250	DN 250
-	304.8mm	304.8mm	-	-	-	-	-	-	-	-
12	300	318.5mm JIS	-	-	-	318.5mm	-	-	-	-
		323.9mm	DN 300	DN 300	DN 300	-	12	-	-	-
14	350	355.6mm	DN 350	DN 350	DN 350	DN 350	14	DN 350	-	-
		377mm China	-	-	-	-	-	377mm	-	-
16	400	406.4mm	DN 400	DN 400	DN 400	DN 400	16	DN 400	-	-
		426mm China	-	-	-	-	-	426mm	-	-
18	450	457.2mm	DN 450	DN 450	DN 450	DN 450	18	DN 450	-	-
		480mm China	-	-	-	-	-	480mm	-	-
20	500	508mm	DN 500	DN 500	DN 500	DN 500	20	DN 500	-	-
		530mm China	-	-	-	-	-	530mm	-	-
22	550	558.8mm	-	-	-	DN 550	22	559mm	-	-
		580mm China	-	-	-	-	-	580mm	-	-
24	600	610mm	DN 600	DN 600	DN 600	DN 600	24	DN 600	-	-
		630mm China	-	-	-	-	-	630mm	-	-


IMPORTANT NOTE:

Nominal designations are used where the actual OD of the pipe matches the ANSI size.
Otherwise both the nominal and actual OD are listed.

China sizes are listed as actual OD in mm.

** China sizes are tubing sizes.

Flange Drilling Specifications

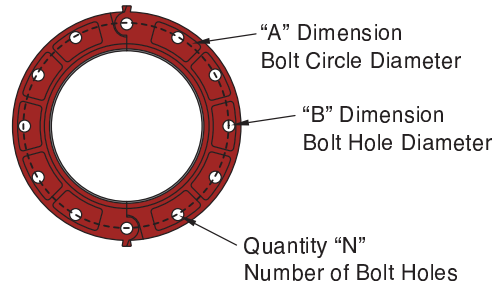

Valve Size		ANSI B16.1 (Class 125#) ¹			ISO 2084 (PN10) ²			ISO 2084 (PN16) ³		
		Dimensions - mm Inches								
Nominal mm Inches	O.D. mm Inches	A	B	Qty. N	A	B	Qty. N	A	B	Qty. N
50 2	60.3 2.375	120.6 4.75	19.0 0.75	4	125.0 4.92	18.0 0.71	4	125.0 4.92	18.0 0.71	4
65 2½	73.0 2.875	139.7 5.50	19.0 0.75	4	145.0 5.71	18.0 0.71	4	145.0 5.71	18.0 0.71	4
80 3	88.9 3.500	152.4 6.00	19.0 0.75	4	160.0 6.30	18.0 0.71	8	160.0 6.30	18.0 0.71	8
100 4	114.3 4.500	190.5 7.50	19.1 0.75	8	180.0 7.09	18.0 0.71	8	180.0 7.09	18.0 0.71	8
125 5	141.3 5.563	215.9 8.50	22.4 0.88	8	210.0 8.27	18.0 0.71	8	210.0 8.27	18.0 0.71	8
150 6	168.3 6.625	241.3 9.50	22.4 0.88	8	240.0 9.45	22.0 0.87	8	240.0 9.45	22.0 0.87	8
200 8	219.1 8.625	298.5 11.75	22.2 0.88	8	295.0 11.61	22.0 0.87	8	295.0 11.61	22.0 0.87	12
250 10	273.0 10.750	362.0 14.25	25.4 1.00	12	350.0 13.78	22.0 0.87	12	355.0 13.98	26.0 1.02	12
300 12	323.9 12.750	431.8 17.00	25.4 1.00	12	400.0 15.75	22.0 0.87	12	410.0 16.14	26.0 1.02	12
350 14	355.6 14.000	476.5 18.76	28.4 1.12	12	460.0 18.11	22.0 0.87	16	470.0 18.50	26.0 1.02	16
400 16	406.4 16.000	539.8 21.25	28.4 1.12	16	515.0 20.28	26.0 1.02	16	525.0 20.67	30.0 1.18	16
450 18	457.2 18.000	577.9 22.75	31.8 1.25	16	565.0 22.24	26.0 1.02	20	585.0 23.03	30.0 1.18	20
500 20	508.0 20.000	635.0 25.00	31.8 1.25	20	620.0 24.41	26.0 1.02	20	650.0 25.59	33.0 1.30	20
600 24	609.6 24.000	749.3 29.50	35.1 1.38	20	725.0 28.54	30.0 1.18	20	770.0 30.31	36.0 1.42	20

1 Same drilling as for B16.5 (Class 150#) and B16.42 (Class 250#).
 2 Same drilling as for BS 4504 Section 3.2 (PN10) and DIN 2532 (PN10).
 3 Same drilling as for BS 4504 Section 3.2 (PN16) and DIN 2532 (PN16).
 For additional information, contact a GRINNELL Sales Representative.

Metric/Imperial Conversion Chart

This chart is provided as a guide for converting metric and imperial measurements.

Convert Metric to Imperial			Convert Imperial to Metric		
Millimeters (mm)	X	0.03937	Inches (in)	X	25.4
Meters (m)	X	3.281	Feet (ft)	X	0.3048
Kilograms (kg)	X	2.205	Pounds (lb)	X	0.4536
Grams (g)	X	0.03527	Ounces (oz)	X	28.35
Kilopascals (kPa)	X	0.145	Pressure (psi)	X	6.894
Bar	X	14.5	Pressure (psi)	X	0.069
Newtons (N)	X	0.2248	End Load (lb)	X	4.45
Newton Meters (N·m)	X	0.738	Torque (lbf)	X	1.356
Celsius (°C)		$(C + 17.78) \times 1.8$	Temp. (°F)		$(F - 32) \div 1.8$
Watts (w)	X	1.341×10^{-3}	Horsepower (hp)	X	745.7
Liters per min. (L/M)	X	0.2642	Gal. per Min. (gpm)	X	3.785
Cubic Meters per min. (m ³ /m)	X	264.2	10 ⁻³ Gal. per Min. (gpm)	X	3.7865

Typical General Specification (CSI - Div. 15, Section A Info., Methods, & Instructions)

Section 1 - Grooved Piping Method

GRINNELL grooved pipe couplings, grooved end fittings, grooved end butterfly and check valves, and other system components as manufactured or supplied by Tyco Fire Protection Products shall be used to install piping systems and make mechanical equipment connections in systems within specified operating conditions and working pressures as shown in the coupling manufacturer's product specification. GRINNELL grooved pipe couplings shall be used for the following systems (subject to applicable local code approval).

Heating / Air Conditioning

Chilled Water
Hot Water
Condenser
Water Heating
Cooling Tower
Dual Temperature
Machinery Room
Utility Water

Plumbing

Domestic Hot Water
Domestic Cold Water
Roof Drains/Storm Drains

Other

Vacuum
Lubrication
Air
Pneumatic Conveyor
Elevator Hydraulic
Low Temperature

Typical Guide Specification

Basic Materials & Methods (CSI - Div. 15 Section 15050)

Section 1 - Materials - Pipe & Pipe Fittings

1.1 Pipe - Pipe shall conform to GRINNELL published tolerance specifications. Steel pipe shall be black or galvanised, conforming to ASTM A-135, A-795 or A-53.

1.2 Couplings - Couplings shall be GRINNELL Figures 705, 707, 772 and 716 cast in ductile iron as specified in ASTM A-536. Couplings shall have nuts and bolts. Couplings shall be coated with a lead free paint as standard, or hot-dipped galvanised in accordance with ASTM A-153 as an option. Couplings shall be GRINNELL Figures 405 and 472 cast in Stainless Steel as specified in ASTM A-743/A-743M. Couplings shall have nuts and bolts.

1.2.1 Gaskets - Gaskets shall be a pressure responsive design, moulded of synthetic elastomer as designated by ASTM D-2000, and shall conform to the coupling housing and pipe outside diameter. Reference shall be made to the latest published GRINNELL gasket selection guide for proper gasket selection for the intended service.

1.2.1.1 Water Service - Gasket shall be Grade "E" EPDM with green colour code identification, for service temperatures from -34°C to 110°C (-30°F to 230°F). Recommended for hot water not to exceed 110°C (230°F), plus a variety of dilute acids, oil free air and many chemical services. Not recommended for petroleum services or steam.

1.2.1.2 Oil Service - Gasket shall be grade "T" Nitrile with orange colour code identification, for service temperatures from -29°C to 82°C (-20°F to 180°F). Recommended for petroleum products, vegetable oils, mineral oils, and air with oil vapors

1.2.1.3 Other Services - Refer to the latest published GRINNELL gasket selection guide for other service recommendations.

1.2.2 Bolts and Nuts - Shall be heat treated carbon steel, ovalneck track head bolts and heavy hex nuts, conforming to the physical properties of ASTM A-183 with a minimum tensile strength of 7584 Bar (110,000 psi). Bolts and nuts shall be zinc electroplated.

1.3 Flanges - Shall be GRINNELL Figure 71 Flange, casting in ductile iron in accordance with ASTM A-536. Flange shall conform to ANSI Class 125 and 150 bolt patterns and shall be coated with a lead-free paint as standard, or hot dipped galvanised in accordance to ASTM A-153.

1.4 Fittings - Shall be ASTM A-536 ductile iron or fabricated from steel pipe, 32mm - 600mm (1 1/4" - 24"). All fittings shall be coated with a lead-free paint as standard, or hot-dipped galvanised as an option in accordance to ASTM A-153.

1.5 Branch Outlets - Shall be GRINNELL Figure 730 mechanical tees or crosses with integral gasket. Figure 730 shall be coated with a lead-free paint as standard, or hot-dipped galvanised as an option.

1.6 Butterfly Valves - Shall be with grooved ends. Valves shall have encapsulated Grade "E" EPDM or Grade "T" Nitrile disc and rated at 20.7 Bar (300 psi) bubble-tight-shut-off. Reference shall be made to the latest published GRINNELL gasket selection guide for proper disc seal selection for the intended service. Valve bodies shall be ductile iron, and upper stems shall be stainless steel.

1.7 Check Valves - Shall be with grooved ends. Valves shall have a resilient elastomer seal Grade "E" EPDM or Grade "T" Nitrile and rated at 20.7 Bar (300 psi). Reference shall be made to the latest published GRINNELL gasket selection guide for proper seal selection for the intended service. Valve bodies shall be ductile iron with a nickel seat. The caps shall be ductile iron with an attached stainless steel clapper assembly for 60.3mm - 219.1mm (2" - 8") and a ductile iron clapper assembly for 273.0mm - 323.9mm (10" - 12"). All bodies and caps shall be coated with a lead-free paint as standard.

Section 2 - Materials - Pipe Preparation

Pipe shall be prepared according to GRINNELL published specifications, ANSI/AWWA C-606, or other applicable standards.

2.1 Pipe Ends - Shall be clean and free from indentations, projections, burrs, rust or roll marks in the area from pipe end to groove.

2.1.1 Standard Weight Pipe - Shall be roll grooved without removing metal, or cut grooved in accordance with GRINNELL published standard roll groove or standard cut groove specifications.

2.1.2 Lightwall Pipe - Shall be roll grooved without metal removal in accordance with GRINNELL published standard roll groove specifications.

SECTION 3 - ASSEMBLY

3.1 GRINNELL couplings, fittings, flanges and valves shall be assembled in accordance with instructions published

by Tyco Fire Protection Products.

3.1.1 Pipe - Ends shall be clean and free from indentations, projections, burrs, roll marks, etc., in the area from pipe end to groove. Pipe ends shall be square cut and prepared in accordance with standard GRINNELL specifications.

3.1.2 Gasket - Shall be of pressure responsive design verified as proper style and grade suitable for the intended service as published in the latest GRINNELL gasket recommendation technical literature.

3.1.3 Lubrication - A thin, uniform coat of GRINNELL lubricant shall be applied to the entire exterior of the gasket, including the gasket lips. Complete lubrication is essential to prevent gasket pinching and to ease installation and alignment. Petroleum-free silicone gasket lubricant is recommended when gaskets are subject to low temperature conditions. Petroleum lubricants shall not be used for EPDM gaskets.

SECTION 4 - SUPPORT

4.1 Horizontal Piping: (Contact Tyco Fire Protection Products for support recommendations)

4.1.1 Flexible Connections - No pipe length shall be left unsupported between any two couplings, nor shall any pipe be left unsupported whenever a change in direction of line flow takes place. Supports shall meet the requirements stated above, but in no case shall the distance between supports exceed the following for systems where linear movement is not required:

Distance Between Supports	
Nominal Size mm Inches	Span Meters Feet
42.4 - 48.3 1 1/4 - 1 1/2	3.7 12
60.3 - 219.1 2 - 8	4.6 15
273.0 - 323.9 10 - 12	4.9 16
355.6 - 406.4 14 - 16	5.5 18
457.2 - 609.6 18 - 24	6.1 20
Note: The requirements of ANSI, ASME or other code groups may require additional supports.	

4.1.2 Rigid Connections - Pipe connections formed with the Figure 772 shall be supported in accordance with applicable ANSI B31.1, Power Piping Code; ANSI B31.9, Building Service Pipe Code.

Typical Specifications

Building Service Systems - Plumbing

Plumbing Specifications (CSI - Div. 15 Section 15-E Plumbing)

SECTION 1 - DOMESTIC WATER SYSTEMS

(CSI - Div. 15, Section 15-E Water Supply Systems) GRINNELL Mechanical Grooved Pipe couplings, fittings and butterfly valves as manufactured or supplied by Tyco Fire Protection Products shall be used for all water supply systems under operating conditions not to exceed 110°C (230°F) temperature. The coupling gasket and encapsulated disc on butterfly valves shall be Grade "E" EPDM.

1.1 Materials:

1.1.1 Pipe - Pipe shall be galvanised steel pipe, conforming to ASTM A-135, A-795 or A-53. All pipe shall be prepared according to GRINNELL published specifications, or to ANSI/AWWA C-606 grooved end pipe. Pipe ends shall be prepared as detailed in Basic Materials and Methods and to the latest GRINNELL published specifications.

1.1.2 Couplings - All GRINNELL grooved couplings and fittings shall be painted or galvanised Figure 705, 707, 772 or 716 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

1.1.3 Branch Connections - Shall be made with Figure 730 and/or Figure 522.

1.1.4 Flange Connections - Flange connections shall be GRINNELL Figure 71 Flanges incorporating Grade "E" EPDM gasket.

1.1.5 Fittings - Fittings shall be painted or galvanised GRINNELL standard ductile iron or segmentally welded steel fittings, with grooved ends.

1.1.6 Butterfly Valves - Shall be of grooved end design with a Grade "E" EPDM encapsulated disc. Upper stem shall be stainless steel. Valves shall have pressure assisted double seal and be capable of 300 psi, bubble-tight-shutoff. Butterfly valves shall be with gear actuator or hand lever. Operating conditions not to exceed -34°C to 110°C (-30°F to 230°F).

1.1.7 Check Valves - Shall be of grooved end design with a clapper seal of Grade "E" EPDM. Valves shall be capable of pressures of 300 psi. The valves shall have a spring loaded clapper to ensure a leak tight seal and a nonsticking operation. The clapper seat in the valve body shall be nickel. Operating conditions not to exceed -34°C to 110°C (-30°F to 230°F).

SECTION 2 - STORM DRAINS / ROOF DRAINS

GRINNELL mechanical grooved pipe couplings and fittings as manufactured by Tyco Fire Protection Products shall be used for all storm and roof drainage systems.

2.1 Materials:

2.1.1 Pipe - Pipe shall be galvanised steel pipe, conforming to ASTM A-135, A-795 or A-53. All pipe shall be prepared according to GRINNELL published specifications, or to ANSI/AWWA grooved end pipe. Pipe

ends shall be prepared as detailed in Basic Materials and Methods and to the latest GRINNELL published specifications.

2.1.2 Couplings - Couplings shall be galvanised Figure 705, 707, 772 or 716 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

2.1.3 Flange Connections - Flange connections shall be galvanised GRINNELL Figure 71 Flanges incorporating Grade "E" EPDM gasket.

2.1.4 Fittings - Fittings shall be galvanised GRINNELL standard ductile iron or segmentally welded steel fittings, with grooved ends.

2.2 Plastic Pipe Systems

2.2.1 Pipe - Pipe with material and dimensions conforming to ASTM D-1785 Type 1, Grade 1 with cut grooves and joint pressure ratings conforming to grooved manufacturer's specifications or recommendations; or Type 2, Grade 1 with rolled or radius cut grooves and joint ratings conforming to grooved manufacturer's specifications and recommendations.

2.2.2 Couplings - Flexible type couplings shall be used.

2.2.3 Flange Connections - Same as in 2.1.3

2.2.4 Fittings - Same as in 2.1.4

SECTION 3 - VENT PIPING

(Same as in Section 2 - Storm Drains / Roof Drains)

Typical Specifications

Building Service Systems - Cooling

Cooling System Specifications (CSI - Div. 15 Section 15-N Refrigeration Systems)

SECTION 1 - CHILLED WATER - SUPPLY & RETURN

GRINNELL Mechanical Grooved Pipe couplings, fittings and butterfly and check valves as manufactured or supplied by Tyco Fire Protection Products shall be used for cooling system chilled water piping, including risers, mains, equipment connection, branches, supply and return lines under operating conditions not to exceed -34°C to 110°C (-30°F to 230°F) temperature. Calculations shall be made based on coupling manufacturers latest literature to determine expansion/ contraction allowance available, enabling elimination of special movement compensators, swing joints, flexible connections and vibration isolators where possible.

1.1 Materials:

1.1.1 Pipe - Shall be steel pipe, conforming to ASTM A-135, A-795 or A-53. All pipe shall be prepared according to GRINNELL published specifications, or to ANSI/AWWA C-606 grooved end pipe. Pipe ends shall be prepared as detailed in Basic Materials and Methods.

1.1.2 Couplings - All flexible couplings shall be GRINNELL Figure 705 and 707 with Grade "E" EPDM gaskets and zinc plated bolts and nuts. All rigid couplings shall be GRINNELL Figure 772 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

1.1.3 Branch Connections - Branch stub-in connections shall be made with Figure 730 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

1.1.4 Flange Connections - Shall be GRINNELL Figure 71 Flange incorporating Grade "E" EPDM gasket.

1.1.5 Fittings - Shall be GRINNELL ductile iron or segmentally welded steel fittings, with grooved ends.

1.1.6 Butterfly Valves - Shall be of grooved end design with EPDM encapsulated disc. Neck design shall readily accommodate insulation. Valves shall have pressure assisted double seal and stainless steel upper stems, and be capable of 20.7 Bar (300 psi), bubble-tight-shut-off, with an actuator or hand lever.

1.1.7 Check Valves - Shall be of grooved end design with a clapper seal of EPDM. The valves shall have a spring loaded clapper to ensure a leak tight seal and a non-sticking operation. The clapper seat in the valve body shall be nickel. Valves shall be capable of pressures of 20.7 Bar (300 psi).

SECTION 2 - COOLING TOWER PIPING

Same as Section 1, except pipe, couplings and fittings shall be galvanised.

SECTION 3 - DUAL TEMPERATURE SYSTEMS PIPING

Same as Section 1.

SECTION 4 - CONDENSER WATER PIPING

Same as Section 1.

Typical Specifications

Building Service Systems - Heating

Heating System Specifications

(CSI - Div. 15 Section 15-L Water Piping)

SECTION 1 - HOT WATER HEATING SYSTEMS - SUPPLY & RETURN

GRINNELL Mechanical Grooved Pipe couplings, fittings and butterfly and check valves as manufactured or supplied by Tyco Fire Protection Products shall be used for hot water systems, including boiler manifolds, mains, risers, branches, supply and return lines, under operating conditions not to exceed 110°C (230°F). Calculations shall be based on coupling manufacturers latest literature to determine expansion allowance available, enabling elimination of special expansion compensators, swing joints, flexible connections and vibration isolators where possible.

1.1 Materials:

1.1.1 Pipe - Shall be steel pipe, conforming to ASTM A-135, A-795 or A-53. All pipe shall be prepared according to GRINNELL published specifications, or to ANSI/AWWA C-606 grooved end pipe. Pipe ends shall be prepared as detailed in Basic Materials and Methods.

1.1.2 Couplings - All flexible couplings shall be GRINNELL Figure 705 and 707 with Grade "E" EPDM gaskets and zinc plated bolts and nuts. All rigid couplings shall be GRINNELL Figure 772 with Grade "E" EPDM gaskets and zinc plated bolts and nuts. All reducing couplings shall be GRINNELL Figure 716 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

1.1.3 Branch Connections - Branch stub-in connections shall be made with GRINNELL Figure 730 with Grade "E" EPDM gaskets and zinc plated bolts and nuts.

1.1.4 Flange Connections

- Flange connections shall be GRINNELL Figure 71 Flange incorporating Grade "E" EPDM gasket.

1.1.5 Fittings - Fittings shall be GRINNELL ductile iron or segmentally welded steel fittings, with grooved ends.

1.1.6 Butterfly Valves - Shall be of grooved end design with EPDM encapsulated disc. Neck design shall readily accommodate insulation. Valves shall have pressure assisted double seal and stainless steel upper stems, and be capable of 20.7 Bar (300 psi), bubble-tight-shut-off, with an actuator or hand lever.

1.1.7 Check Valves - Shall be of grooved end design with a clapper seal of EPDM. The valves shall have a spring loaded clapper to ensure a leak tight seal and a nonsticking operation. Valves shall be capable of pressures of 20.7 Bar (300 psi).