

For SI: 1 inch = 25.4 mm, 1 foot = 304.8 mm.

R611.8 Requirements for lintels and reinforcement around openings.

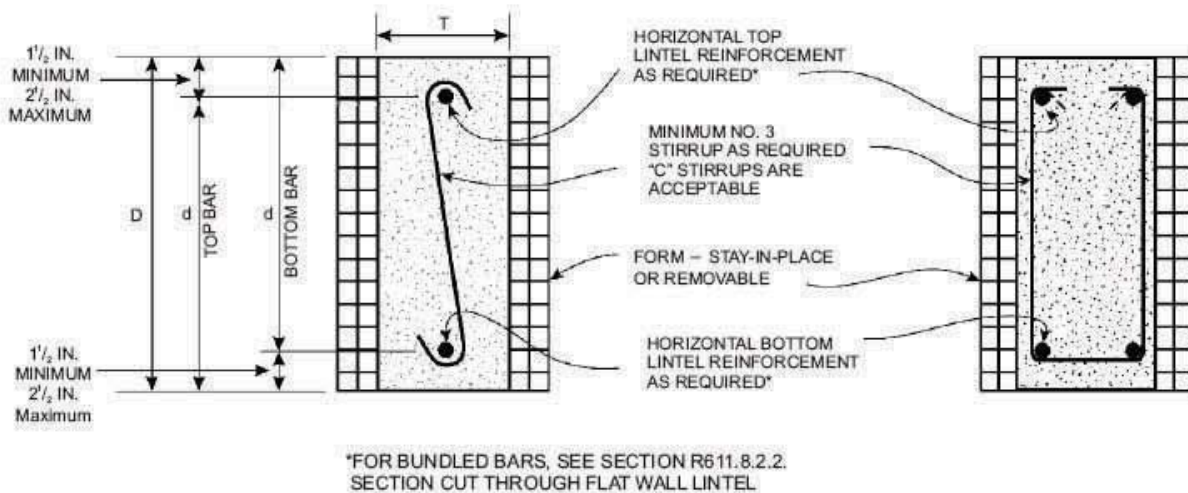


TABLE R611.8(1) LINTEL DESIGN LOADING CONDITIONS^{a, b, d}

DESCRIPTION OF LOADS AND OPENINGS ABOVE INFLUENCING DESIGN OF LINTEL			DESIGN LOAD CONDITION ^c
Opening in wall of top story of two-story building, or first story of one-story building			
Wall supporting loads from roof, including attic floor, if applicable, and	Top of lintel equal to or less than W/2 below top of wall		2
	Top of lintel greater than W/2 below top of wall		NLB
Wall not supporting loads from roof or attic floor			NLB
Opening in wall of first story of two-story building where wall immediately above is of concrete construction, or opening in basement wall of one-story building where wall immediately above is of concrete construction			
LB ledger board mounted to side of wall with bottom of ledger less than or equal to W/2 above top of lintel, and	Top of lintel greater than W/2 below bottom of opening in story above		1
	Top of lintel less than or equal to W/2 below bottom of opening in story above, and	Opening is entirely within the footprint of the opening in the story above	1
		Opening is partially within the footprint of the opening in the story above	4
LB ledger board mounted to side of wall with bottom of ledger more than W/2 above top of lintel			NLB
NLB ledger board mounted to side of wall with bottom of ledger less than or equal to W/2 above top of lintel, or no ledger board, and	Top of lintel greater than W/2 below bottom of opening in story above		NLB
	Top of lintel less than or equal to W/2 below bottom of opening in story above, and	Opening is entirely within the footprint of the opening in the story above	NLB
		Opening is partially within the footprint of the opening in the story above	1
Opening in basement wall of two-story building where walls of two stories above are of concrete construction			
LB ledger board mounted to side of wall with bottom of ledger less than or equal to W/2 above top of lintel, and	Top of lintel greater than W/2 below bottom of opening in story above		1
	Top of lintel less than or equal to W/2 below bottom of opening in story above, and	Opening is entirely within the footprint of the opening in the story above	1
		Opening is partially within the footprint of the opening in the story above	5
LB ledger board mounted to side of wall with bottom of ledger more than W/2 above top of lintel			NLB
NLB ledger board mounted to side of wall with bottom of ledger less than or equal to W/2 above top of lintel, or no ledger board, and	Top of lintel greater than W/2 below bottom of opening in story above		NLB
	Top of lintel less than or equal to W/2 below bottom of opening in story above, and	Opening is entirely within the footprint of the opening in the story above	NLB
		Opening is partially within the footprint of the opening in the story above	1
Opening in wall of first story of two-story building where wall immediately above is of light framed construction, or opening in basement wall of one-story building, where wall immediately above is of light framed construction			
Wall supporting loads from roof, second floor and top-story wall of light-framed	Top of lintel equal to or less than W/2 below top of wall		3
	Top of lintel greater than W/2 below top of wall		NLB
Wall not supporting loads from roof or second floor			NLB

a. LB means load bearing, NLB means nonload-bearing, and W means width of opening.

b. Footprint is the area of the wall below an opening in the story above, bounded by the bottom of the opening and vertical lines extending downward from the edges of the opening.

c. For design loading condition "NLB" see Tables R611.8(9) and R611.8(10). For all other design loading conditions see Tables R611.8(2) through R611.8(8).

d. A NLB ledger board is a ledger attached to a wall that is parallel to the span of the floor, roof or ceiling framing that supports the edge of the floor, ceiling or roof.



TABLE R611.8(2) MAXIMUM ALLOWABLE CLEAR SPANS FOR 4-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)								
			1	2		3		4		5	
				30	70	30	70	30	70	30	70
			Maximum clear span of lintel (feet - inches)								
8	Span without stirrups ^{i,j}		3-2	3-4	2-4	2-6	2-2	2-1	2-0	2-0	2-0
	1-#4	40,000	5-2	5-5	4-1	4-3	3-10	3-7	3-4	2-9	2-9
		60,000	6-2	6-5	4-11	5-1	4-6	4-2	3-8	2-11	2-10
	1-#5	40,000	6-3	6-7	5-0	5-2	4-6	4-2	3-8	2-11	2-10
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR
Center distance A ^{k,l}		1-1	1-2	0-8	0-9	0-7	0-6	0-5	0-4	0-4	
12	Span without stirrups ^{i,j}		3-4	3-7	2-9	2-11	2-8	2-6	2-5	2-2	2-2
	1-#4	40,000	6-7	7-0	5-4	5-7	5-0	4-9	4-4	3-8	3-7
		60,000	7-11	8-6	6-6	6-9	6-0	5-9	5-3	4-5	4-4
	1-#5	40,000	8-1	8-8	6-7	6-10	6-2	5-10	5-4	4-6	4-5
		60,000	9-8	10-4	7-11	8-2	7-4	6-11	6-2	4-10	4-8
	2-#4 1-#6	40,000	9-1	9-8	7-4	7-8	6-10	6-6	6-0	4-10	4-8
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR
Center distance A ^{k,l}		1-8	1-11	1-1	1-3	1-0	0-11	0-9	0-6	0-6	
16	Span without stirrups ^{i,j}		4-7	5-0	3-11	4-0	3-8	3-7	3-4	3-1	3-0
	1-#4	40,000	6-8	7-3	5-6	5-9	5-2	4-11	4-6	3-10	3-8
		60,000	9-3	10-1	7-9	8-0	7-2	6-10	6-3	5-4	5-2
	1-#4	40,000	9-6	10-4	7-10	8-2	7-4	6-11	6-5	5-5	5-3
		60,000	11-5	12-5	9-6	9-10	8-10	8-4	7-9	6-6	6-4
	2-#4 1-#6	40,000	10-7	11-7	8-10	9-2	8-3	7-9	7-2	6-1	5-11
		60,000	12-9	13-10	10-7	11-0	9-10	9-4	8-7	6-9	6-6
	2-#5	40,000	13-0	14-1	10-9	11-2	9-11	9-2	8-2	6-6	6-3
60,000		DR	DR	DR	DR	DR	DR	DR	DR	DR	
Center distance A ^{k,l}		2-3	2-8	1-7	1-8	1-4	1-3	1-0	0-9	0-8	
20	Span without stirrups ^{i,j}		5-9	6-5	5-0	5-2	4-9	4-7	4-4	3-11	3-11
	1-#4	40,000	7-5	8-2	6-3	6-6	5-10	5-7	5-1	4-4	4-2
		60,000	9-0	10-0	7-8	7-11	7-1	6-9	6-3	5-3	5-1
	1-#5	40,000	9-2	10-2	7-9	8-1	7-3	6-11	6-4	5-4	5-2
		60,000	12-9	14-2	10-10	11-3	10-1	9-7	8-10	7-5	7-3
	2-#4 1-#6	40,000	11-10	13-2	10-1	10-5	9-4	8-11	8-2	6-11	6-9
		60,000	14-4	15-10	12-1	12-7	11-3	10-9	9-11	8-4	8-1
	2-#5	40,000	14-7	16-2	12-4	12-9	11-4	10-6	9-5	7-7	7-3
		60,000	17-5	19-2	14-9	15-3	13-5	12-4	11-0	8-8	8-4
	2-#6	40,000	16-4	18-11	12-7	13-3	11-4	10-6	9-5	7-7	7-3
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR
Center distance A ^{k,l}		2-9	3-5	2-0	2-2	1-9	1-7	1-4	0-11	0-11	



(continued)

TABLE R611.8(2)—continued MAXIMUM ALLOWABLE CLEAR SPANS FOR 4-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a,b,c,d, e, f,m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8									
		1	2	3	4	5					
		Maximum ground snow load (psf)									
			30	70	30	70	30	70	30	70	
Maximum clear span of lintel (feet - inches)											
24	Span without stirrups ^{i, j}	6-11	7-9	6-1	6-3	5-9	5-7	5-3	4-9	4-8	
	1-#4	40,000	8-0	9-0	6-11	7-2	6-5	6-2	5-8	4-9	4-8
		60,000	9-9	11-0	8-5	8-9	7-10	7-6	6-11	5-10	5-8
	1-#5	40,000	10-0	11-3	8-7	8-11	8-0	7-7	7-0	5-11	5-9
		60,000	13-11	15-8	12-0	12-5	11-2	10-7	9-10	8-3	8-0
	2-#4 1-#6	40,000	12-11	14-6	11-2	11-6	10-5	9-10	9-1	7-8	7-5
		60,000	15-7	17-7	13-6	13-11	12-7	11-11	11-0	9-3	9-0
	2-#5	40,000	15-11	17-11	13-7	14-3	12-8	11-9	10-8	8-7	8-4
		60,000	19-1	21-6	16-5	17-1	15-1	14-0	12-6	9-11	9-7
	2-#6	40,000	17-7	21-1	14-1	14-10	12-8	11-9	10-8	8-7	8-4
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR
	Center distance A ^{k,l}		3-3	4-1	2-5	2-7	2-1	1-11	1-7	1-2	1-1

For SI: 1 inch = 25.4 mm; 1 foot = 304.8 mm; 1 pound per square foot = 0.0479 kPa; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

- a. See Table R611.3 for tolerances permitted from nominal thickness.
- b. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi. See note j.
- c. Table values are based on uniform loading. See Section R611.8.2 for lintels supporting concentrated loads.
- d. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.
- e. Linear interpolation is permitted between ground snow loads and between lintel depths.
- f. DR indicates design required.
- g. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased
- h. Stirrups shall be fabricated from reinforcing bars with the same yield strength as that used for the main longitudinal
- i. Allowable clear span without stirrups applicable to all lintels of the same depth, D . Top and bottom reinforcement for lintels without stirrups shall not be less than the least amount of reinforcement required for a lintel of the same depth and loading condition with stirrups. All other spans require stirrups spaced at not more than $d/2$.
- j. Where concrete with a minimum specified compressive strength of 3,000 psi (20.7 MPa) is used, clear spans for lintels without stirrups shall be permitted to be multiplied by 1.05. If the increased span exceeds the allowable clear span for a lintel of the same depth and loading condition with stirrups, the top and bottom reinforcement shall be equal to or greater than that required for a lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel
- k. Center distance, A , is the center portion of the clear span where stirrups are not required. This is applicable to all longitudinal
- l. Where concrete with a minimum specified compressive strength of 3,000 psi is used, center distance, A , shall be permitted to be multiplied by 1.10.
- m. The maximum clear opening width between two solid wall segments shall be 18 feet (5486 mm). See Section R611.7.2.1. Lintel clear spans in the table greater than 18 feet are shown for interpolation and information only.



TABLE R611.8(3) MAXIMUM ALLOWABLE CLEAR SPANS FOR 6-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ⁹ (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
			30	70	30	70	30	70	30	70		
Maximum clear span of lintel (feet - inches)												
8	Span without stirrups ^{i,j}		4-2	4-8	3-1	3-3	2-10	2-6	2-3	2-0	2-0	
	1-#4	40,000	5-1	5-5	4-2	4-3	3-10	3-6	3-3	2-8	2-7	
		60,000	6-2	6-7	5-0	5-2	4-8	4-2	3-11	3-3	3-2	
	1-#5	40,000	6-3	6-8	5-1	5-3	4-9	4-3	4-0	3-3	3-2	
		60,000	7-6	8-0	6-1	6-4	5-8	5-1	4-9	3-8	3-6	
	2-#4 1-#6	40,000	7-0	7-6	5-8	5-11	5-3	4-9	4-5	3-8	3-6	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
	Center distance A ^{k,1}		1-7	1-10	1-1	1-2	0-11	0-9	0-8	0-5	0-5	
12	Span without stirrups ^{i,j}		4-2	4-8	3-5	3-6	3-2	2-11	2-9	2-5	2-4	
	1-#4	40,000	5-7	6-1	4-8	4-10	4-4	3-11	3-8	3-0	2-11	
		60,000	7-9	8-6	6-6	6-9	6-1	5-6	5-1	4-3	4-1	
	1-#5	40,000	7-11	8-8	6-8	6-11	6-2	5-7	5-2	4-4	4-2	
		60,000	9-7	10-6	8-0	8-4	7-6	6-9	6-3	5-2	5-1	
	2-#4 1-#6	40,000	8-11	9-9	7-6	7-9	6-11	6-3	5-10	4-10	4-8	
		60,000	10-8	11-9	8-12	9-4	8-4	7-6	7-0	5-10	5-8	
	2-#5	40,000	10-11	12-0	9-2	9-6	8-6	7-8	7-2	5-6	5-3	
		60,000	12-11	14-3	10-10	11-3	10-1	9-0	8-1	6-1	5-10	
	2-#6	40,000	12-9	14-0	10-8	11-1	9-7	8-1	7-3	5-6	5-3	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
	Center distance A ^{k,1}		2-6	3-0	1-9	1-10	1-6	1-3	1-1	0-9	0-8	
	16	Span without stirrups ^{i,j}		5-7	6-5	4-9	4-11	4-5	4-0	3-10	3-4	3-4
		1-#4	40,000	6-5	7-2	5-6	5-9	5-2	4-8	4-4	3-7	3-6
60,000			7-10	8-9	6-9	7-0	6-3	5-8	5-3	4-4	4-3	
1-#5		40,000	7-11	8-11	6-10	7-1	6-5	5-9	5-4	4-5	4-4	
		60,000	11-1	12-6	9-7	9-11	8-11	8-0	7-6	6-2	6-0	
2-#4 1-#6		40,000	10-3	11-7	8-10	9-2	8-3	7-6	6-11	5-9	5-7	
		60,000	12-5	14-0	10-9	11-1	10-0	9-0	8-5	7-0	6-9	
2-#5		40,000	12-8	14-3	10-11	11-4	10-2	9-2	8-7	6-9	6-6	
		60,000	15-2	17-1	13-1	13-7	12-3	11-0	10-3	7-11	7-7	
2-#6		40,000	14-11	16-9	12-8	13-4	11-4	9-8	8-8	6-9	6-6	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
Center distance A ^{k,1}		3-3	4-1	2-5	2-7	2-1	1-9	1-6	1-0	1-0		



(continued)

TABLE R611.8(3)-continued MAXIMUM ALLOWABLE CLEAR SPANS FOR 6-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE								
			1	2	3	4	5				
			Maximum ground snow load (psf)								
			30	70	30	70	30	70	30	70	
Maximum clear span of lintel (feet - inches)											
20	Span without stirrups ^{i, j}		6-11	8-2	6-1	6-3	5-8	5-2	4-11	4-4	4-3
	1-#5	40,000	8-9	10-1	7-9	8-0	7-3	6-6	6-1	5-1	4-11
		60,000	10-8	12-3	9-5	9-9	8-10	8-0	7-5	6-2	6-0
	2-#4 1-#6	40,000	9-11	11-4	8-9	9-1	8-2	7-4	6-10	5-8	5-7
		60,000	13-9	15-10	12-2	12-8	11-5	10-3	9-7	7-11	7-9
	2-#5	40,000	14-0	16-2	12-5	12-11	11-7	10-6	9-9	7-11	7-8
		60,000	16-11	19-6	15-0	15-6	14-0	12-7	11-9	9-1	8-9
	2-#6	40,000	16-7	19-1	14-7	15-3	13-1	11-3	10-2	7-11	7-8
		60,000	19-11	22-10	17-4	18-3	15-6	13-2	11-10	9-1	8-9
	Center distance A ^{k, l}		3-11	5-2	3-1	3-3	2-8	2-2	1-11	1-4	1-3
24	Span without stirrups ^{i, j}		8-2	9-10	7-4	7-8	6-11	6-4	5-11	5-3	5-2
	1-#5	40,000	9-5	11-1	8-7	8-10	8-0	7-3	6-9	5-7	5-5
		60,000	11-6	13-6	10-5	10-9	9-9	8-9	8-2	6-10	6-8
	2-#4 1-#6	40,000	10-8	12-6	9-8	10-0	9-0	8-2	7-7	6-4	6-2
		60,000	12-11	15-2	11-9	12-2	11-0	9-11	9-3	7-8	7-6
	2-#5	40,000	15-2	17-9	13-9	14-3	12-10	11-7	10-10	9-0	8-9
		60,000	18-4	21-6	16-7	17-3	15-6	14-0	13-1	10-4	10-0
	2-#6	40,000	18-0	21-1	16-4	16-11	14-10	12-9	11-8	9-2	8-11
		60,000	21-7	25-4	19-2	20-4	17-2	14-9	13-4	10-4	10-0
	Center distance A ^{k, l}		4-6	6-2	3-8	4-0	3-3	2-8	2-3	1-7	1-6

For SI: 1 inch = 25.4 mm; 1 foot = 304.8 mm; 1 psf = 0.0479 kPa; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

- a. See Table R611.3 for tolerances permitted from nominal thickness.
- b. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi. See Note j.
- c. Table values are based on uniform loading. See Section R611.8.2 for lintels supporting concentrated loads.
- d. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.
- e. Linear interpolation is permitted between ground snow loads and between lintel depths.
- f. DR indicates design required.
- g. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased lintel depth spans the entire length of the lintel.



h. Stirrups shall be fabricated from reinforcing bars with the same yield strength as that used for the main longitudinal reinforcement.

i. Allowable clear span without stirrups applicable to all lintels of the same depth, D . Top and bottom reinforcement for lintels without stirrups shall not be less than the least amount of reinforcement required for a lintel of the same depth and loading condition with stirrups. All other spans require stirrups spaced at not more than $d/2$.

j. Where concrete with a minimum specified compressive strength of 3,000 psi is used, clear spans for lintels without stirrups shall be permitted to be multiplied by 1.05. If the increased span exceeds the allowable clear span for a lintel of the same depth and loading condition with stirrups, the top and bottom reinforcement shall be equal to or greater than that required for a lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups that has been increased.

k. Center distance, A , is the center portion of the clear span where stirrups are not required. This is applicable to all longitudinal bar sizes and steel yield strengths.

l. Where concrete with a minimum specified compressive strength of 3,000 psi is used, center distance, A , shall be permitted to be multiplied by 1.10.

m. The maximum clear opening width between two solid wall segments shall be 18 feet (5486 mm). See Section R611.7.2.1. Lintel clear spans in the table greater than 18 feet are shown for interpolation and information only.



TABLE R611.8(4) MAXIMUM ALLOWABLE CLEAR SPANS FOR 8-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
				30	70	30	70	30	70	30	70	
			Maximum clear span of lintel (feet - inches)									
8	Span without stirrups ^{i,j}		4-4	4-9	3-7	3-9	3-4	2-10	2-7	2-1	2-0	
	1-#4	40,000	4-4	4-9	3-7	3-9	3-4	2-11	2-9	2-3	2-2	
		60,000	6-1	6-7	5-0	5-3	4-8	4-0	3-9	3-1	3-0	
	1-#5	40,000	6-2	6-9	5-2	5-4	4-9	4-1	3-10	3-2	3-1	
		60,000	7-5	8-1	6-2	6-5	5-9	4-11	4-7	3-9	3-8	
	2-#4 1-#6	40,000	6-11	7-6	5-9	6-0	5-4	4-7	4-4	3-6	3-5	
		60,000	8-3	9-0	6-11	7-2	6-5	5-6	5-2	4-2	4-1	
	2-#5	40,000	8-5	9-2	7-0	7-3	6-6	5-7	5-3	4-2	4-0	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
	Center distance A ^{k,1}		2-1	2-6	1-5	1-6	1-3	0-11	0-10	0-6	0-6	
12	Span without stirrups ^{i,j}		4-10	5-8	4-0	4-2	3-9	3-2	3-0	2-7	2-6	
	1-#4	40,000	5-5	6-1	4-8	4-10	4-4	3-9	3-6	2-10	2-10	
		60,000	6-7	7-5	5-8	5-11	5-4	4-7	4-3	3-6	3-5	
	1-#5	40,000	6-9	7-7	5-9	6-0	5-5	4-8	4-4	3-7	3-6	
		60,000	9-4	10-6	8-1	8-4	7-6	6-6	6-1	5-0	4-10	
	2-#4 1-#6	40,000	8-8	9-9	7-6	7-9	7-0	6-0	5-8	4-7	4-6	
		60,000	10-6	11-9	9-1	9-5	8-5	7-3	6-10	5-7	5-5	
	2-#5	40,000	10-8	12-0	9-3	9-7	8-7	7-5	6-11	5-6	5-4	
		60,000	12-10	14-5	11-1	11-6	10-4	8-11	8-4	6-7	6-4	
	2-#6	40,000	12-7	14-2	10-10	11-3	10-2	8-3	7-6	5-6	5-4	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
	Center distance A ^{k,1}		3-2	4-0	2-4	2-6	2-0	1-6	1-4	0-11	0-10	
16	Span without stirrups ^{i,j}		6-5	7-9	5-7	5-10	5-2	4-5	4-2	3-7	3-6	
	1-#4	40,000	6-2	7-1	5-6	5-8	5-1	4-5	4-2	3-5	3-4	
		60,000	7-6	8-8	6-8	6-11	6-3	5-5	5-1	4-2	4-0	
	1-#5	40,000	7-8	8-10	6-10	7-1	6-4	5-6	5-2	4-3	4-1	
		60,000	9-4	10-9	8-4	8-7	7-9	6-8	6-3	5-2	5-0	
	2-#4 1-#6	40,000	8-8	10-0	7-8	8-0	7-2	6-2	5-10	4-9	4-8	
		60,000	12-0	13-11	10-9	11-2	10-0	8-8	8-1	6-8	6-6	
	2-#5	40,000	12-3	14-2	11-0	11-4	10-3	8-10	8-3	6-9	6-7	
		60,000	14-10	17-2	13-3	13-8	12-4	10-8	10-0	7-11	7-8	
	2-#6	40,000	14-6	16-10	13-0	13-5	12-1	10-1	9-2	6-11	6-8	
		60,000	17-5	20-2	15-7	16-1	14-6	11-10	10-8	7-11	7-8	
	Center distance A ^{k,1}		4-1	5-5	3-3	3-6	2-10	2-1	1-10	1-3	1-2	



(continued)

TABLE R611.8(4)-continued MAXIMUM ALLOWABLE CLEAR SPANS FOR 8-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LIN- TEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
			30	70	30	70	30	70	30	70		
Maximum clear span of lintel (feet - inches)												
20	Span without stirrups ^{i, j}		7-10	9-10	7-1	7-5	6-7	5-8	5-4	4-7	4-6	
	1-#5	40,000	8-4	9-11	7-8	8-0	7-2	6-3	5-10	4-9	4-8	
		60,000	10-2	12-1	9-5	9-9	8-9	7-7	7-1	5-10	5-8	
	2-#4 1-#6	40,000	9-5	11-3	8-8	9-0	8-1	7-0	6-7	5-5	5-3	
		60,000	11-6	13-8	10-7	11-0	9-11	8-7	8-0	6-7	6-5	
	2-#5	40,000	11-9	13-11	10-10	11-2	10-1	8-9	8-2	6-8	6-7	
		60,000	16-4	19-5	15-0	15-7	14-0	12-2	11-4	9-3	9-0	
	2-#6	40,000	16-0	19-0	14-9	15-3	13-9	11-10	10-10	8-3	8-0	
		60,000	19-3	22-11	17-9	18-5	16-7	13-7	12-4	9-3	9-0	
	Center distance A ^{k, l}		4-10	6-10	4-1	4-5	3-7	2-8	2-4	1-7	1-6	
24	Span without stirrups ^{i, j}		9-2	11-9	8-7	8-11	8-0	6-11	6-6	5-7	5-6	
	1-#5	40,000	8-11	10-10	8-6	8-9	7-11	6-10	6-5	5-3	5-2	
		60,000	10-11	13-3	10-4	10-8	9-8	8-4	7-10	6-5	6-3	
	2-#4 1-#6	40,000	10-1	12-3	9-7	9-11	8-11	7-9	7-3	6-0	5-10	
		60,000	12-3	15-0	11-8	12-1	10-11	9-5	8-10	7-3	7-1	
	2-#5	40,000	12-6	15-3	11-11	12-4	11-1	9-7	9-0	7-5	7-3	
		60,000	17-6	21-3	16-7	17-2	15-6	13-5	12-7	10-4	10-1	
	2-#6	40,000	17-2	20-11	16-3	16-10	15-3	13-2	12-4	9-7	9-4	
		60,000	20-9	25-3	19-8	20-4	18-5	15-4	14-0	10-7	10-3	
	Center distance A ^{k, l}		5-6	8-1	4-11	5-3	4-4	3-3	2-10	1-11	1-10	

For SI: 1 inch = 25.4 mm; 1 foot = 304.8 mm; 1 psf = 0.0479 kPa; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

Note: Top and bottom reinforcement for lintels without stirrups shown in shaded cells shall be equal to or greater than that required for lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups.

- a. See Table R611.3 for tolerances permitted from nominal thickness.
- b. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi. See Note j.
- c. Table values are based on uniform loading. See Section R611.8.2 for lintels supporting concentrated loads.
- d. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.
- e. Linear interpolation is permitted between ground snow loads and between lintel depths.



f. DR indicates design required.

g. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased lintel depth spans the entire length of the lintel.

h. Stirrups shall be fabricated from reinforcing bars with the same yield strength as that used for the main longitudinal reinforcement.

i. Allowable clear span without stirrups applicable to all lintels of the same depth, D . Top and bottom reinforcement for lintels without stirrups shall not be less than the least amount of reinforcement required for a lintel of the same depth and loading condition with stirrups. All other spans require stirrups spaced at not more than $d/2$.

j. Where concrete with a minimum specified compressive strength of 3,000 psi is used, clear spans for lintels without stirrups shall be permitted to be multiplied by 1.05. If the increased span exceeds the allowable clear span for a lintel of the same depth and loading condition with stirrups, the top and bottom reinforcement shall be equal to or greater than that required for a lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups that has been increased.

k. Center distance, A , is the center portion of the clear span where stirrups are not required. This is applicable to all longitudinal bar sizes and steel yield strengths.

l. Where concrete with a minimum specified compressive strength of 3,000 psi is used, center distance, A , shall be permitted to be multiplied by 1.10.

m. The maximum clear opening width between two solid wall segments shall be 18 feet. See Section R611.7.2.1. Lintel clear spans i



TABLE R611.8(5) MAXIMUM ALLOWABLE CLEAR SPANS FOR 10-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
			30	70	30	70	30	70	30	70		
Maximum clear span of lintel (feet - inches)												
8	Span without stirrups ^{i,j}		6-0	7-2	4-7	4-10	4-1	3-1	2-11	2-3	2-2	
	1-#4	40,000	4-3	4-9	3-7	3-9	3-4	2-9	2-7	2-1	2-1	
		60,000	5-11	6-7	5-0	5-3	4-8	3-10	3-8	2-11	2-11	
	1-#5	40,000	6-1	6-9	5-2	5-4	4-9	3-11	3-9	3-0	2-11	
		60,000	7-4	8-1	6-3	6-5	5-9	4-9	4-6	3-7	3-7	
	2-#4 1-#6	40,000	6-10	7-6	5-9	6-0	5-5	4-5	4-2	3-4	3-4	
		60,000	8-2	9-1	6-11	7-2	6-6	5-4	5-0	4-1	4-0	
	2-#5	40,000	8-4	9-3	7-1	7-4	6-7	5-5	5-1	4-1	4-0	
		60,000	9-11	11-0	8-5	8-9	7-10	6-6	6-1	4-8	4-6	
	2-#6	40,000	9-9	10-10	8-3	8-7	7-9	6-4	5-10	4-1	4-0	
60,000		DR	DR	DR	DR	DR	DR	DR	DR	DR		
Center distance A ^{k,l}		2-6	3-1	1-10	1-11	1-7	1-1	0-11	0-7	0-7		
12	Span without stirrups ^{i,j}		5-5	6-7	4-7	4-10	4-3	3-5	3-3	2-8	2-8	
	1-#4	40,000	5-3	6-0	4-8	4-10	4-4	3-7	3-4	2-9	2-8	
		60,000	6-5	7-4	5-8	5-10	5-3	4-4	4-1	3-4	3-3	
	1-#5	40,000	6-6	7-6	5-9	6-0	5-5	4-5	4-2	3-5	3-4	
		60,000	7-11	9-1	7-0	7-3	6-7	5-5	5-1	4-2	4-0	
	2-#4 1-#6	40,000	7-4	8-5	6-6	6-9	6-1	5-0	4-9	3-10	3-9	
		60,000	10-3	11-9	9-1	9-5	8-6	7-0	6-7	5-4	5-3	
	2-#5	40,000	10-5	12-0	9-3	9-7	8-8	7-2	6-9	5-5	5-4	
		60,000	12-7	14-5	11-2	11-6	10-5	8-7	8-1	6-6	6-4	
	2-#6	40,000	12-4	14-2	10-11	11-4	10-2	8-5	7-8	5-7	5-5	
60,000		14-9	17-0	13-1	13-6	12-2	10-0	9-1	6-6	6-4		
Center distance A ^{k,l}		3-9	4-11	2-11	3-2	2-7	1-9	1-7	1-0	1-0		
16	Span without stirrups ^{i,j}		7-1	9-0	6-4	6-8	5-10	4-9	4-6	3-9	3-8	
	1-#4	40,000	5-11	7-0	5-5	5-8	5-1	4-3	4-0	3-3	3-2	
		60,000	7-3	8-7	6-8	6-11	6-3	5-2	4-10	3-11	3-10	
	1-#5	40,000	7-4	8-9	6-9	7-0	6-4	5-3	4-11	4-0	3-11	
		60,000	9-0	10-8	8-3	8-7	7-9	6-5	6-0	4-11	4-9	
	2-#4 1-#6	40,000	8-4	9-11	7-8	7-11	7-2	5-11	5-7	4-6	4-5	
		60,000	10-2	12-0	9-4	9-8	8-9	7-3	6-10	5-6	5-5	
	2-#5	40,000	10-4	12-3	9-6	9-10	8-11	7-4	6-11	5-8	5-6	
		60,000	14-4	17-1	13-3	13-8	12-4	10-3	9-8	7-10	7-8	
	2-#6	40,000	14-1	16-9	13-0	13-5	12-2	10-1	9-6	7-0	6-10	
60,000		17-0	20-2	15-8	16-2	14-7	12-0	10-11	8-0	7-9		
Center distance ^{k,l}		4-9	6-8	4-0	4-4	3-6	2-5	2-2	1-5	1-4		



(continued)

TABLE R611.8(5)-continued MAXIMUM ALLOWABLE CLEAR SPANS FOR 10-INCH NOMINAL THICK FLAT LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, m} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LIN- TEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
				30	70	30	70	30	70	30	70	
Maximum clear span of lintel (feet - inches)												
20	Span without stirrups ^{i, j}		8-7	11-4	8-1	8-5	7-5	6-1	5-9	4-10	4-9	
	1-#4	40,000	6-5	7-10	6-2	6-4	5-9	4-9	4-6	3-8	3-7	
		60,000	7-10	9-7	7-6	7-9	7-0	5-10	5-6	4-5	4-4	
	1-#5	40,000	8-0	9-9	7-8	7-11	7-2	5-11	5-7	4-6	4-5	
		60,000	9-9	11-11	9-4	9-8	8-9	7-3	6-10	5-6	5-5	
	2-#4 1-#6	40,000	9-0	11-1	8-8	8-11	8-1	6-9	6-4	5-2	5-0	
		60,000	11-0	13-6	10-6	10-11	9-10	8-2	7-9	6-3	6-2	
	2-#5	40,000	11-3	13-9	10-9	11-1	10-0	8-4	7-10	6-5	6-3	
		60,000	15-8	19-2	15-0	15-6	14-0	11-8	11-0	8-11	8-9	
	2-#6	40,000	15-5	18-10	14-8	15-2	13-9	11-5	10-9	8-6	8-3	
60,000		18-7	22-9	17-9	18-5	16-7	13-10	12-9	9-5	9-2		
Center distance A ^{k, l}		5-7	8-4	5-1	5-5	4-5	3-1	2-9	1-10	1-9		
24	Span without stirrups ^{i, j}		9-11	13-7	9-9	10-2	9-0	7-5	7-0	5-10	5-9	
	1-#5	40,000	8-6	10-8	8-5	8-8	7-10	6-6	6-2	5-0	4-11	
		60,000	10-5	13-0	10-3	10-7	9-7	8-0	7-6	6-1	6-0	
	2-#4 1-#6	40,000	9-7	12-1	9-6	9-9	8-10	7-5	7-0	5-8	5-6	
		60,000	11-9	14-9	11-7	11-11	10-10	9-0	8-6	6-11	6-9	
	2-#5	40,000	12-0	15-0	11-9	12-2	11-0	9-2	8-8	7-1	6-11	
		60,000	14-7	18-3	14-4	14-10	13-5	11-2	10-7	8-7	8-5	
	2-#6	40,000	14-3	17-11	14-1	14-7	13-2	11-0	10-4	8-5	8-3	
		60,000	19-11	25-0	19-7	20-3	18-4	15-3	14-5	10-10	10-7	
	Center distance A ^{k, l}		6-3	9-11	6-1	6-6	5-4	3-9	3-4	2-2	2-1	

For SI: 1 inch = 25.4 mm; 1 foot = 304.8 mm; 1 pound per square foot = 0.0479 kPa; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

Note: Top and bottom reinforcement for lintels without stirrups shown in shaded cells shall be equal to or greater than that required for lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups.

- a. See Table R611.3 for tolerances permitted from nominal thickness.
- b. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi. See Note j.
- c. Table values are based on uniform loading. See Section R611.8.2 for lintels supporting concentrated loads.
- d. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.



- e. Linear interpolation is permitted between ground snow loads and between lintel depths.
- f. DR indicates design required.
- g. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased lintel depth spans the entire length of the lintel.
- h. Stirrups shall be fabricated from reinforcing bars with the same yield strength as that used for the main longitudinal reinforcement.
- i. Allowable clear span without stirrups applicable to all lintels of the same depth, D . Top and bottom reinforcement for lintels without stirrups shall not be less than the least amount of reinforcement required for a lintel of the same depth and loading condition with stirrups. All other spans require stirrups spaced at not more than $d/2$.
- j. Where concrete with a minimum specified compressive strength of 3,000 psi is used, clear spans for lintels without stirrups shall be permitted to be multiplied by 1.05. If the increased span exceeds the allowable clear span for a lintel of the same depth and loading condition with stirrups, the top and bottom reinforcement shall be equal to or greater than that required for a lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups that has been increased.
- k. Center distance, A , is the center portion of the clear span where stirrups are not required. This is applicable to all longitudinal bar sizes and steel yield strengths.
- l. Where concrete with a minimum specified compressive strength of 3,000 psi is used, center distance, A , shall be permitted to be multiplied by 1.10.
- m. The maximum clear opening width between two solid wall segments shall be 18 feet (5486 mm). See Section R611.7.2.1. Lintel clear spans in the table greater than 18 feet are shown for interpolation and information only.



TABLE R611.8(6) MAXIMUM ALLOWABLE CLEAR SPANS FOR 6-INCH THICK WAFFLE-GRID LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, o} MAXIMUM ROOF CLEAR SPAN 40 FEET AND MAXIMUM FLOOR SPAN 32 FEET

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE R611.8(1)									
			1	2		3		4		5		
			Maximum ground snow load (psf)									
				30	70	30	70	30	70	30	70	
			Maximum clear span of lintel (feet - inches)									
8'	Span without stirrups ^{k, l}		2-7	2-9	2-0	2-1	2-0	2-0	2-0	2-0	2-0	
	1-#4	40,000	5-2	5-5	4-0	4-3	3-7	3-3	2-11	2-4	2-3	
		60,000	5-9	6-3	4-0	4-3	3-7	3-3	2-11	2-4	2-3	
	1-#5	40,000	5-9	6-3	4-0	4-3	3-7	3-3	2-11	2-4	2-3	
		60,000	5-9	6-3	4-0	4-3	3-7	3-3	2-11	2-4	2-3	
	2-#4 1-#6	40,000	5-9	6-3	4-0	4-3	3-7	3-3	2-11	2-4	2-3	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
Center distance A ^{m, n}			0-9	0-10	0-6	0-6	0-5	0-5	0-4	STL	STL	
12'	Span without stirrups ^{k, l}		2-11	3-1	2-6	2-7	2-5	2-4	2-3	2-1	2-0	
	1-#4	40,000	5-9	6-2	4-8	4-10	4-4	4-1	3-9	3-2	3-1	
		60,000	8-0	8-7	6-6	6-9	6-0	5-5	4-11	3-11	3-10	
	1-#5	40,000	8-1	8-9	6-8	6-11	6-0	5-5	4-11	3-11	3-10	
		60,000	9-1	10-3	6-8	7-0	6-0	5-5	4-11	3-11	3-10	
	2-#4 1-#6	40,000	9-1	9-9	6-8	7-0	6-0	5-5	4-11	3-11	3-10	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
Center distance A ^{m, n}			1-3	1-5	0-10	0-11	0-9	0-8	0-6	STL	STL	
Span without stirrups ^{k, l}			4-0	4-4	3-6	3-7	3-4	3-3	3-1	2-10	2-10	
16'	1-#4	40,000	6-7	7-3	5-6	5-9	5-2	4-10	4-6	3-9	3-8	
		60,000	8-0	8-10	6-9	7-0	6-3	5-11	5-5	4-7	4-5	
	1-#5	40,000	8-2	9-0	6-11	7-2	6-5	6-0	5-7	4-8	4-6	
		60,000	11-5	12-6	9-3	9-9	8-4	7-7	6-10	5-6	5-4	
	2-#4 1-#6	40,000	10-7	11-7	8-11	9-3	8-3	7-7	6-10	5-6	5-4	
		60,000	12-2	14-0	9-3	9-9	8-4	7-7	6-10	5-6	5-4	
	2-#5	40,000	12-2	14-2	9-3	9-9	8-4	7-7	6-10	5-6	5-4	
60,000		DR	DR	DR	DR	DR	DR	DR	DR	DR		
Center distance A ^{m, n}			1-8	2-0	1-2	1-3	1-0	0-11	0-9	STL	STL	
20'	Span without stirrups ^{k, l}		5-0	5-6	4-6	4-7	4-3	4-1	4-0	3-8	3-8	
	1-#4	40,000	7-2	8-2	6-3	6-6	5-10	5-6	5-1	4-3	4-2	
		60,000	8-11	9-11	7-8	7-11	7-1	6-8	6-2	5-2	5-0	
	1-#5	40,000	9-1	10-2	7-9	8-1	7-3	6-10	6-4	5-4	5-2	
		60,000	12-8	14-2	10-11	11-3	10-2	9-6	8-9	7-1	6-10	
	2-#4 1-#6	40,000	10-3	11-5	8-9	9-1	8-2	7-8	7-1	6-0	5-10	
		60,000	14-3	15-11	11-9	12-5	10-8	9-9	8-9	7-1	6-10	
2-#5	40,000	14-6	16-3	11-6	12-1	10-4	9-6	8-6	6-11	6-8		
	60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR		
Center distance A ^{m, n}			2-0	2-6	1-6	1-7	1-3	1-1	1-0	STL	STL	



(continued)

**TABLE R611.8(6)-continued MAXIMUM ALLOWABLE CLEAR SPANS FOR 6-INCH THICK WAF-
FLE-GRID LINTELS IN LOAD-BEARING WALLS^{a, b, c, d, e, f, o} MAXIMUM ROOF CLEAR SPAN 40
FEET AND MAXIMUM FLOOR SPAN 32 FEET**

LINTEL DEPTH, D ^g (inches)	NUMBER OF BARS AND BAR SIZE IN TOP AND BOTTOM OF LINTEL	STEEL YIELD STRENGTH ^h , f _y (psi)	DESIGN LOADING CONDITION DETERMINED FROM TABLE									
			1	2	3	4	5					
			Maximum ground snow load (psf)									
			30	70	30	70	30	70	30	70		
Maximum clear span of lintel (feet - inches)												
24w ^j	Span without stirrups ^{k, l}		6-0	6-8	5-5	5-7	5-3	5-0	4-10	4-6	4-5	
	1-#4	40,000	7-11	9-0	6-11	7-2	6-5	6-0	5-7	4-8	4-7	
		60,000	9-8	10-11	8-5	8-9	7-10	7-4	6-10	5-9	5-7	
	1-#5	40,000	9-10	11-2	8-7	8-11	8-0	7-6	7-0	5-10	5-8	
		60,000	12-0	13-7	10-6	10-10	9-9	9-2	8-6	7-2	6-11	
	2-#4 1-#6	40,000	11-1	12-7	9-8	10-1	9-1	8-6	7-10	6-7	6-5	
		60,000	15-6	17-7	13-6	14-0	12-8	11-10	10-8	8-7	8-4	
	2-#5	40,000	15-6	17-11	12-8	13-4	11-6	10-7	9-7	7-10	7-7	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	DR	
	Center distance A ^{m, n}		2-4	3-0	1-9	1-11	1-6	1-4	1-2	STL	STL	

For SI: 1 inch = 25.4 mm; 1 pound per square foot = 0.0479 kPa; 1 foot = 304.8 mm; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

a. Where lintels are formed with waffle-grid forms, form material shall be removed, if necessary, to create top and bottom flanges of the lintel that are not less than 3 inches in depth (in the vertical direction), are not less than 5 inches (127 mm) in width for 6-inch nominal waffle-grid forms and not less than 7 inches in width for 8-inch nominal waffle-grid forms. See Figure R611.8(3). Flat form lintels shall be permitted in place of waffle-grid lintels. See Tables R611.8(2) through R611.8(5).

b. See Table R611.3 for tolerances permitted from nominal thicknesses and minimum dimensions and spacing of cores.

c. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi (17.2 MPa). See Notes l and n. Table values are based on uniform loading. See Section R611.8.2 for lintels supporting concentrated loads.

d. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.

e. Linear interpolation is permitted between ground snow loads.

f. DR indicates design required. STL - stirrups required throughout lintel.

g. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased lintel depth spans the entire length of the lintel.

h. Stirrups shall be fabricated from reinforcing bars with the same yield strength as that used for the main longitudinal reinforcement.

i. Lintels less than 24 inches in depth with stirrups shall be formed from flat-walls forms [see Tables R611.8(2) through R611.8(5)], or, if necessary, form material shall be removed from waffle-grid forms so as to provide the required cover for stirrups. Allowable spans for lintels formed with flat-wall forms shall be determined from Tables R611.8(2) through R611.8(5).

j. Where stirrups are required for 24-inch (610 mm) deep lintels, the spacing shall not exceed 12 inches (305 mm) on center.

k. Allowable clear span without stirrups applicable to all lintels of the same depth, D . Top and bottom reinforcement for lintels without stirrups shall not be less than the least amount of reinforcement required for a lintel of the same depth and loading condition with stirrups. All other spans require stirrups spaced at not more than $d/2$.



l. Where concrete with a minimum specified compressive strength of 3,000 psi is used, clear spans for lintels without stirrups shall be permitted to be multiplied by 1.05. If the increased span exceeds the allowable clear span for a lintel of the same depth and loading condition with stirrups, the top and bottom reinforcement shall be equal to or greater than that required for a lintel of the same depth and loading condition that has an allowable clear span that is equal to or greater than that of the lintel without stirrups that has been increased.

m. Center distance, A , is the center portion of the span where stirrups are not required. This is applicable to all longitudinal bar sizes and steel yield strengths.

n. Where concrete with a minimum specified compressive strength of 3,000 psi is used, center distance, A , shall be permitted to be multiplied by 1.10.

o. The maximum clear opening width between two solid wall segments shall be 18 feet . See Section R611.7.2.1. Lintel spans in the table greater than 18 feet are shown for interpolation and information only.



TABLE R611.8(9) MAXIMUM ALLOWABLE CLEAR SPANS FOR FLAT LINTELS WITHOUT STIRRUPS IN NONLOAD-BEARING WALLS^{a, b, c, d, e, g, h}

LINTEL DEPTH, D' (inches)	NUMBER OF BARS AND BAR SIZE	STEEL YIELD STRENGTH, f _y (psi)	NOMINAL WALL THICKNESS (inches)								
			4		6		8		10		
			Lintel Supporting								
			Concrete Wall	Light-framed Gable	Concrete Wall	Light-framed Gable	Concrete Wall	Light-framed Gable	Concrete Wall	Light-framed Gable	
Maximum Clear Span of Lintel (feet - inches)											
8	1-#4	40,000	10-11	11-5	9-7	11-2	7-10	9-5	7-3	9-2	
		60,000	12-5	11-7	10-11	13-5	9-11	13-2	9-3	12-10	
	1-#5	40,000	12-7	11-7	11-1	13-8	10-1	13-5	9-4	13-1	
		60,000	DR	DR	12-7	16-4	11-6	14-7	10-9	14-6	
	2-#4 1-#6	40,000	DR	DR	12-0	15-3	10-11	15-0	10-2	14-8	
		60,000	DR	DR	DR	DR	12-2	15-3	11-7	15-3	
	2-#5	40,000	DR	DR	DR	DR	12-7	16-7	11-9	16-7	
		60,000	DR	DR	DR	DR	DR	DR	13-3	16-7	
	2-#6	40,000	DR	DR	DR	DR	DR	DR	13-2	17-8	
		60,000	DR	DR	DR	DR	DR	DR	DR	DR	
	12	1-#4	40,000	11-5	9-10	10-6	12-0	9-6	11-6	8-9	11-1
			60,000	11-5	9-10	11-8	13-3	10-11	14-0	10-1	13-6
1-#5		40,000	11-5	9-10	11-8	13-3	11-1	14-4	10-3	13-9	
		60,000	11-5	9-10	11-8	13-3	11-10	16-0	11-9	16-9	
2-#4 1-#6		40,000	DR	DR	11-8	13-3	11-10	16-0	11-2	15-6	
		60,000	DR	DR	11-8	13-3	11-10	16-0	11-11	18-4	
2-#5		40,000	DR	DR	11-8	13-3	11-10	16-0	11-11	18-4	
		60,000	DR	DR	11-8	13-3	11-10	16-0	11-11	18-4	
16		1-#4	40,000	13-6	13-0	11-10	13-8	10-7	12-11	9-11	12-4
			60,000	13-6	13-0	13-8	16-7	12-4	15-9	11-5	15-0
		1-#5	40,000	13-6	13-0	13-10	17-0	12-6	16-1	11-7	15-4
			60,000	13-6	13-0	13-10	17-1	14-0	19-7	13-4	18-8
	2-#4 1-#6	40,000	13-6	13-0	13-10	17-1	13-8	18-2	12-8	17-4	
		60,000	13-6	13-0	13-10	17-1	14-0	20-3	14-1	-	
	2-#5	40,000	13-6	13-0	13-10	17-1	14-0	20-3	14-1	-	
		60,000	DR	DR	13-10	17-1	14-0	20-3	14-1	-	
	20	1-#4	40,000	14-11	15-10	13-0	14-10	11-9	13-11	10-10	13-2
			60,000	15-3	15-10	14-11	18-1	13-6	17-0	12-6	16-2
		1-#5	40,000	15-3	15-10	15-2	18-6	13-9	17-5	12-8	16-6
			60,000	15-3	15-10	15-8	20-5	15-9	-	14-7	20-1
2-#4 1-#6		40,000	15-3	15-10	15-8	20-5	14-11	-	13-10	-	
		60,000	15-3	15-10	15-8	20-5	15-10	-	15-11	-	
2-#5		40,000	15-3	15-10	15-8	20-5	15-10	-	15-11	-	
		60,000	15-3	15-10	15-8	20-5	15-10	-	15-11	-	
24		1-#4	40,000	16-1	17-1	13-11	15-10	12-7	14-9	11-8	13-10
			60,000	16-11	18-5	16-1	19-3	14-6	18-0	13-5	17-0
		1-#5	40,000	16-11	18-5	16-3	19-8	14-9	18-5	13-8	17-4
			60,000	16-11	18-5	17-4	-	17-0	-	15-8	-
	2-#4 1-#6	40,000	16-11	18-5	17-4	-	16-1	-	14-10	-	
		60,000	16-11	18-5	17-4	-	17-6	-	17-1	-	
	2-#5	40,000	16-11	18-5	17-4	-	17-6	-	17-4	-	
		60,000	16-11	18-5	17-4	-	17-6	-	17-8	-	



(continued)

TABLE R611.8(9)-continued MAXIMUM ALLOWABLE CLEAR SPANS FOR FLAT LINTELS WITHOUT STIRRUPS IN NONLOAD-BEARING WALLS^{a, b, c, d, e, g, h} ROOF CLEAR SPAN 40 FEET AND FLOOR CLEAR SPAN 32 FEET (table missing?)

For SI: 1 inch = 25.4 mm; 1 foot = 304.8 mm; Grade 40 = 280 MPa; Grade 60 = 420 MPa.

- a. See Table R611.3 for tolerances permitted from nominal thickness.
- b. Table values are based on concrete with a minimum specified compressive strength of 2,500 psi. See Note e.
- c. Deflection criterion is $L/240$, where L is the clear span of the lintel in inches, or $1/2$ -inch, whichever is less.
- d. Linear interpolation between lintels depths, D , is permitted provided the two cells being used to interpolate are shaded.
- e. Where concrete with a minimum specified compressive strength of 3,000 psi is used, spans in cells that are shaded shall be permitted to be multiplied by 1.05.
- f. Lintel depth, D , is permitted to include the available height of wall located directly above the lintel, provided that the increased lintel depth spans the entire length of the lintel.
- g. DR indicates design required.
- h. The maximum clear opening width between two solid wall segments shall be 18 feet (5486 mm). See Section R611.7.2.1. Lintel spans in the table greater than 18 feet are shown for interpolation and information purposes only.

R611.8.1 Reinforcement around openings. Reinforcement shall be provided around openings in walls equal to or greater than 2 feet (610 mm) in width in accordance with this section and Figure R611.8(1), in addition to the minimum wall reinforcement required by [Sections R404.1.2](#), R611.6 and R611.7. Vertical wall reinforcement required by this section is permitted to be used as reinforcement at the ends of solid wall segments required by Section R611.7.2.2.2 provided it is located in accordance with Section R611.8.1.2. Wall openings shall have a minimum depth of concrete over the width of the opening of 8 inches (203 mm) in flat walls and waffle-grid walls, and 12 inches (305 mm) in screen-grid walls. Wall openings in waffle-grid and screen-grid walls shall be located such that not less than one-half of a vertical core occurs along each side of the opening.

R611.8.1.1 Horizontal reinforcement. Lintels complying with Section R611.8.2 shall be provided above wall openings equal to or greater than 2 feet (610 mm) in width.

Exception: Continuous horizontal wall reinforcement placed within 12 inches (305 mm) of the top of the wall *story* as required in [Sections R404.1.2.2](#) and R611.6.2 is permitted in lieu of top or bottom lintel reinforcement required by Section R611.8.2 provided that the continuous horizontal wall reinforcement meets the location requirements specified in Figures R611.8(2), R611.8(3), and R611.8(4) and the size requirements specified in Tables R611.8(2) through R611.8(10).

Openings equal to or greater than 2 feet (610 mm) in width shall have a minimum of one No. 4 bar placed within 12 inches (305 mm) of the bottom of the opening. See Figure R611.8(1).

Horizontal reinforcement placed above and below an opening shall extend beyond the edges of the opening the dimension required to develop the bar in tension in accordance with Section R611.5.4.4.

R611.8.1.2 Vertical reinforcement. Not less than one No. 4 bar [Grade 40 (280 MPa)] shall be provided on each side of openings equal to or greater than 2 feet (610 mm) in width. The vertical reinforcement required by this section shall extend the full height of the wall story and shall be located within 12 inches (305 mm) of each side of the opening. The vertical reinforcement required on each side of an opening by this section is permitted to serve as reinforcement at the ends of solid wall segments in accordance with Section R611.7.2.2.2,



provided it is located as required by the applicable detail in Figure R611.7(2). Where the vertical reinforcement required by this section is used to satisfy the requirements of Section R611.7.2.2.2 in waffle- and screen-grid walls, a concrete flange shall be created at the ends of the solid wall segments in accordance with Table R611.7(4), note e. In the top-most story, the reinforcement shall terminate in accordance with Section R611.6.4.

R611.8.2 Lintels. Lintels shall be provided over all openings equal to or greater than 2 feet (610 mm) in width. Lintels with uniform loading shall conform to Sections R611.8.2.1, and R611.8.2.2, or Section R611.8.2.3. Lintels supporting concentrated loads, such as from roof or floor beams or girders, shall be designed in accordance with [ACI 318](#).

R611.8.2.1 Lintels designed for gravity load-bearing conditions. Where a lintel will be subjected to gravity load condition 1 through 5 of Table R611.8(1), the clear span of the lintel shall not exceed that permitted by Tables R611.8(2) through R611.8(8). The maximum clear span of lintels with and without stirrups in flat walls shall be determined in accordance with Tables R611.8(2) through R611.8(5), and constructed in accordance with Figure R611.8(2). The maximum clear span of lintels with and without stirrups in waffle-grid walls shall be determined in accordance with Tables R611.8(6) and R611.8(7), and constructed in accordance with Figure R611.8(3). The maximum clear span of lintels with and without stirrups in screen-grid walls shall be determined in accordance with Table R611.8(8), and constructed in accordance with Figure R611.8(4).

Where required by the applicable table, No. 3 stirrups shall be installed in lintels at a maximum spacing of $d/2$ where d equals the depth of the lintel, D , less the cover of the concrete as shown in Figures R611.8(2) through R611.8(4). The smaller value of d computed for the top and bottom bar shall be used to determine the maximum stirrup spacing. Where stirrups are required in a lintel with a single bar or two bundled bars in the top and bottom, they shall be fabricated like the letter "c" or "s" with 135-degree (2.36 rad) standard hooks at each end that comply with Section R611.5.4.5 and Figure R611.5.4(3) and installed as shown in Figures R611.8(2) through R611.8(4). Where two bars are required in the top and bottom of the lintel and the bars are not bundled, the bars shall be separated by a minimum of 1 inch (25 mm). The free end of the stirrups shall be fabricated with 90- or 135-degree (1.57 or 2.36 rad) standard hooks that comply with Section R611.5.4.5 and Figure R611.5.4(3) and installed as shown in Figures R611.8(2) and R611.8(3). For flat, waffle-grid and screen-grid lintels, stirrups are not required in the center distance, A , portion of spans in accordance with Figure R611.8(1) and Tables R611.8(2) through R611.8(8). See Section R611.8.2.2, item 5, for requirement for stirrups through out lintels with bundled bars.

R611.8.2.2 Bundled bars in lintels. It is permitted to bundle two bars in contact with each other in lintels if all of the following are observed:

1. Bars no larger than No. 6 are bundled.
2. Where the wall thickness is not sufficient to provide not less than 3 inches (76 mm) of clear space beside bars (total on both sides) oriented horizontally in a bundle, the bundled bars shall be oriented in a vertical plane.
3. Where vertically oriented bundled bars terminate with standard hooks to develop the bars in tension beyond the support (see Section R611.5.4.4), the hook extensions shall be staggered to provide a minimum of one inch (25 mm) clear spacing between the extensions.
4. Bundled bars shall not be lap spliced within the lintel span and the length on each end of the lintel that is required to develop the bars in tension.
5. Bundled bars shall be enclosed within stirrups throughout the length of the lintel. Stirrups and the installation thereof shall comply with Section R611.8.2.1.



R611.8.2.3 Lintels without stirrups designed for nonload-bearing conditions. The maximum clear span of lintels without stirrups designed for nonload-bearing conditions of Table R611.8(1).1 shall be determined in accordance with this section. The maximum clear span of lintels without stirrups in flat walls shall be determined in accordance with Table R611.8(9), and the maximum clear span of lintels without stirrups in walls of waffle-grid or screen-grid construction shall be determined in accordance with Table R611.8(10).

R611.9 Requirements for connections-general. Concrete walls shall be connected to footings, floors, ceilings and roofs in accordance with this section.

TABLE R611.9(1) WOOD FRAMED FLOOR TO SIDE OF CONCRETE WALL, FRAMING PERPENDICULAR^{a, b, c}

ANCHOR BOLT SPACING (inches)	TENSION TIE SPACING (inches)	BASIC WIND SPEED (mph)					
		85B	90B	100B	110B	120B	130B
				85C	90C	100C	110C
			85D	90D	100D		
12	12						
12	24						
12	36						
12	48						
16	16					A	A
16	32						
16	48						
19.2	19.2	A	A	A	A	A	
19.2	38.4	A	A	A			

For SI: 1 inch = 25.4 mm; 1 mile per hour = 0.447 m/s.

- a. This table is for use with the detail in Figure R611.9(1). Use of this detail is permitted where a cell is not shaded and prohibited where shaded.
- b. Wall design per other provisions of Section R611 is required.
- c. Letter "A" indicates that a minimum nominal 3 × 8 ledger is required.

