



# Sign Up With Brooks!

# VINYL SIGNS (SELF-ADHESIVE)

# SELF-ADHESIVE VINYL SIGNS and LABELS are silk


screened with UV inks, then clear laminated for durability and fade resistance. Mounting surface must be clean, dry, smooth, and non-porous. To mount these on a porous surface, such as brick or concrete block, use our **Sign On!** aerosol adhesive.

# ALUMINUM SIGNS

ALUMINUM SIGNS are silk screened, then oven baked for added durability. They also have smooth, finished edges; rounded corners; and pre-drilled mounting holes. Ideal for mounting on porous surfaces, such as concrete block or brick.

# **RIGID PLASTIC SIGNS**

**RIGID PLASTIC SIGNS** are screen printed with UV inks on both sides. Rigid, tough plastic  $(\frac{1}{32})$  thick) with keyhole slots for easy perpendicular wall mounting.

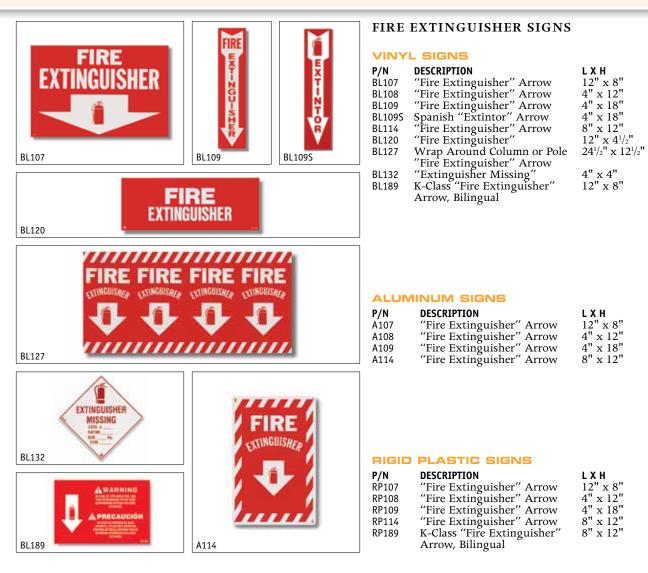


1-24

1-24

25+

25+

				S	IGNS, LABELS,	& TAGS 9 149
P/N AWM108 AWM109 AWM114	INUM 90° ANGLE SIGNS DESCRIPTION "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow	<b>L X H</b> 4" x 12" 4" x 18" 8" x 12"	1-24	25+	FIRE STINGUSHER	FIRE BXZGD
<b>PIGID</b> <b>P/N</b> PWM108 PWM109 PWM114	PLASTIC 90° ANGLE SIGNS DESCRIPTION "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow	<b>L X H</b> 4" x 12" 4" x 18" 8" x 12"	1-24	25+	AWM109   PWM114	PTD109
<b>3-D RI</b> <b>P/N</b> PTD108 PTD109 PTD182 PTD109B	GID PLASTIC ANGLE SIGNS DESCRIPTION "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow "Fire Extinguisher" Arrow, Bilingual	<b>L X H</b> 4" x 12" 4" x 18" 5" x 6" 11" x 18"	1-24	25+	PTD182	PTD109B
	EXTINGUISHER INSIDE SIGN SIGNS DESCRIPTION "Fire Extinguisher Inside" "Fire Extinguisher Inside" "Fire Extinguisher Inside"	S LXH 4" x 4" 6" x 9" 4" x 3"	1-24	25+	FIRE EXTINGUISHER INSIDE	FIRE EXTINGUISHER INSIDE
BL183 FIRE E	"Fire Extinguisher Inside"	18" x 2"			FIRE EXTINGUISHER INSIDE	ELISS
P/N BL130 BL123 BL128 BL106 BL135R BL135W* BL135W*	DESCRIPTION Reversed "In Case Of Fire Break Front" "Warning \$500 Fine" "WarningElectronic Alarm" "Fire Extinguisher - In Case Of Fire Break Glass" Red "Fire" Die-Cut White "Fire" Die-Cut "Pull Here" *WHILE QUANTITIES LAST!	$\begin{array}{c} \textbf{L X H} \\ 4^{3}/_{4}" \ge 1^{1}/_{2}" \\ 4'' \ge 4'' \\ 6'' \ge 2'' \\ 6'' \ge 2'' \\ 3'' \ge 8^{1}/_{2}'' \\ 3'' \ge 8^{1}/_{2}'' \\ 4'' \ge 2^{1}/_{2}'' \end{array}$	1-24	25+	BL172 WARNING \$500 FINE OB 6 MONTHS JAIL SENTENCE FOR TAMPERING WITH OR MISUSE	BL130 WARNING Ref L920 WARNING Ref L920 WARNING BL128
SIGN .	ADHESIVE				BL123	EXTINGUISHER In Case Of Fire Break Glass
	Sign On! ADHESIVE.					
P/N BA1	DESCRIPTION Sign On! Aerosol Adhesive		SEE PAI	EACH Ge 182		HERE NY OF FIRE! BA1

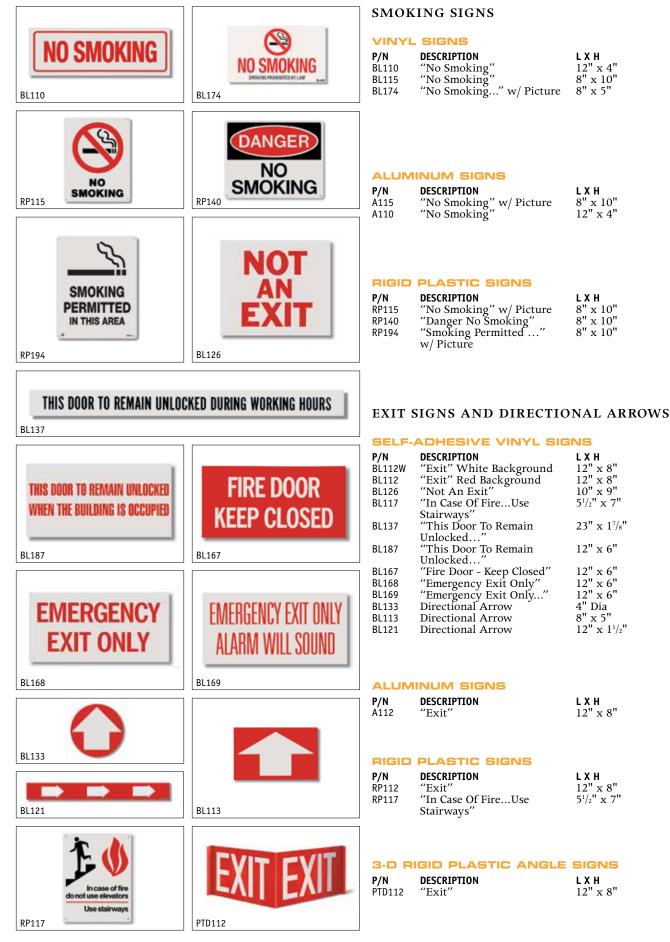

# 2013 © BROOKS EQUIPMENT COMPANY, LLC.

151

# FIRE HOSE SIGNS

## **VINYL SIGNS**

<b>P/N</b>	DESCRIPTION	<b>L X H</b>
BL111	"Fire Hose"	12" x 4"
BL118	"Fire Hose" Arrow	8" x 12"
PL125	"Fire Hose" Arrow	4" x 18"
BL125	"Fire Hose" Arrow	4" x 18"

#### PLASTIC 90° ANGLE SIGNS P/N DESCRIPTION L X H

1/11	DESCRIPTION	
PWM125	"Fire Hose" Arrow	4" x 18"

# FIRE ALARM SIGNS

## **VINYL SIGNS**

P/N	DESCRIPTION	LXH
BL119	"Fire Alarm" Arrow	8" x 12"
BL185	"Fire Alarm Pull Station	4" x 4"
	Inside"	

#### **3-D RIGID PLASTIC ANGLE SIGNS**

P/N	DESCRIPTION	LXH
PTD156	"Fire Alarm" Arrow	4" x 12"

# DANGER SIGNS

## **RIGID PLASTIC SIGNS**

P/N	DESCRIPTION	LXH
RP139	"Danger High Voltage"	10" x 8"
RP140	"Danger No Smoking"	10" x 8"
RP145	"Danger Safety Glasses"	10" x 8"
RP146	"Danger Flammable Liquids"	10" x 8"
RP147	"Danger Authorized"	10" x 8"
RP148	"Danger Construction"	10" x 8"
RP150	"Danger Flammable"	10" x 8"
RP151	"Danger Hard Hat Area"	10" x 8"
RP152	"Danger Keep Out"	10" x 8"
RP153	"Danger Do Not Enter"	10" x 8"
RP154	"Danger Ear Protection"	10" x 8"

2013 © BROOKS EQUIPMENT COMPANY, LLC.

# SAFETY TRAINING POSTERS

**SAFETY TRAINING POSTERS** provide concise, easy-tounderstand explanations of key safety topics and their specific issues. All posters are laminated on both sides for extra durability.

P/N	DESCRIPTION	LXH
FEPOSTER		24" x 18"
FAPOSTER	"First Aid Training"	24" x 18"



FAPOSTER

EACH

	MISCELLANEOUS SIGNS
103650BY	The HEIGHT INDICATOR mounts next to door frames to help law enforcement determine a criminal's height. Durable vinyl exceeds Reflectivity 3 requirements and is adhesive-backed for easy installation. Tape is 1 <sup>1</sup> / <sub>2</sub> " x 3' and measures from 4' to 7'. P/N DESCRIPTION 1-24 25+ 103650BY Height Indicator
BL124	VINYL SIGNSP/NDESCRIPTIONL X HBL170"Fire Blanket" Arrow4" x 18"BL124Hose Rack Operation13" x 2³/4"P/NDESCRIPTIONL X HBL144"First Aid Station" Arrow8" x 12"P/NDESCRIPTIONL X HBL157"First Aid Kit Inside"L X H
RP176 BL144 BL144 IN CASE OF EMERGENCY DIAL 911 DIAL 911	P/NDESCRIPTIONL X HRP176"Emergency Eye Wash"8" x 10"RP120"In Case of Emergency8" x 10"Dial 911""RP144"First Aid"8" x 10"RP257"For Use On Combustible"7" x 10"
RP120   RP257     Image: All problems   Image: All problems     PTD261   PTD176	<b>3-D RIGID PLASTIC ANGLE SIGNSP/NDESCRIPTIONL X H</b> PTD261AED Stand-Out5" x 6"PTD176"Emergency Eye Wash"18" x 10"
	GLOW-IN-THE-DARK SIGNS   GLOW-IN-THE-DARK SELF-ADHESIVE VINYL SIGNS   will glow for up to eight hours, remaining very visible in normal lighting. Cycling from daylight to darkness will not wear out signs.   P/N DESCRIPTION L X H   G108 "Fire Extinguisher" Arrow 4" x 12"   G109 "Fire Extinguisher" Arrow 4" x 18"   G112 "Exit" 12" x 8"   G113 Directional Arrow 8" x 5"   G126 "No Exit" 5" x 5"/4"   G186 "Fire Extinguisher" 6" x 1"   G261 AED Sign 6" x 8"
G126 FIRE EXTINGUISHER G186	For Photo-Luminescent Signs, See Page 139.

SIGNS, LABELS, & TAGS 5 153

# SYSTEM SIGNS

## ALUMINUM SIGNS (ADHESIVE-BACKED)

P/N	DESCRIPTION	LXH
A106	"Caution"	5" x 2"
A106S	Spanish "Caution"	5" x 2"
A272	"Remote Pull Station"	5" x 3"
A273	"Fire System"	5" x 3"
A276	"Fryer"	4" x 2"
A277	"Griddle"	4" x 2"
A278	"Broiler"	4" x 2"
A281	"Hood #1"	4" x 2"
A282	"Hood #2"	4" x 2"
A283	"Hood #3"	4" x 2"
A284	"Hood #4"	4" x 2"

# SPRINKLER SIGNS

**SPRINKLER IDENTIFICATION SIGNS** are made of aluminum, painted white, and printed with fade-resistant red ink. Each sign has predrilled mounting holes for easy installation.

P/N	DESCRIPTION	LXH	1-99	100+
A221♦	"Air Control"	6" x 2"		
A222◆	"Air Line"	6" x 2"		
A223◆	"Alarm Line"	6" x 2"		
A163	"Alarm Test"	6" x 2"		
A224◆	"Anti-Freeze System"	6" x 2"		
A225◆	"Auxiliary Drain"	6" x 2"		
A142	"Automatic Sprinkler"	6" x 4"		
A226◆	"This Valve Controls"	9" x 7"		
A143	"Control Valve"	6" x 2"		
A227◆	"Drain"	6" x 2"		
A228♦	"Drain Valve"	6" x 2"		
A229♦	"Dry Standpipe"	6" x 2"		
A160	"Inspection Test"	6" x 2"		
A230♦	"Entire System"	6" x 2"		
A243♦	"Fire Sprinkler Valve"	6" x 2"		
A164	"Hydraulic Data"	6" x 4"		
A232◆	"Hydraulic System"	5" x 7"		
A233♦	"Main Control"	6" x 2"		
A161	"Main Drain"	6" x 2"		
A234◆	"Normally Closed"	6" x 2"		
A235◆	"Normally Open"	6" x 2"		
A236◆	"Open Sprinkler Control"	6" x 2"		
A237◆	"Open Sprinkler Drain"	6" x 2"		
A162	"Sprinkler Control"	6" x 2"		
A165	"Sprinkler Fire-Alarm"	7 <sup>3</sup> /4" x 6"		
A238♦	"Sprinkler Valve Room"	6" x 2"		
A239♦	"Test & Drain"	6" x 2"		
A240♦	"Test Valve"	6" x 2"		
A241♦	"Water Motor Line"	6" x 2"		
A242♦	"Wet Standpipe"	6" x 2"		
	1 1			

◆ Plastic coated

**SPRINKLER ALARM SIGNS** are made of plastic, painted red, and printed with fade-resistant white ink. Each circular sign has a predrilled mounting hole for easy installation over alarm bell.

P/N	DESCRIPTION	DIA	EACH
RP251	"Sprinkler Fire Alarm"	7"	

These quality made **FDC SIGNS** help firefighters find water sources quickly. Signs are made of aluminum with predrilled holes for easy mounting.

<b>P/N</b> A244 A245 A246 BA246	<b>DESCRIPTION</b> "Fire Department Connection" "FDC" w/ Arrow, 4" Letters "FDC", 6" Letters	<b>L X H</b> 4" x 6" 12" x 10" 10" x 14"
RA246	"FDC", 6" Reflective Letters	7" x 14"
RA246	"FDC", 6" Reflective Letters	7" x 14"





# **EXAMPLE #1**

# THIS DOOR TO REMAIN UNLOCKED WHEN THE BUILDING IS OCCUPIED

**EXAMPLE #2** 



**EXAMPLE #3** 



**SPRINKLER CONTROL** 

# CUSTOM ENGRAVED SIGNS

Two exciting options available—**PLASTIC WITH PRE-**PUNCHED HOLES OF PLASTIC WITH ADHESIVE BACK.

- Custom made to your specifications—up to 432 sq. in.
- Seven different color schemes available.
- Comes complete with pre-punched corner holes or adhesive backs.
- · Service your non-traditional sign needs with our custom signs up to (24" x 18").

# **EXAMPLES:**



**PLASTIC WITH ADHESIVE BACK** 

System Serviced in Accordance with NFPA17 or 17A and 96 by **ABC Fire Systems** (555) 555-5555

**RED ON WHITE** 



**BLACK ON YELLOW** 




CORPORATE HEADQUARTERS P. O. Box 481908 Charlotte, NC 28269 www.brooksequipment.com TELEPHONE


SIGNS, LABELS, & TAG

800.826.3473 / 704.596.9438 FAX 800.433.9265

EMAIL sales@brooksequipment.com

# **CUSTOM ENGRAVED SIGNS EASY ORDER FORM**

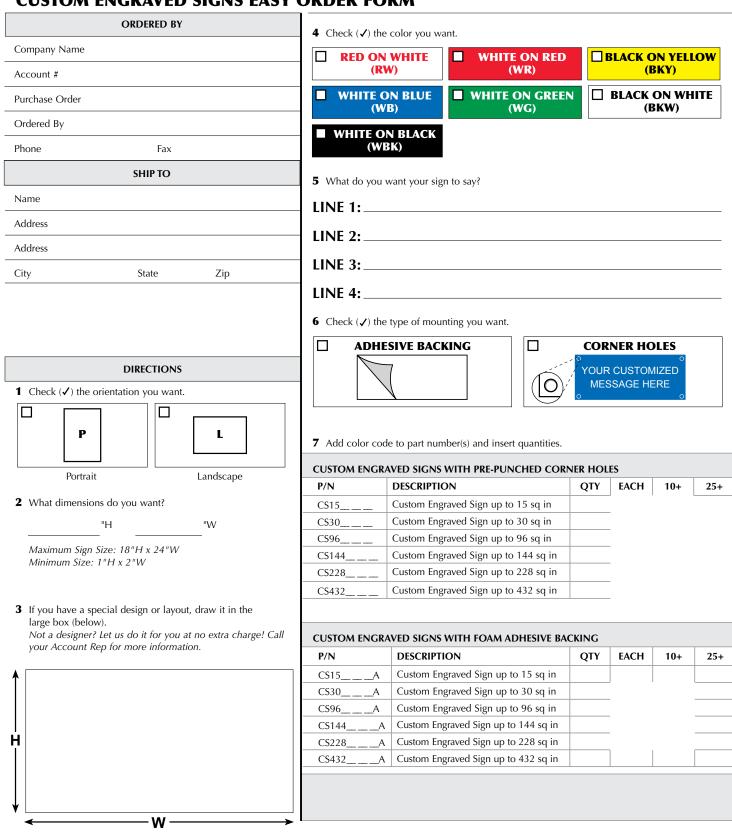

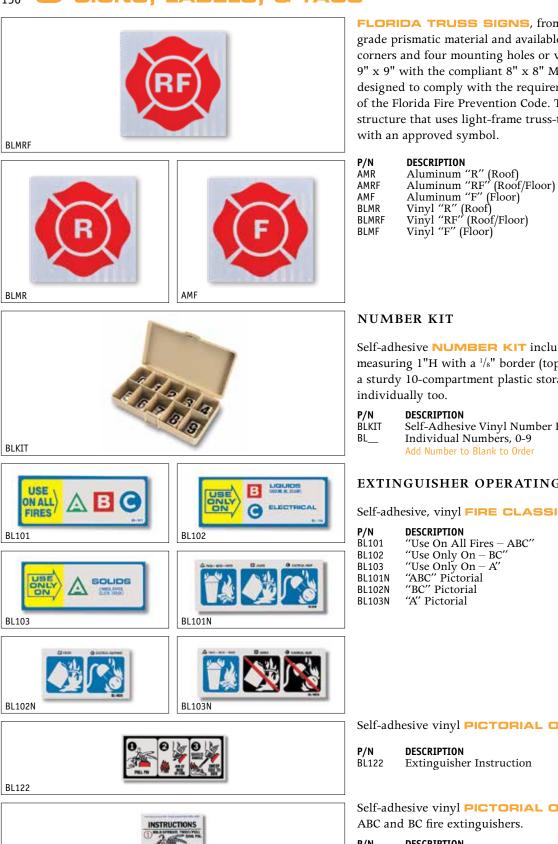

FLORIDA TRUSS SIGNS, from Brooks, are made of engineergrade prismatic material and available in .040 aluminum with radius corners and four mounting holes or vinyl peel and stick. Measuring 9" x 9" with the compliant 8" x 8" Maltese symbol, these signs are designed to comply with the requirements of Rule 69A-60.0081 of the Florida Fire Prevention Code. This rule requires that any structure that uses light-frame truss-type construction be marked

Self-adhesive NUMBER KIT includes 25 each of numbers 0–9, measuring 1"H with a 1/8" border (top and bottom). Comes in a sturdy 10-compartment plastic storage box. Order numbers

# Self-Adhesive Vinyl Number Kit Individual Numbers, 0-9 Add Number to Blank to Order

# EXTINGUISHER OPERATING LABELS

Self-adhesive, vinyl FIRE CLASSIFICATION LABELS.

8/10		5			
	P/N BL101 BL102 BL103 BL101N BL102N BL103N	DESCRIPTION "Use On All Fires – ABC" "Use Only On – BC" "Use Only On – A" "ABC" Pictorial "BC" Pictorial "A" Pictorial	$\begin{array}{c} {\sf L} \; {\sf X} \; {\sf H} \\ 4^{1}/2" \; \propto \; 1^{3}/4" \\ 3" \; \propto \; 1^{3}/4" \\ 4^{1}/2" \; \propto \; 1^{3}/4" \end{array}$	1-49 50-99 100+	

EACH


Self-adhesive vinyl **PICTORIAL OPERATING LABELS**.

P/N	DESCRIPTION	LXH	1-49 50-99 100+
BL122	Extinguisher Instruction	$5^{1/2}$ " x $2^{1/2}$ "	

Self-adhesive vinyl **PICTORIAL OPERATING LABELS** for ABC and BC fire extinguishers.

	-			
P/N	DESCRIPTION	LXH	1-49 50-99	100+
BL200	ABC Extinguisher w/ Hose	3" x 5 <sup>1</sup> / <sub>4</sub> "		
	Instruction			
BL201	ABC Extinguisher w/ Nozzle	3" x 5 <sup>1</sup> / <sub>4</sub> "		
	Instruction			
BL202	BC Extinguisher w/ Hose	3" x 5 <sup>1</sup> / <sub>4</sub> "		
	Instruction			
BL203	BC Extinguisher w/ Nozzle	3" x 5 <sup>1</sup> / <sub>4</sub> "		
	Instruction			

BL200

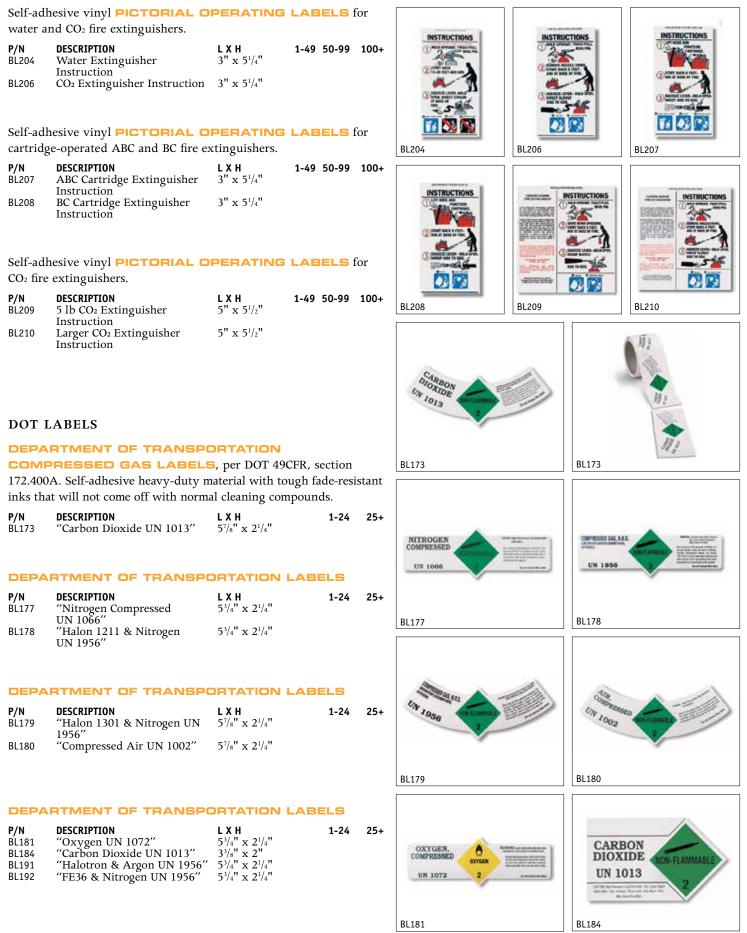




## **"NON-FLAMMABLE GAS" DOT SHIPPING LABELS**

(paper) are sold in rolls of 500.

P/N	DESCRIPTION	LXH
BL171	"Non-Flammable Gas"	4" x 4"

# **DEPARTMENT OF TRANSPORTATION LABELS**

P/N	DESCRIPTION	LXH	1-24	25-99	100+
BL188	"Nitrogen Compressed UN 1066"	3 <sup>3</sup> /8" x 2"			



#### RS301



#### CONDUCTIVITY TEST LABEL 13 14 15 16 Technician. ASOND MJ J

# NFPA HAZARD IDENTIFICATION DIAMONDS come in

two sizes, 10" and 16" square polystyrene. Designed to help meet hazcom/NFPA requirements with color coding to indicate fire, health, instability (reactivity), and special hazards. Also available are 3" (for 10" sign) and 6" (for 16" sign) black number/symbol kits. Kit includes three each of numerals 0, 1, 2, 3, 4, and one each of symbols for Oxidizer, Use No Water, Corrosive, and Radioactive. Minimum size of numerals and symbols must be 3" for legibility at 100' and 6" for legibility at 300'.

#### P/N DESCRIPTION NFPA 10" Hazard Identification Sign NFPA 16" Hazard Identification Sign 3" Numeral/Symbol Kit RS301

- RS302
- BI K3
- 6" Numeral/Symbol Kit BLK6

# CUSTOM HAZMAT LABELS

# Custom HAZARDOUS MATERIAL COMMUNICATION

LABELS meet NFPA 10 requirements. Vinyl labels are custom imprinted with your company name, address, and phone number. Minimum of 100 each per copy. \$35 minimum order.

NOTE: Do not install on front of extinguisher, per NFPA 10.

P/N	DESCI
SSPHMCL1	ABC
SSPHMCL2	BC H
SSPHMCL3	CO <sub>2</sub> ]
SSPHMCL4	Halo
SSPHMCL5	Wate
SSPHMCL9	Custo

RIPTION HazMat IazMat HazMat n HazMat er HazMat om HazMat

LXH 100+ 1,000+ 2,000+  $\begin{array}{c} 2^{3}/4'' \ge 2^{1}/2'' \\ 2^{3}/4'' \ge 2^{1}/2'' = 2^{1}/2'' \\ 2^{1}/2'' \ge 2^{1}/2'' =$  $2^{3}/_{4}$ " x  $2^{1}/_{2}$ "  $2^{3}/_{4}$ " x  $2^{1}/_{2}$ "

Custom-imprinted metallic CONDUCTIVITY TEST LABELS


have a single line imprint area. Two-roll minimum. 300 per roll.

P/N	DESCRIPTION	LXH
SSPCTL	Custom Conductivity Test	3" x 3/4"
CTLBK	Blank Conductivity Test	3" x <sup>3</sup> /4"
	(No Minimum Order)	

# CUSTOM HYDROTEST/SIX-YEAR LABELS

Choices—just one of many benefits of ordering from Brooks. HYDROTEST and SIX-YEAR MAINTENANCE LABELS are a necessary reminder to keep your customer's equipment maintenance and inspections up to date. And the benefit is, we'll custom imprint these labels with your company name, address, and phone number so your customer knows who to call. Plus you choose the material—white or blue vinyl or silver metallic that shows "Void" when removed—as recommended in NFPA 10. Minimum order is 1,000 for vinyl and 500 for metallic labels. Sold and priced per 100. Delivery is four to six weeks.

P/N	DESCRIPTION	LXH
SSPVHT	Low-Pressure Hydrostatic Test, White Vinyl	$3^{1}/_{2}$ " x $2^{1}/_{4}$ "
SSPV6H	6-Year Standard Hydrotest, White Vinyl	$3^{1}/_{2}$ " x $2^{1}/_{4}$ "
SSPVCA	California Hydrotest, White Vinyl	$3^{1}/4^{"} \ge 2^{1}/4^{"}$
SSPBL6	6-Year Maintenance, Blue Vinyl	$3^{1}/_{2}$ " x $2^{1}/_{4}$ "

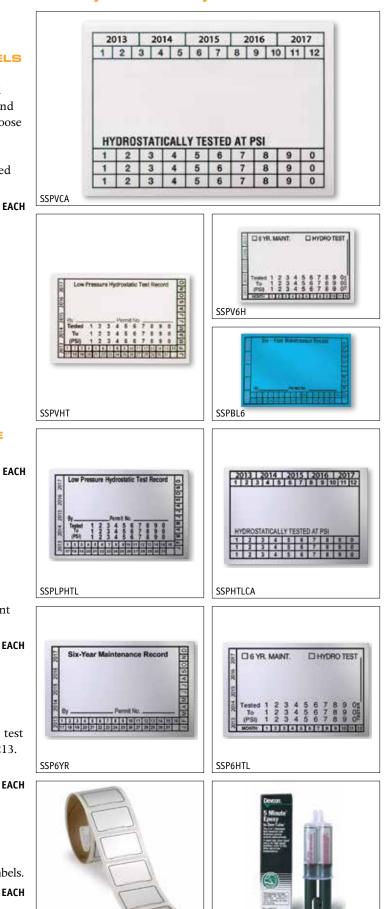

5ME

Custom HYDROTEST and SIX-YEAR MAINTENANCE METALIZED LABELS.

<b>P/N</b> SSPLPHTL	<b>DESCRIPTION</b> Low-Pressure Hydrostatic Test, Silver Metallic	<b>L X H</b> $3^{1}/2^{"} \ge 2^{1}/4^{"}$
SSPHTLCA	California Hydrotest	$3^{1/4}$ " x $2^{1/4}$ "
SSP6YR	6-Year Maintenance	$3^{1/2}$ " x $2^{1/4}$ "
SSP6HTL	6-Year Standard Hydrotest	$3^{1/2}$ " x $2^{1/4}$ "

# BLANK HYDROTEST/SIX-YEAR LABELS are silver

"Void" metalized material. Stamp your own name (with permanent ink). 250 per roll.


P/N	DESCRIPTION	LXH	EAC
6HTLBK	6-Year Blank Hydrotest, Silver Metallic	$3^{1/2}$ " x $2^{1/4}$ "	

**COMPOSITE CYLINDER TEST LABELS** for recording test information on composite cylinders, per DOT 49CFR, section 180.213. Instructions provided.

P/N	DESCRIPTION	LXH	EA
CRL50	Composite Retest Labels, Pkg/50	2" x 1 <sup>1</sup> /4"	

**FIVE-MINUTE EPOXY** for applying over the composite test labels.

P/N DESCRIPTION 5ME 5-Minute Epoxy CRL50

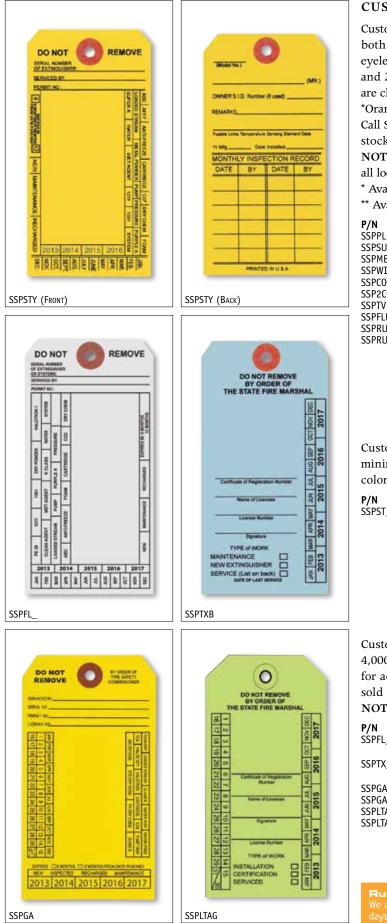

# CUSTOM SERVICE TAGS

Custom-imprinted extinguisher **SERVICE TAGS** are printed on both sides with black ink on a coated 13-pt stock with reinforced eyelets. Metal eyelets and/or wire optional. Deadline—every 10<sup>th</sup> and 25<sup>th</sup> of each month with delivery in six to eight weeks. Years are changed automatically every October. Colors available: Yellow (Y), \*Orange (O), Blue (B), Green (G), Red (R), \*\*Lilac (L), and White (W). Call Sales for pricing on large orders, special designs and our custom stocking program.

NOTE: It is the customer's responsibility to be sure the tag design meets all local and state regulations. SSPRUSH35 not available for Tyvek tags. \* Available for SSPST only!

\*\* Available for SSPST, SSPCA, and SSPNF.

P/N	DESCRIPTION
SSPPL	Plate Charge (New & Revised Orders Only)
SSPSU	Set-Up Charge (For Each Order)
SSPME	Metal Eyelets Add-On
SSPWIRE	Wire Attachment Add-On
SSPCOLOR	Additional Color Charge
SSP2C0	Additional Ink Add-On
SSPTVK	Tyvek Add-On, White Only (5,000 min.)
SSPFLU	Fluorescent Add-On
SSPRUSH	Rush Delivery Charge, 2–3 Week Print-Time
SSPRUSH35	Rush Delivery Charge, 3–5 Day Print-Time
	(Max 10,000 Tags)

# Custom-imprinted **STANDARD SERVICE TAGS** have a

minimum order of 2,000 tags. See above for additional options and color codes. Priced and sold per 1,000.

ST_	<b>DESCRIPTION</b> Service Tags	<b>L X H</b> $2^{5}/8'' \ge 5^{1}/4$	2-4	5.
	Add Color Code to Blank to Order			

Custom-imprinted **SERVICE TAGS** have a minimum order of 4,000 tags. Tags meet state regulations as of catalog printing. See above for additional options and color codes. Custom tags are priced and sold per 1,000.

NOTE: Red not permitted in Texas!

<b>p/n</b> SSPFL_	DESCRIPTION Custom Florida	<b>L X H</b> $2^{5}/8'' \ge 5^{1}/4''$	4	5-14	15+
SSPTX_	Add Color Code to Blank to Order Custom Texas Add Color Code to Blank to Order	2 <sup>5</sup> /8" x 5 <sup>1</sup> /4"			
SSPGA SSPGAB SSPLTAG SSPLTAGB	Custom Georgia, Yellow Custom Georgia, Lt. Blue Custom Louisiana, Green Custom Louisiana, Blue	3" x 5 <sup>1</sup> /2" 3" x 5 <sup>1</sup> /2" 2 <sup>5</sup> /8" x 5 <sup>1</sup> /4" 2 <sup>5</sup> /8" x 5 <sup>1</sup> /4"			


Rush Tag Orders Available In Three to Five Days! We can now ship your tag orders faster than ever, printing most within 3-5 business days from the date of final proof. Contact your Sales Rep for more information.

EACH

-14

15+

161

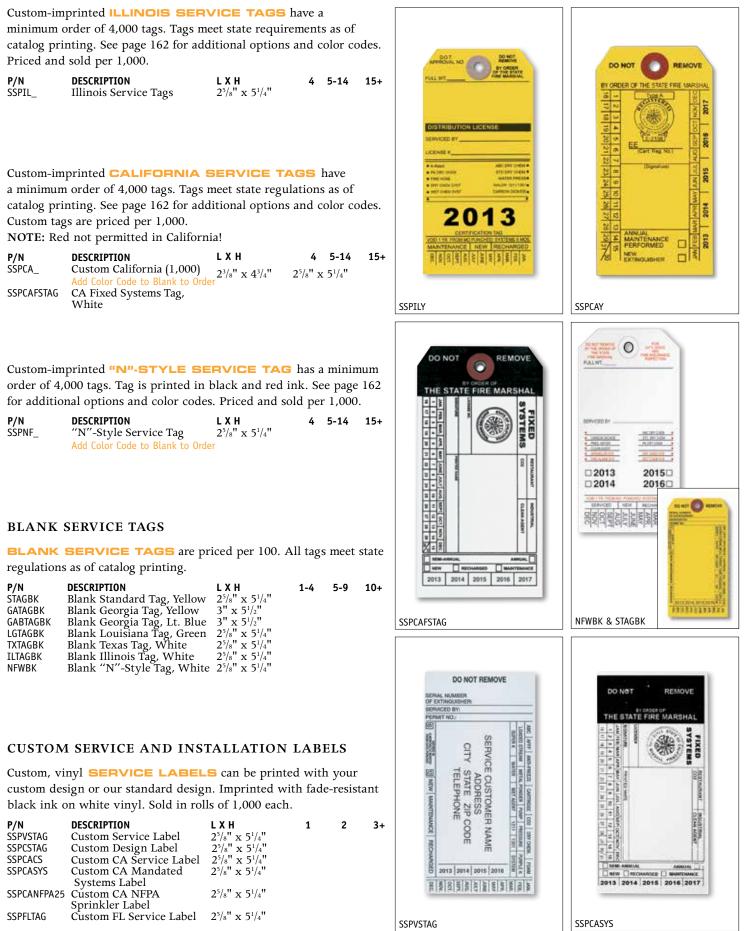



Custom "CALL FOR SERVICE" LABEL with your company name and phone number. White polyvinyl with red/yellow border and black imprint. Use on extinguishers, hoods, first aid kits, hose stations, etc. Sold in rolls of 500 each.

P/N	DESCRIPTION	LXH	EACH
SSPFSL	Custom "Call for Service"	3 <sup>1</sup> / <sub>4</sub> " x 2"	

Imprinted, vinyl INSTALLATION LABEL for automatic systems and alarm panels. Sold in rolls of 100 each.

P/N	DESCRIPTION	LXH	EACH
LAIL100	Louisiana Installation Label	$3^{7}/8'' \ge 3^{7}/8''$	
TXIL100	Texas Installation Label	5" x 4"	
0KIL100	Oklahoma Installation Label	5" x 4"	

# **AGENT REPLACEMENT LABEL**. Use to record agent

replacement as required by NFPA 10, sections 7.4.2.3.1 (Foam), 7.4.2.2 (Wet Agent), and 7.4.3.11 (Wet Chemical). Same material as our continuity test labels (silver metallic), preprinted with four years on a roll of 300 labels.

P/N	DESCRIPTION	LXH	EACH
ARL300	Agent Replacement Label	3" x ${}^{3}\!/_{4}$ "	

# VERIFICATION OF SERVICE COLLARS (CUSTOM AND BLANK)

VERIFICATION OF SERVICE COLLARS. Made of durable polymer material, this collar is available in four different sizes. Each size is a different color for identification. Two smallest sizes have two years molded; larger ones have four.

NOTE: Collars read, "Verification of Service, YR \_\_\_\_\_" and "MN 1-12".

P/N	DESCRIPTION	PKG QTY	ID	EACH
SC1	Green	100	$1^{3}/8''$	
SC2	Gray	100	1 <sup>3</sup> /4"	
SC3	Blue	50	$2^{1}/8''$	
SC4	Violet	50	31/16"	

Custom-imprinted VERIFICATION OF SERVICE COLLARS comply with NFPA 10. Made of high-density polyethylene with clear polyester over lamination. Available in four sizes with your company name and phone number imprinted in durable colored ink on white background. Other custom imprint available (as required by state). Normal delivery is two to four weeks. \$35 minimum order. NOTE: Collars approved for the State of Georgia.

P/N	DESCRIPTION	PKG QTY	ID	EACH
SSPCC1	Custom, Green	100	$1^{3}/8''$	
SSPCC2	Custom, Gray	100	$1^{3}/4''$	
SSPCC3	Custom, Blue	100	$2^{1}/8''$	
SSPCC4	Custom, Violet	100	3 <sup>1</sup> / <sub>16</sub> "	

# Custom-imprinted CALIFORNIA VERIFICATION OF

**SERVICE COLLARS** meet California State requirements.

Same specifications and order requirements as our custom-imprinted Verification of Service Collars (above).


NOTE: Company name and E# are required on CA collars.


P/N	DESCRIPTION	PKG QTY	ID	EACH
SSPCCAL1	Custom CA, Green	100	$1^{3}/8''$	
SSPCCAL2	Custom CA, Gray	100	$1^{3}/4''$	
SSPCCAL3	Custom CA, Blue	100	$2^{1}/8''$	
SSPCCAL4	Custom CA, Violet	100	3 <sup>1</sup> / <sub>16</sub> "	





ARL300

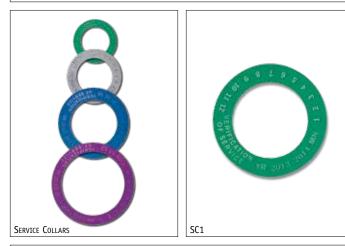

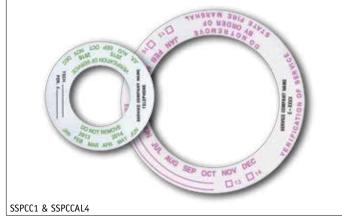

Nº 280594

Nº 280594

CLAIM CHECK

NON-COMPLIANCE INSPECTION NOTICE

REASON FOR NON-COMPLIANCE

CRTAG

EACH

# MISCELLANEOUS TAGS

**CUSTOMER REPAIR TAG** allows you to document the work performed on each extinguisher and the total amount to be paid. Comes with a looped string for easy attachment around gauge. The bottom is perforated to give the customer their claim check. Sold in packages of 100.

P/N	DESCRIPTION	LXH	EACH
CRTAG	Customer Repair Tag	$3^{1}/8'' \ge 5^{1}/2''$	

Blank **TEXAS IMPAIRED TAG** is designed for use with portable extinguishers and systems, per Texas Code. Measures  $2^{1/4}$ " x  $5^{1/4}$ " and is red with black imprint. Sold in packages of 100.

P/N	DESCRIPTION	LXH	EACH
REDTXBK	Texas Impaired Tag	$2^{5}/8$ " x $5^{1}/4$ "	

**NON-COMPLIANCE TAG** is for recording deficiencies in fire equipment. Two-part carbon form with paper front and heavy, red stock backing. TNC50 meets State of Georgia code and CANC50 meets State of California code. Sold in packages of 50.

P/N	DESCRIPTION	LXH	EACH
TNC50	Non-Compliance Tag	$3^{1}/_{8}$ " x $6^{1}/_{4}$ "	
CANC50	California Non-Compliance Tag	3 <sup>1</sup> /8" x 6 <sup>1</sup> /4"	

**CONDEMNED TAG** for extinguishers that need to be removed from service. Red, as required by many states.

P/N	DESCRIPTION	LXH	EACH
ECTAG	Condemned Tag	5 <sup>1</sup> /4" x 2 <sup>3</sup> /4"	

Use this perforated **CYLINDER TAG** to indicate whether your cylinders are empty, in use, or full. Tags are white and come with a fiber patch and wires. Sold in packages of 50.

<b>P/N</b> 3PCT	<b>DESCRIPTION</b> Cylinder Tag	<b>L X H</b> $2^{5/8}$ " x $5^{1/4}$ "	EACH

<b>AED INSPECTION TAG</b> is sold in packages of 100. White with red print.			
<b>P/N</b> AEDTAGBK	<b>DESCRIPTION</b> AED Inspection Tag	<b>L X H</b> $2^{5}/8'' \ge 5^{1}/4''$	EACH

Plastic three-year monthly INSPECTION & RECHARGE TAG record is designed for recording service and inspection dates, all on one tag. Printed in black and red ink on plastic stock. Back side is

LXH

215/16" x 5"

printed with twelve-month record (up to four years).

Inspection & Recharge Tag

DESCRIPTION



DO NOT REMOVE EQUIPMENT IMPAIRED
Centilization of Registration National Network Commission Bigmittaile Commission National
0 Date
REDTXBK

163



RE EXTINGUISHE

P/N

IŤAG



# METAL FOUR-YEAR INSPECTION TAG is designed to

record monthly inspections of fire extinguishers.

<b>P/N</b> TAG	<b>DESCRIPTION</b> Metal 4-Year Inspection Tag	<b>L X H</b> 2 <sup>1</sup> /4" x 3"	EACH
<b>PLASTIC FOUR-YEAR INSPECTION TAG</b> is made of strong 23 mil high-density yellow plastic. Tags will not break, tear, crack, or become brittle with age. Unaffected by moisture, oils, and grease too. Sold individually.			
<b>P/N</b> 4PTAG	<b>DESCRIPTION</b> Plastic 4-Year Inspection Tag	L X H 2 <sup>1</sup> / <sub>4</sub> " x 3"	EACH
Peel-and-stick monthly <b>INSPECTION TAG</b> are printed with green ink on white label stock. Sold in rolls of 100.			
<b>P/N</b> MTAG	<b>DESCRIPTION</b> Inspection Tag	<b>L X H</b> 2" x 3"	EACH 6.36
<b>PLASTIC INSPECTION TAG</b> is for outside use. Will not tear, break, crack, or become brittle with age. Unaffected by moisture, oils, and grease too. Twelve-month record on yellow plastic. Sold individually.			
<b>P/N</b> PTAG	<b>DESCRIPTION</b> Plastic Inspection Tag	<b>L X H</b> $2^{1}/2^{"} \times 4^{1}/8^{"}$	EACH
The <b>MONTHLY INSPECTION TAG</b> , printed on card stock, is ideal for indoor monthly fire equipment inspections by plant personnel. Sold in packages of 100.			
<b>P/N</b> RT100	<b>DESCRIPTION</b> Monthly Inspection Tag	<b>L X H</b> $2^{5}/8'' \ge 5^{1}/4''$	EACH
	IOSE INSPECTION/HYDF		
printed	with red ink on white card stock	. Sold individually.	
<b>P/N</b> FHTAG	<b>DESCRIPTION</b> Fire Hose Inspection/ Hydrotest Tag	<b>LXH</b> 2 <sup>7</sup> /s" x 5 <sup>3</sup> /4"	EACH
	CCESSORIES		
	<b>OVERS</b> are perfect for keeping	ng dust and water away	
from your tags. NOTE: See Page 300 for "Zip Lock Report Holders".			
<b>P/N</b> STC	DESCRIPTION Standard Tag Cover	<b>H X W</b> 6 <sup>3</sup> / <sub>4</sub> " x 3 <sup>1</sup> / <sub>2</sub> "	EACH
HSTC	2.5 mil Poly Heavy-Duty Tag Cover	$6^{1/2}$ " x $3^{1/8}$ "	
TBZL2*	10 mil Frosty Matte Soft Vinyl Resealable Tag Cover (Adhesive-Backed)	6 <sup>3</sup> / <sub>4</sub> " x 3 <sup>5</sup> / <sub>16</sub> "	
TBZL3*	10 mil Satin Resealable Tag Cover 10 mil Satin	6 <sup>3</sup> / <sub>4</sub> " x 3 <sup>3</sup> / <sub>8</sub> "	
RFTC2*	Heavy-Duty Red Flap Tag Cover 10 mil Satin	7" x 3 <sup>5</sup> / <sub>16</sub> "	
	*Must Be Purchased In Quantities of 50		

### TAG FASTENERS

# DESCRIPTION

	5" Secur-A-Tach Tag Seal, Pkg/1,000
.8	5½" Nylon Tag Seal, Pkg/5,000
4	5 <sup>1</sup> / <sub>4</sub> " Polypropylene Seal, Pkg/5,000
	Galvanized Tag Wire, Pkg/1,000
000	Diamond Tag Fastener, Pkg/1,000

EACH